


**50TC
Cooling Only/Electric Heat
Packaged Rooftop
3 to 15 Nominal Tons**



Product Data

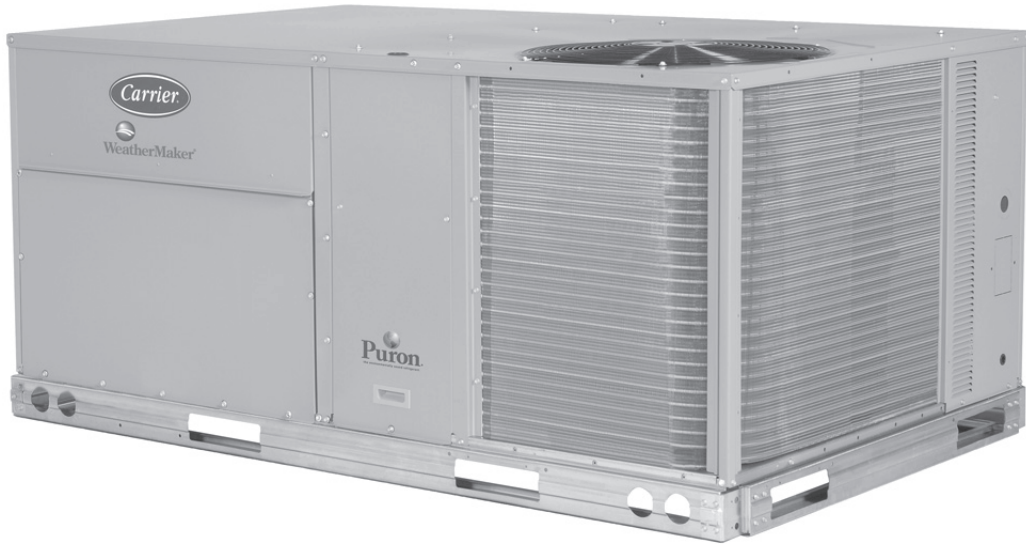

C08613



TABLE OF CONTENTS

	PAGE		PAGE
FEATURES AND BENEFITS	3	APPLICATION DATA	32
MODEL NUMBER NOMENCLATURE	4	COOLING TABLES	35
FACTORY OPTIONS & ACCESSORIES	6	STATIC PRESSURE TABLES	56
AHRI CAPACITY RATING	9	FAN PERFORMANCE	59
SOUND PERFORMANCE	11	ELECTRICAL INFORMATION	76
PHYSICAL DATA	12	SEQUENCE OF OPERATION	141
CURBS & WEIGHTS DIMENSIONS	16	GUIDE SPECIFICATIONS	144



Turn to the Experts™

The Carrier rooftop unit (RTU) was designed by customers for customers. With no-strip screw collars, handled access panels, and more we've made your unit easy to install, easy to maintain and easy to use.

Easy to install:

All WeatherMaker™ units are field-convertible to horizontal air flow which makes it easy to adjust to unexpected job site complications. Lighter units make easy replacement. Most Carrier 50TC rooftops fit on existing Carrier curbs dating back to 1989. Also, our large control box gives you room to work and room to mount Carrier accessory controls.

Easy to maintain:

Easy access handles by Carrier provide quick and easy access to all normally serviced components. Our "no-strip" screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit's metal. Take accurate pressure readings by reading condenser pressure with panels on. Simply remove the black, composite plug, route your gauge line(s) through the hole, and connect them to the refrigeration service valve(s).

Easy to use:

The newly designed, central terminal board by Carrier puts all your connections and troubleshooting points in one convenient place, standard. Most low voltage connections are made to the same board and make it easy to find what you're looking for and easy to access it. Carrier rooftops have high and low pressure switches, a filter drier, and 2-in (51mm) filters standard.

FEATURES AND BENEFITS

- Single-stage cooling capacity control on 04 to 12 models. Two-stage cooling capacity control on 08 to 16 models.
 - SEER's up to 13.0 (up to 13.4 with ECM motor*)
 - EER's up to 11.3 (up to 11.4 with ECM motor*)
 - IEER's up to 12.2 with single speed indoor fan motor.
 - IEER's up to 13.0 with 2-speed/VFD indoor fan motor.
 - Up to 28% lighter than similar industry units. Lighter rooftops make easier replacement jobs.
 - 3-12.5 ton units fit on existing Carrier rooftop curbs making the utility connections the same. This saves time and money on replacement jobs.
 - Standardized components and layout. Standardized components and controls make service and stocking parts easier.
 - Scroll compressors on all units. This makes service, stocking parts, replacement, and troubleshooting easier.
 - Field convertible airflow (3-12.5 tons). Being able to convert a unit from vertical airflow to horizontal makes it easy to overcome job site complications. 15 ton models requires a simple supply duct cover to field convert from factory vertical to horizontal.
 - Easy-adjust, belt-drive motor available. There's no need for field-supplied drives or motors.
 - Provisions for bottom or side condensate drain.
 - Capable of thru-the-base or thru-the-curb electrical routing.
 - Single-point electrical connection.
 - Sloped, composite drain pan sheds water; and won't rust.
 - Standardized controls and control box layout. Standardized components and controls make stocking parts and service easier.
 - Clean, large, easy to use control box.
 - Color-coded wiring.
 - Large, laminated wiring and power wiring drawings which are affixed to unit make troubleshooting easy.
 - Single, central terminal board for test and wiring connections.
 - Fast-access, handled, panels for easy access to the blower and blower motor, control box, and compressors.
 - "No-strip" screw system guides screws into the panel and captures them tightly without stripping the screw, the panel, or the unit.
 - Exclusive, newly-design indoor refrigerant header for easier maintenance and replacement.
 - Mechanical cooling (115°F to 40°F or 46°C to 4°C) standard on all models. Winter start kit allows cooling operation down to 25°F (-4°C) and MotorMaster to -20°F (-29°C).
 - 2-in (51mm) disposable filters on all units.
 - Refrigerant filter-drier on each circuit.
 - High and low pressure switches. Added reliability with high pressure switch and low pressure switch.
 - Factory-installed Humidi-MiZer® adaptive dehumidification system on all sizes with round tube/plate fin condenser coils, includes MotorMaster I controller.
- NOTE:** The last order date for 50TC 04-06 units with Humidi-MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.
- Optional Staged Air Volume (SAV) system utilizes a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed between cooling stages. Available on 2-stage cooling models 08-16 with electromechanical controls or RTU Open.

* ECM motor is available on size 04-06 units only.

MODEL NUMBER NOMENCLATURE

Position:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
Example:	5	0	T	C	-	A	0	4	A	1	A	5	-	0	A	0	A	0

Unit Heat Type

50 - Electric Heat Packaged Rooftop

Model Series - WeatherMaker™

TC - Standard Efficiency

Heat Size

- = No heat

Refrig. Systems Options

A = Standard One Stage Cooling Models

B = Standard One Stage Cooling with Humidi-MiZer® (04-07 models only)¹

D = Two Stage Cooling Models 08-16

E = Two Stage Cooling Models 08-16 with

Al/Cu condenser Coils and with Humidi-MiZer

Cooling Tons

04 = 3 tons	07 = 6 tons	12 = 10 tons
05 = 4 tons	08 = 7.5 tons	14 = 12.5 tons
06 = 5 tons	09 = 8.5 tons	16 = 15 tons

Sensor Options

A = None

B = RA Smoke Detector

C = SA Smoke Detector

D = RA + SA Smoke Detector

E = CO₂ Sensor

F = RA Smoke Detector and CO₂ Sensor

G = SA Smoke Detector and CO₂ Sensor

H = RA + SA Smoke Detector and CO₂ Sensor

Indoor Fan Options

0 = Direct Drive ECM (Sizes 04-06 / -5 voltage only)

1 = Belt Drive, Standard Static Option

2 = Belt Drive, Medium Static Option

3 = Belt Drive, High Static Option

C = High Static Option with High Efficiency Motor (Size 16 Only)

Coil Options – RTPF (Outdoor - Indoor - Hail Guard)

A = Al/Cu - Al/Cu

B = Precoat Al/Cu - Al/Cu

C = E-coat Al/Cu - Al/Cu

D = E-coat Al/Cu - E-coat Al/Cu

E = Cu/Cu - Al/Cu

F = Cu/Cu - Cu/Cu

M = Al/Cu - Al/Cu — Louvered Hail Guard

N = Precoat Al/Cu - Al/Cu — Louvered Hail Guard

P = E-coat Al/Cu - Al/Cu — Louvered Hail Guard

Q = E-coat Al/Cu - E-coat Al/Cu — Louvered Hail Guard

R = Cu/Cu - Al/Cu — Louvered Hail Guard

S = Cu/Cu - Cu/Cu — Louvered Hail Guard

Coil Options – Novation (Outdoor - Indoor - Hail Guard)

G = Al/Al - Al/Cu

H = Al/Al - Cu/Cu

J = Al/Al - E-coat Al/Cu

K = E-coat Al/Al - Al/Cu

L = E-coat Al/Al - E-coat Al/Cu

T = Al/Al - Al/Cu — Louvered Hail Guard

U = Al/Al - Cu/Cu — Louvered Hail Guard

V = Al/Al - E-coat Al/Cu — Louvered Hail Guard

W = E-coat Al/Al - Al/Cu — Louvered Hail Guard

X = E-coat Al/Al - E-coat Al/Cu — Louvered Hail Guard

Packaging & Seismic Compliance

0 = Standard

1 = LTL

3 = California Seismic Compliant Label

4 = LTL and CA Seismic Compliant Label

Electrical Options

A = None

C = Non-Fused Disconnect

D = Thru-The-Base Connections

F = Non-Fused Disconnect and Thru-The-Base Connections

G = 2-Speed Indoor Fan (VFD) Controller

J = 2 Speed Fan Controller (VFD) and

Non-Fused Disconnect

K = 2 Speed Fan Controller (VFD) and

Thru-The-Base Connections

M = 2 Speed Fan Controller (VFD)

with Non-Fused Disconnect and

Thru-The-Base Connections

Service Options

0 = None

1 = Unpowered Convenience Outlet

2 = Powered Convenience Outlet

3 = Hinged Panels

4 = Hinged Panels and

Unpowered Convenience Outlet

5 = Hinged Panels and

Powered Convenience Outlet

Intake / Exhaust Options

A = None

B = Temperature Economizer w/ Barometric Relief

F = Enthalpy Economizer w/ Barometric Relief

K = 2-Position Damper

U = Temperature Ultra Low Leak Economizer w/ Barometric Relief

W = Enthalpy Ultra Low Leak Economizer

w/ Barometric Relief

Base Unit Controls

0 = Electromechanical Controls can be used with W7212

EconoMi\$er IV (Non-Fault Detection and Diagnostic)

1 = PremierLink Controller

2 = RTU Open Multi-Protocol Controller

6 = Electro-mechanical w/ 2-Speed Fan and W7220

Economizer Controller Controls. Can be used with

W7220 EconoMi\$er X (w/ Fault Detection & Diagnostic)

Design Revision

- = Factory Design Revision

Voltage

1 = 575/3/60

5 = 208-230/3/60

3 = 208-230/1/60²

6 = 460/3/60

NOTES:

On single phase (-3 voltage code) models, the following are not available as a factory installed option:

- Humidi-MiZer

- Coated Coils or Cu Fin Coils

- Louvered Hail Guards

- Economizer or 2 Position Damper

- Powered 115 Volt Convenience Outlet

¹ Last order date for 50TC 04-06 with Humidi-MiZer is October 12, 2015. Use KC, HC or LC models after that date.

² Production of single phase voltage models has been discontinued per DOE regulations. Single phase 50TC models will only be available until current inventories are exhausted.

Not all possible options are displayed, see the current 50TC 04-16 Price Pages for more details.

Table 1 – FACTORY-INSTALLED OPTIONS AND FIELD-INSTALLED ACCESSORIES

CATEGORY	ITEM	FACTORY INSTALLED OPTION	FIELD INSTALLED ACCESSORY
Cabinet	Supply Duct Cover (16 size only)		X
	Thru-the-base electrical connections	X	X
	California Seismic Compliant Labeling	X	
	Hinged Access Panels	X	
Coil Options	Cu/Cu indoor and/or outdoor coils ^{1, 6}	X	
	Pre-coated outdoor coils ^{1, 6}	X	
	Premium, E-coated outdoor coils ^{1, 6}	X	
Humidity Control	Humidi-MiZer [®] Adaptive Dehumidification System ^{6, 9}	X	
Condenser Protection	Condenser coil hail guard (louvered design) ⁶	X	X
Controls	Thermostats, temperature sensors, and subbases		X
	PremierLink DDC communicating controller	X	X
	RTU Open – protocol controller	X	
	Smoke detector (supply and/or return air)	X	
	Time Guard II compressor delay control circuit		X
	Phase Monitor		X
Economizers & Outdoor Air Dampers	EconoMiSer IV (for electro-mechanical controlled – Non FDD (Standard air leak damper models) ^{6,7}	X	X
	EconoMiSer2 for DDC controls, complies with FDD (Standard and Ultra Low Leak air damper models) ^{6,8}	X	X
	Motorized 2 position outdoor-air damper ⁶	X	X
	Manual outdoor-air damper (25% and 50%)		X
	Barometric relief ²	X	X
	Power exhaust		X
	EconoMiSer X for electro-mechanical controls, complies with FDD (Standard and Ultra Low Leak air damper models) ^{6,7}	X	X
Economizer Sensors & IAQ Devices	Single dry bulb temperature sensors ³	X	X
	Differential dry bulb temperature sensors ³		X
	Single enthalpy sensors ³	X	X
	Differential enthalpy sensors ³		X
	CO ₂ sensor (wall, duct, or unit mounted) ³	X	X
Electric Heat	Electric Resistance Heaters		X
	Single Point Kit		X
Indoor Motor & Drive	Multiple motor and drive packages	X	
	Staged Air Vol (SAV) system w/VFD controller (2-stage cool only with electrical mechanical and RTU Open controls)	X	
	Display Kit for SAV system with VFD		X
Low Ambient Control	Winter start kit ⁴		X
	Motormaster [®] head pressure controller ⁴		X
Power Options	Convenience outlet (powered) ⁶	X	
	Convenience outlet (unpowered)	X	
	Non-fused disconnect ⁵	X	
	Disconnect Switch Bracket (16 size only)		X
Roof Curbs	Roof curb 14-in (356mm)		X
	Roof curb 24-in (610mm)		X

NOTES:

1. Novation coated coils are only available with E-coat.
2. Included with economizer.
3. Sensors for optimizing economizer.
4. See application data for assistance.
5. Available on units with MOCP's of 80 amps or less.
6. Not available as factory installed option on single phase (208/230/1/60) models. Use field-installed accessory where available.
7. FDD – (Fault Detection and Diagnostic) capability per California Title 24 section 120.2
8. Models with RTU Open DDC controls comply with California Title 24 Fault Detection and Diagnostic (FDD). PremierLink is non FDD.
9. The last order date for 48TC 04–06 units with Humidi-MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.

FACTORY OPTIONS AND/OR ACCESSORIES

Economizer (dry-bulb or enthalpy)

Economizers save energy, money and improve comfort levels in the conditioned space. They bring in fresh, outside air for ventilation; and provide cool outside air to cool your building. This also is the preferred method of low ambient cooling. When integrated with CO₂ sensors, economizers can provide even more savings by coupling the ventilation air to only that amount required based on space occupancy. Economizers are available, installed and tested by the factory, with either enthalpy or temperature dry-bulb inputs. There are also models for electromechanical, direct digital controllers and single speed fan or 2-speed indoor fan motors. Additional sensors are available as accessories to optimize the economizer. Economizers include gravity controlled barometric relief that helps equalize building pressure and ambient air pressures. This can be a cost effective solution to prevent building pressurization. Economizers are available in Ultra Low Leak and standard low leak versions.

CO₂ Sensor

Improves productivity and saves money by working with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO₂ sensor detects their presence through increasing CO₂ levels, and opens the economizer appropriately.

When the occupants leave, the CO₂ levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Control Ventilation (DCV) reduces the overall load on the rooftop, saving money.

Smoke Detectors

Trust the experts. Smoke detectors make your application safer and your job easier. Carrier smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory, for supply air, return air, or both.

Louvered Hail Guards

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

Convenience Outlet (powered or un-powered)

Reduce service and/or installation costs by including a convenience outlet in your specification. Carrier will install this service feature at our factory. Provides a convenient, 15 amp, 115v GFCI receptacle with “Wet in Use” cover. The “powered” option allows the installer to power the outlet from the line side of the disconnect or load side as required by code. The “unpowered” option is to be powered from a separate 115/120v power source.

Non-fused Disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop.

Disconnect Switch Bracket

Provides a pre-engineered and sized mounting bracket for applications requiring a unit mounted fused and non-fused disconnect of greater than 100 amps. Bracket assures that no damage will occur to coils when mounting with screws and other fasteners (16 size only).

Power Exhaust with Barometric Relief

Superior internal building pressure control. This field-installed accessory may eliminate the need for costly, external pressure control fans.

PremierLink

This CCN controller regulates your rooftop’s performance to tighter tolerances and expanded limits, as well as facilitates zoning systems and digital accessories. It also unites your Carrier HVAC equipment together on one, coherent CCN network. The PremierLink can be factory-installed, or easily field-installed. Not available with 2-speed Staged Air Volume (SAV) System.

RTU Open, Multi-protocol Controller

Connect the rooftop to an existing BAS without needing complicated translators or adapter modules using the RTU Open controller. This new controller speaks the 4 most common building automation system languages (Bacnet, Modbus, N2, and Lonworks). Use this controller when you have an existing BAS.

Time Guard II Control Circuit

This accessory protects your compressor by preventing short-cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping. Not required with PremierLink, RTU Open, or authorized commercial thermostats.

Filter or Fan Status Switches

Use these differential pressure switches to detect a filter clog or indoor fan motor failure. When used in conjunction with a compatible unit controller/thermostat, the switches will activate an alarm to warn the appropriate personnel.

Motorized 2-Position Damper

The new Carrier 2-position, motorized outdoor air damper admits up to 100% outside air. Using reliable, gear-driven technology, the 2-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration. Not available with Staged Air Volume (SAV) models.

Manual OA Damper

Manual outdoor air dampers are an economical way to bring in ventilation air. The dampers are available in 25% and 50% versions. Not available with Staged Air Volume (SAV) models.

FACTORY OPTIONS AND/OR ACCESSORIES (cont.)

Optional Humidi-MiZer[®] Adaptive Dehumidification System

Carrier's Humidi-MiZer Adaptive Dehumidification System is an all-inclusive factory installed option that can be ordered with any WeatherMaker 50TC 04-16 rooftop unit equipped with RTPF condenser coils.

NOTE: The last order date for 50TC 04-06 units with Humidi-MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.

This system expands the envelope of operation of Carrier's WeatherMaker rooftop products to provide unprecedented flexibility to meet year-round comfort conditions.

The Humidi-MiZer adaptive dehumidification system has the industry's only dual dehumidification mode setting. The Humidi-MiZer system includes two new modes of operation.

The WeatherMaker 50TC-04-16 rooftop coupled with the Humidi-MiZer system is capable of operating in normal design cooling mode, subcooling mode, and hot gas reheat mode. Normal design cooling mode is when the unit will operate under its normal sequence of operation by cycling compressors to maintain comfort conditions.

Subcooling mode will operate to satisfy part load type conditions when the space requires combined sensible and a higher proportion of latent load control. Hot Gas Reheat mode will operate when outdoor temperatures diminish and the need for latent capacity is required for sole humidity control. Hot Gas Reheat mode will provide neutral air for maximum dehumidification operation.

Staged Air Volume (SAV) Indoor Fan Speed System

Carrier's Staged Air Volume (SAV) system saves energy and installation time by utilizing a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed in sequence with the units cooling operation. Per ASHRAE 90.1 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%). During the heating mode the VFD will allow total design cfm (100%) operation and during the ventilation mode the VFD will allow operation to 2/3rd of total cfm.

Compared to single speed indoor fan motor systems, Carrier's SAV system can save substantial energy, 25%+*, versus single speed indoor fan motor systems.

The VFD used in Carrier's SAV system has soft start capabilities to slowly ramp up the speeds, thus eliminating any high inrush air volume during initial start-up. It also has internal over-current protection for the fan motor and a field installed display kit that allows adjustment and in depth diagnostics of the VFD.

This SAV system is available on models with 2-stage cooling operation with electromechanical or RTU Open, Multi Protocol controls. Both space sensor and conventional thermostats/controls can be used to provide accurate control in any application.

The SAV system is very flexible for initial fan performance set up and adjustment. The standard factory shipped VFD is pre-programmed to automatically stage the fan speed between the first and second stage of cooling. The unit fan performance static pressure and cfm can be easily adjusted using the traditional means of pulley adjustments. The other means to adjust the unit static and cfm performance is to utilize the field installed Display Kit and adjust the frequency and voltage in the VFD to performance requirements. In either case, once set up, the VFD will automatically adjust the speed between the cooling stage operations.

*Data based on .10 (\$/kWh) utilizing Carrier's HAP 4.6 simulation software program

Motormaster Head Pressure Controller

The Motormaster motor controller is a low ambient, head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling when economizer usage is either not appropriate or desired. The Motormaster will either cycle the outdoor fan motors or operate them at reduced speed to maintain the unit operation, depending on the model.

Hinged Access Panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are: filters, control box, fan motor and compressor.

Winter Start Kit

The winter start kit by Carrier extends the low ambient limit of your rooftop to 25°F (-4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

Alternate Motors and Drives

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, your Carrier expert has a factory installed combination to meet your application. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

Thru-the-Base Connections

Thru-the-base connections, available as either an accessory or as a factory option, are necessary to ensure proper connection and seal when routing wire and piping through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for gas lines, main power lines, as well as control power.

FACTORY OPTIONS AND/OR ACCESSORIES (cont.)

Electric Heaters

Carrier offers a full-line of field-installed accessory heaters. The heaters are very easy to use, install and are all pre-engineered and certified.

Supply Duct Cover

This supply duct cover is required when field converting the factory standard vertical duct supply to horizontal duct supply configuration. One required per unit (16 size only).

California OSHPD Seismic Certification Label

Units meet the seismic requirements of the International Code Council Evaluation Service (ICC-ES) document AC156 (Acceptance Criteria for Seismic Qualification by Shake-Table Testing of Nonstructural Components and Systems) and per International Building Code (IBC 2009) at an SDS (g) value of 2.00 z/h=1.0, Ip=1.5 and certified by independent structural engineers. A certification label is applied to the unit that meets the CA OSHPD Special Seismic Certification pre-approval labeling requirements on the external chassis of the unit.

Table 2 – AHRI COOLING RATING TABLES

UNIT	COOLING STAGES	NOM. CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (KW)	SEER	EER	IEER WITH SINGLE SPEED INDOOR MOTOR	IEER WITH 2-SPEED INDOOR MOTOR
A04	1	3	34.0	3.2	13.0	10.60	N/A	N/A
A05	1	4	45.0	4.0	13.0	11.00	N/A	N/A
A06	1	5	59.0	5.5	13.0	10.75	N/A	N/A
A07	1	6	70.0	6.4	N/A	11.00	11.2	N/A
A08	1	7.5	88.0	8.0	N/A	11.00	11.2	N/A
D08	2	7.5	83.0	7.5	N/A	11.00	11.7	12.8
A09	1	8.5	97.0	8.8	N/A	11.00	11.2	N/A
D09	2	8.5	99.0	9.0	N/A	11.00	11.7	12.8
A12	1	10	117.0	10.6	N/A	11.00	11.2	N/A
D12	2	10	114.0	10.3	N/A	11.10	11.8	12.8
D14	2	12.5	140.0	12.9	N/A	10.80	11.0	11.8
D16	2	15	174.0	16.1	N/A	10.80	11.7	12.4

Table 3 – DIRECT DRIVE INDOOR ECM-X13 MOTOR

UNIT	COOLING STAGES	NOM. CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (KW)	SEER	EER
A04	1	3	34.4	3.1	13.4	11.00
A05	1	4	45.0	3.9	13.4	11.40
A06	1	5	59.0	5.5	13.2	10.75

LEGEND AND NOTES for TABLES 2 and 3

- AHRI – Air Conditioning, Heating and Refrigeration Institute Test Standard
- ASHRAE – American Society of Heating, Refrigerating and Air Conditioning, Inc.
- EER – Energy Efficiency Ratio
- IEER – Integrated Energy Efficiency Ratio
- N/A – Not Applicable
- SEER – Seasonal Energy Efficiency Ratio

NOTES:

1. Rated in accordance with AHRI Standard 210/240 or 340/360, as appropriate.
2. Ratings are based on:
Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.
IEER Standard: A measure that expresses cooling part-load EER efficiency for commercial unitary air conditioning and heat pump equipment on the basis of weighted operation at various load capacities.
3. All 50TC units comply with ASHRAE 90.1 Energy Standard for minimum SEER and EER requirements.
4. 50TC units comply with US Energy Policy Act (2005). To evaluate code compliance requirements, refer to state and local codes.



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program For verification of certification for individual products, go to www.ahridirectory.org.

Table 4 – MINIMUM - MAXIMUM AIRFLOWS COOLING AND ELECTRIC HEAT

UNIT	COOLING		ELECTRIC HEATERS	
	Minimum	Maximum	Minimum	Maximum
50TC-*04	900	1500	900	1500
50TC-*05	1200	2000	1200	2000
50TC-*06	1500	2500	1500	2500
50TC-*07	1800	3000	1800	3000
50TC-*08	2250	3750	2250 [†]	3750
50TC-*09	2550	4250	2550 [†]	4250
50TC-*12	3000	5000	3000 [†]	5000
50TC-*14	3600	6000	3000 [†]	6000
50TC-*16	4500	7500	4500	7500

[†] Minimum electric heat CFM exceptions :

UNIT	UNIT VOLTAGE	HEATER KW	UNIT CONFIGURATION	REQUIRED MINIMUM CFM
50TC-*12 50TC-*14	208/230	42.4	Horizontal	3200
50TC-*12 50TC-*14	208/230	50.0	Horizontal	3200
50TC-*12 50TC-*14	460	50.0	Horizontal or Vertical	3200
50TC-*08	575	17.0	Horizontal or Vertical	2800
50TC-*09 50TC-*12 50TC-*14	575	34.0	Horizontal or Vertical	2350

Table 5 – SOUND PERFORMANCE TABLE

UNIT	COOLING STAGES	OUTDOOR SOUND (dB) @60Hz								
		A – WEIGHTED	63	125	250	500	1000	2000	4000	8000
A04	1	80	90.6	80.9	80.2	76	74.6	71.3	68.5	63.9
A05	1	81	90.9	84.6	79.5	77.9	76.5	71.1	66.9	62.5
A06	1	78	84.0	82.2	76.3	74.8	72.5	68.8	65.6	61.8
A07	1	78	88.8	81.8	76.9	74.4	73.3	69.8	66.3	62.7
A08	1	82	90.1	82.6	81.0	79.4	77.0	73.0	70.4	66.7
D08	2	82	85.8	84.3	80.5	78.7	76.4	72.7	68.3	65.1
A09	1	83	91.2	86.4	81.9	81.0	78.3	73.9	71.4	67.3
D09	2	82	88.6	85.0	81.6	79.5	77.4	74.1	71.0	66.3
A12	1	82	88.6	85.0	81.6	79.5	77.4	74.1	71.0	66.3
D12	2	82	89.0	83.1	80.5	78.5	75.5	71.6	69.6	69.3
D14	2	87	87.0	85.2	84.6	84.9	82.2	78.4	75.3	72.9
D16	2	87	87.0	85.2	84.6	84.9	82.2	78.4	75.3	72.9

LEGEND

dB – Decibel



NOTES:

1. Outdoor sound data is measure in accordance with AHRI standard 270–2008.
2. Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure accounts for specific environmental factors which do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
3. A–weighted sound ratings filter out very high and very low frequencies, to better approximate the response of an “average” human ear. A–weighted measurements for Carrier units are taken in accordance with 270–2008.

Table 6 – PHYSICAL DATA

(COOLING)

3 - 4 TONS

		50TC–A04 Produced On or Prior to 7/26/2015	50TC–A04 Produced On or After 7/27/2015	50TC–A05 Produced On or Prior to 7/26/0215	50TC–A05 Produced On or After 7/27/2015
Refrigeration System					
	# Circuits / # Comp. / Type	1 / 1 / Scroll	1 / 1 / Scroll	1 / 1 / Scroll	1 / 1 / Scroll
	Puron® refrig. (R–410A) (lbs–oz)	5–10	4–4	7–5	7–5
	Humidi–MiZer® Puron refrig. charge A/B (lbs – oz)	8–11	–	–	–
	Metering Device	Acutrol	Acutrol	Acutrol	Acutrol
	Humidi–MiZer Metering Device	Acutrol + TXV	Acutrol + TXV	Acutrol + TXV	Acutrol + TXV
	High–press. Trip / Reset (psig)	630 / 505	630 / 505	630 / 505	630 / 505
	Low–press. Trip / Reset (psig)	54 / 117	54 / 117	54 / 117	54 / 117
	Compressor Capacity Staging (%)	100%	100%	100%	100%
Evap. Coil					
	Material (Tube/Fin)	Cu / Al	Cu / Al	Cu / Al	Cu / Al
	Coil type	3/8–in RTPF	3/8–in RTPF	3/8–in RTPF	3/8–in RTPF
	Rows / FPI	2 / 15	2 / 15	2 / 15	2 / 15
	Total Face Area (ft ²)	5.5	5.5	5.5	5.5
	Condensate Drain Conn. Size	3/4–in	3/4–in	3/4–in	3/4–in
Humidi–MiZer Coil			†		†
	Material (Tube/Fin)	Cu / Al	Cu / Al	Cu / Al	Cu / Al
	Coil type	3/8–in RTPF	3/8–in RTPF	3/8–in RTPF	3/8–in RTPF
	Rows..Fins/in.	1 / 17	1 / 17	2 / 17	2 / 17
	Total Face Area (ft ²)	3.9	3.9	3.9	3.9
Evap. Fan and Motor					
Standard Direct Drive 3 phase	Motor Qty / Drive Type	–	1 / Direct	–	1 / Direct
	Max BHP	–	0.75	–	0.75
	RPM Range	–	600–1200	–	600–1200
	Motor Frame Size	–	48	–	48
	Fan Qty / Type	–	1 / Centrifugal	–	1 / Centrifugal
	Fan Diameter (in)	–	10 x 11	–	10 x 11
Standard Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.7	1.7	1.7	1.7
	RPM Range	560–854	560–854	560–854	560–854
	Motor Frame Size	48	48	48	48
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10	10 x 10
Medium Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.7	1.7	1.7	1.7
	RPM Range	770–1175	770–1175	770–1175	770–1175
	Motor Frame Size	48	48	48	48
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10	10 x 10
High Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.4	2.4	2.4	2.4
	RPM Range	1035–1466	1035–1466	1035–1466	1035–1466
	Motor Frame Size	56	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10	10 x 10
Cond. Coil					
	Material (Tube/Fin)	Cu / Al	Cu / Al	Cu / Al	Cu / Al
	Coil type	3/8–in RTPF	5/16–in RTPF	3/8–in RTPF	5/16–in RTPF
	Rows / FPI	1 / 17	1 / 17	2 / 17	2 / 17
	Total Face Area (ft ²)	14.6	12.6	16.5	15.6
Cond. fan / motor					
	Qty / Motor Drive Type	1/ Direct	1/ Direct	1/ Direct	1/ Direct
	Motor HP / RPM	1/4 / 1100	1/4 / 1100	1/4 / 1100	1/4 / 1100
	Fan diameter (in)	22	22	22	22
Filters					
	RA Filter # / Size (in)	2 / 16 x 25 x 2	2 / 16 x 25 x 2	2 / 16 x 25 x 2	2 / 16 x 25 x 2
	OA inlet screen # / Size (in)	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1

NOTE: Humidi–MiZer is not available with Novation condenser coil models, only Round Tube / Plate Fin (RTPF).

– Not applicable

† 575V motor utilizes 3.7 BHP.

‡ The last order date for 50TC 04–06 units with Humidi–MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.

Table 7 – PHYSICAL DATA

(COOLING)

5 - 6 TONS

		50TC–A06 Produced On or Prior to 7/26/2015	50TC–A06 Produced On or After 7/27/2015	50TC–A07
Refrigeration System				
# Circuits / # Comp. / Type		1 / 1 / Scroll	1 / 1 / Scroll	1 / 1 / Scroll
Puron® refrig. (R-410A) (lbs-oz)		10-11	9-0	14-2
Humidi-MiZer® Puron refrig. charge A/B (lbs - oz)		16-0	-	22-5
Metering Device		Acutrol	Acutrol	Acutrol
Humidi-MiZer Metering Device		Acutrol + TXV	Acutrol + TXV	Acutrol + TXV
High-press. Trip / Reset (psig)		630 / 505	630 / 505	630 / 505
Low-press. Trip / Reset (psig)		54 / 117	54 / 117	54 / 117
Compressor Capacity Staging (%)		100%	100%	100%
Evap. Coil				
Material (Tube/Fin)		Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		4 / 15	4 / 15	4 / 15
Total Face Area (ft ²)		5.5	5.5	7.3
Condensate Drain Conn. Size		3/4-in	3/4-in	3/4-in
Humidi-MiZer Coil				
Material (Tube/Fin)		Cu / Al	‡	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows..Fins/in.		2 / 17	2 / 17	2 / 17
Total Face Area (ft ²)		3.9	3.9	5.2
Evap. Fan and Motor				
Standard Direct Drive 3 phase	Motor Qty / Drive Type	-	1 / Direct	-
	Max BHP	-	1	-
	RPM Range	-	600-1200	-
	Motor Frame Size	-	48	-
	Fan Qty / Type	-	1 / Centrifugal	-
	Fan Diameter (in)	-	10 x 11	-
Standard Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.7	1.7	2.4
	RPM Range	770-1175	770-1175	1073-1457
	Motor Frame Size	48	48	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10
Medium Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.4	2.4	2.9†
	RPM Range	1035-1466	1035-1466	1173-1518
	Motor Frame Size	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10
High Statoc 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.9	2.9	3.7
	RPM Range	1303-1687	1303-1687	1474-1788
	Motor Frame Size	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10
Cond. Coil				
Material (Tube/Fin)		Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	5/16-in RTPF	3/8-in RTPF
Rows / FPI		2 / 17	2 / 17	2 / 17
Total Face Area (ft ²)		16.5	15.6	21.3
Cond. fan / motor				
Qty / Motor Drive Type		1/ Direct	1/ Direct	1/ Direct
Motor HP / RPM		1/4 / 1100	1/4 / 1100	1/4 / 1100
Fan diameter (in)		22	22	22
Filters				
RA Filter # / Size (in)		2 / 16 x 25 x 2	2 / 16 x 25 x 2	4 / 16 x 16 x 2
OA inlet screen # / Size (in)		1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1

NOTE: Humidi-MiZer is not available with Novation condenser coil models, only Round Tube / Plate Fin (RTPF).

- Not applicable

† 575V motor utilizes 3.7 BHP.

‡ The last order date for 50TC 04-06 units with Humidi-MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.

Table 8 – PHYSICAL DATA

(COOLING)

7.5 - 8.5 TONS

		50TC-A08	50TC-D08	50TC-A09	50TC-D09
Refrigeration System					
# Circuits / # Comp. / Type		1 / 1 / Scroll	2 / 2 / Scroll	1 / 1 / Scroll	2 / 2 / Scroll
RTPF models R-410a charge A/B (lbs - oz)		13 - 12	8 - 5 / 8 - 2	15 - 4	10 - 5 / 10 - 12
Alternate (MCHX) R-410a charge A/B (lbs - oz)			4 - 6 / 4 - 6		
Alternate (Humidi-MiZer®) R-410a charge A/B (lbs - oz)			13 - 3 / 13 - 3		16 - 13 / 16 - 13
Metering device		Acutrol	Acutrol	Acutrol	Acutrol
Alternate (Humidi-MiZer) Metering device		-	Acutrol + TXV	-	Acutrol + TXV
High-press. Trip / Reset (psig)		630 / 505	630 / 505	630 / 505	630 / 505
Low-press. Trip / Reset (psig)		54 / 117	54 / 117	54 / 117	54 / 117
Compressor Capacity Staging (%)		100%	50% / 100%	100%	50% / 100%
Evap. Coil					
Material		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		3 / 15	3 / 15	3 / 15	3 / 15
Total face area (ft ²)		8.9	8.9	11.1	11.1
Condensate drain conn. size		3/4-in	3/4-in	3/4-in	3/4-in
Humidi-MiZer Coil					
Material		-	Cu / Al	-	Cu / Al
Coil type		-	3/8-in RTPF	-	3/8-in RTPF
Rows / FPI		-	2 / 17	-	2 / 17
Total face area (ft ²)		-	6.3	-	8.4
Evap. fan and motor					
Standard Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.7	1.7	1.7	1.7
	RPM range	489-747	489-747	518-733	518-733
	Motor frame size	56	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	15 x 15
Medium Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.9†	2.9†	2.4	2.4
	RPM range	733-949	733-949	690-936	690-936
	Motor frame size	56	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	15 x 15
High Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	4.7	4.7	3.7	3.7
	RPM range	909-1102	909-1102	838-1084	838-1084
	Motor frame size	14	14	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	15 x 15
Cond. Coil					
Material		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		2 / 17	2 / 17	2 / 17	2 / 17
Total face area (ft ²)		20.5	20.5	21.4	25.1
Alternate (MCHX) Cond. Coil					
Material		-	Al / Al	-	-
Coil type		-	Novation™	-	-
Rows / FPI		-	1 / 20	-	-
Total face area (ft ²)		-	20.5	-	-
Cond. fan / motor					
Qty / Motor drive type		2 / direct	2 / direct	2 / direct	2 / direct
Motor HP / RPM		1/4 / 1100	1/4 / 1100	1/4 / 1100	1/4 / 1100
Fan diameter (in)		22	22	22	22
Filters					
RA Filter # / Size (in)		4 / 16 x 20 x 2	4 / 16 x 20 x 2	4 / 20 x 20 x 2	4 / 20 x 20 x 2
OA inlet screen # / Size (in)		1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1

NOTE: Humidi-MiZer is not available with Novation condenser coil models, only Round Tube/Plate Fin (RTPF).

- Not applicable

† 575V motor utilizes 3.7 BHP

Table 9 – PHYSICAL DATA

(COOLING)

10 - 15 TONS

		50TC-A12	50TC-D/E12	50TC-D/E14	50TC-D/E16
Refrigeration System					
# Circuits / # Comp. / Type		1 / 1 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll
RTPF models R-410a charge A/B (lbs - oz)		20 - 0	10 - 5 / 10 - 3	11 - 0 / 11 - 6	15-14/16-12
Alternate (MCHX) R-410a charge A/B (lbs - oz)		-	6 - 0 / 6 - 0	7 - 6 / 8 - 0	-
Alternate (Humidi-MiZer®) R-410a charge A/B (lbs - oz)		-	16 - 10 / 16 - 0	17 - 10 / 18 - 3	-
Metering device		Acutrol	Acutrol	Acutrol	Acutrol
Alternate (Humidi-MiZer) Metering device		-	Acutrol + TXV	Acutrol + TXV	-
High-press. Trip / Reset (psig)		630 / 505	630 / 505	630 / 505	630 / 505
Low-press. Trip / Reset (psig)		54 / 117	54 / 117	54 / 117	54 / 117
Compressor Capacity Staging (%)		100%	50% / 100%	50% / 100%	50% / 100%
Evap. Coil					
Material		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		4 / 15	4 / 15	4 / 15	3 / 15
Total face area (ft ²)		11.1	11.1	11.1	17.5
Condensate drain conn. size		3/4-in	3/4-in	3/4-in	3/4-in
Humidi-MiZer Coil					
Material		-	Cu / Al	Cu / Al	Cu / Al
Coil type		-	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		-	2 / 17	2 / 17	1 / 17
Total face area (ft ²)		-	8.4	8.4	13.8
Evap. fan and motor					
Standard Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.4	2.4	2.9 [†]	2.9 [†]
	RPM range	591-838	591-838	652-843	507-676
	Motor frame size	56	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	18 x 18
Medium Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	3.7	3.7	3.7	3.7
	RPM range	838-1084	838-1084	838-1084	627-851
	Motor frame size	56	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	18 x 18
High Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	4.7	4.7	4.7	6.5 / 6.9 / 7.0 / 8.3 [‡]
	RPM range	1022-1240	1022-1240	1022-1240	776-955
	Motor frame size	14	14	14	S184T
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	18 x 18
Cond. Coil					
Material		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		2 / 17	2 / 17	3 / 17	2 / 17
Total face area (ft ²)		25.1	25.1	25.1	2 @ 23.1
Alternate (MCHX) Cond. Coil					
Material		-	Al / Al	Al / Al	-
Coil type		-	Novation™	Novation™	-
Rows / FPI		-	1 / 20	2 / 20	-
Total face area (ft ²)		-	25.1	25.1	-
Cond. fan / motor					
Qty / Motor drive type		2 / direct	2 / direct	1 / direct	3 / direct
Motor HP / RPM		1/4 / 1100	1/4 / 1100	1 / 1175	1/4 / 1100
Fan diameter (in)		22	22	30	22
Filters					
RA Filter # / Size (in)		4 / 20 x 20 x 2	4 / 20 x 20 x 2	4 / 20 x 20 x 2	6 / 18 x 24 x 2 2 / 24 x 27 x 1 (vert.)
OA inlet screen # / Size (in)		1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 30 x 39 x 1 (horiz)

NOTE: Humidi-MiZer is not available with Novation condenser coil models, only Round Tube/Plate Fin (RTPF) up to 16 size.


- Not applicable

[†] 575V motor utilizes 3.7 BHP

[‡] On Size 16 units, Max BHP for the High Static motor varies with the motor's voltage; see the table below.

Voltage	BHP
208	6.5
230	6.9
460	7.0
575	8.3

CURBS, WEIGHTS & DIMENSIONS

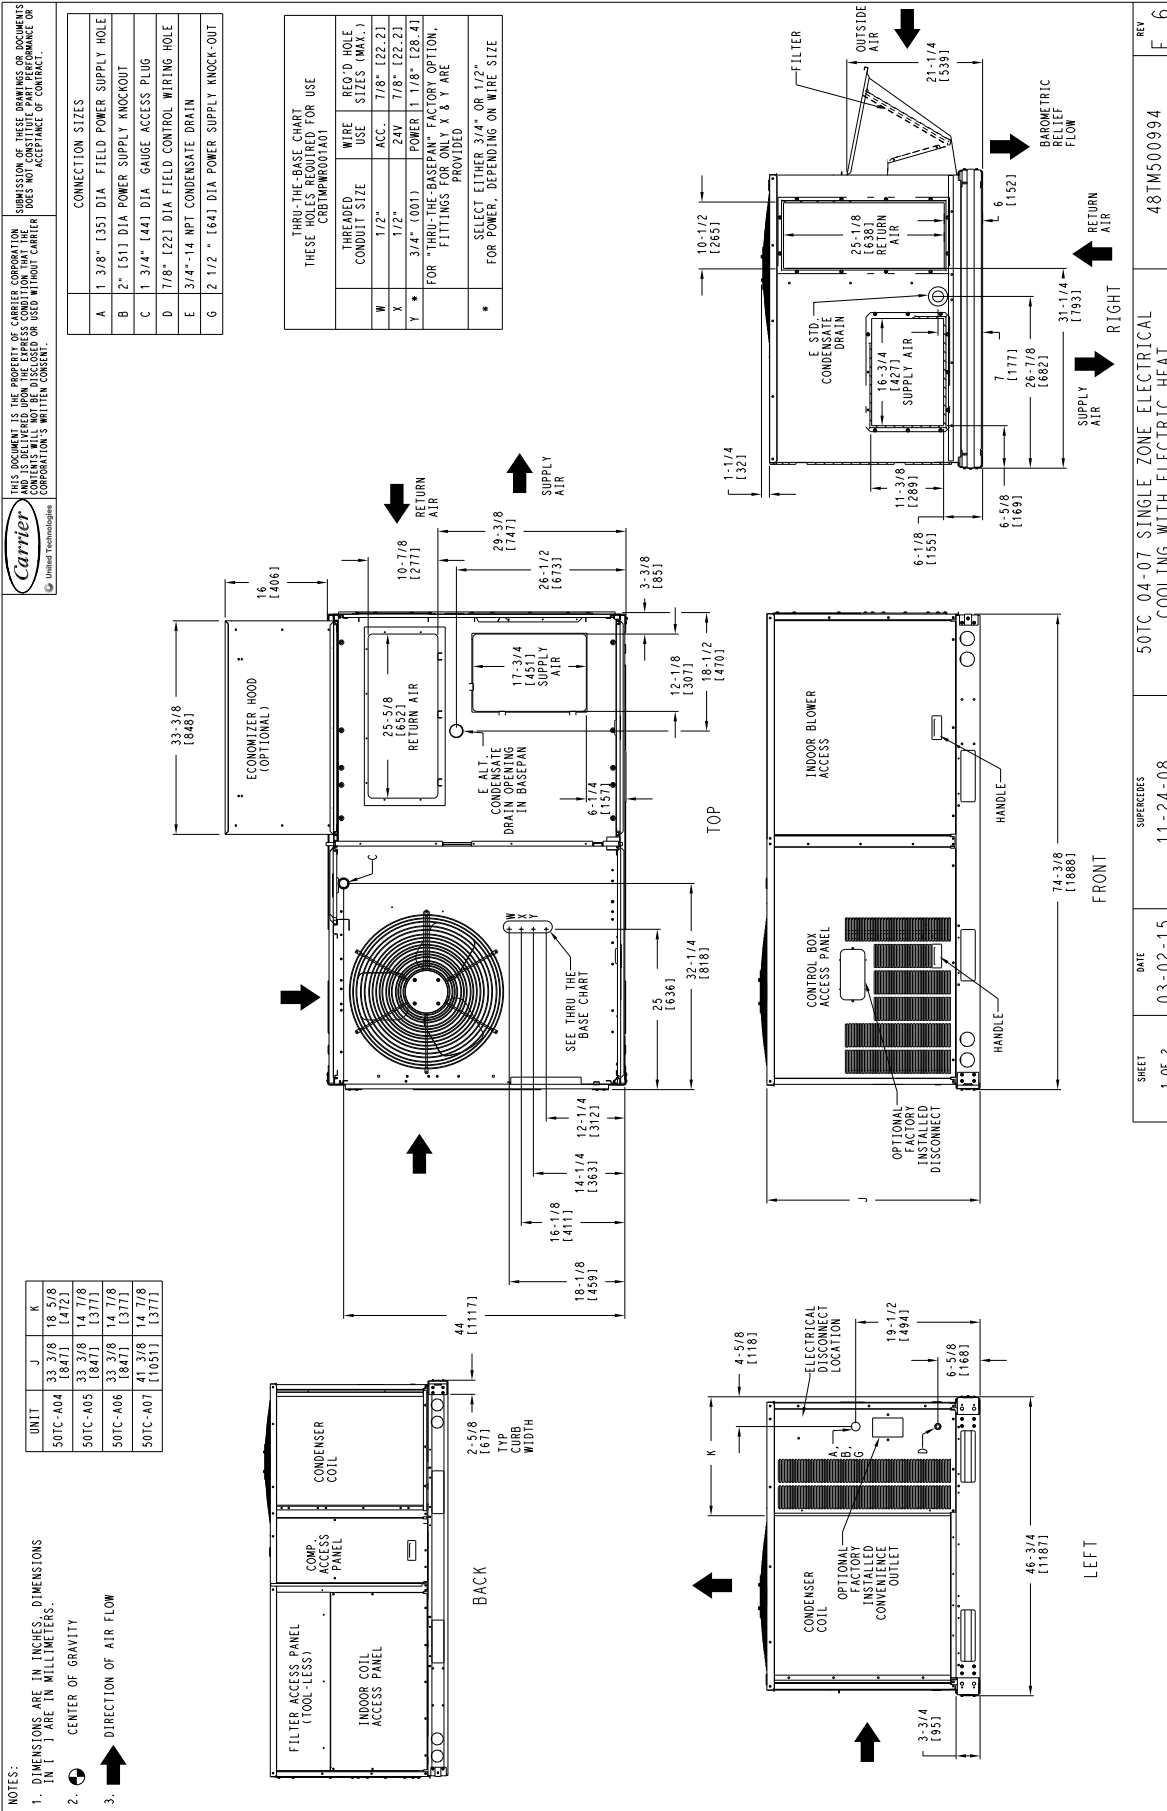

NOTES:

- DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
- CENTER OF GRAVITY
- DIRECTION OF AIR FLOW

The drawing shows four views of the 50TC 04-07 unit:

- TOP View:** Shows the condenser coil (25-5/8 [652] RETURN AIR), indoor coil (17-3/4 [451] SUPPLY AIR), and condensing drain opening. Dimensions include 33-3/8 [848] for the hood, 16 [406] for the hood height, and 32-1/4 [818] for the main body width.
- FRONT View:** Shows the control box access panel, indoor blower access, and handles. Dimensions include 74-3/8 [1886] for the total height and 31-1/4 [793] for the main body height.
- BACK View:** Shows the filter access panel (tool-less), indoor coil access panel, and condenser coil. Dimensions include 44 [1117] for the top section height and 2-5/8 [67] for the curb width.
- LEFT View:** Shows the condenser coil, optional factory installed convenient outlet, and electrical disconnect location. Dimensions include 46-3/4 [1187] for the total height and 4-5/8 [116] for the top section height.

50TC 04-07 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT

SUPERSEDES 11-24-08

SHEET 1 OF 2

DATE 03-02-15

48TM500994

REV F.6

Fig. 1 - Dimensions 50TC 04-07 (Sheet 1 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

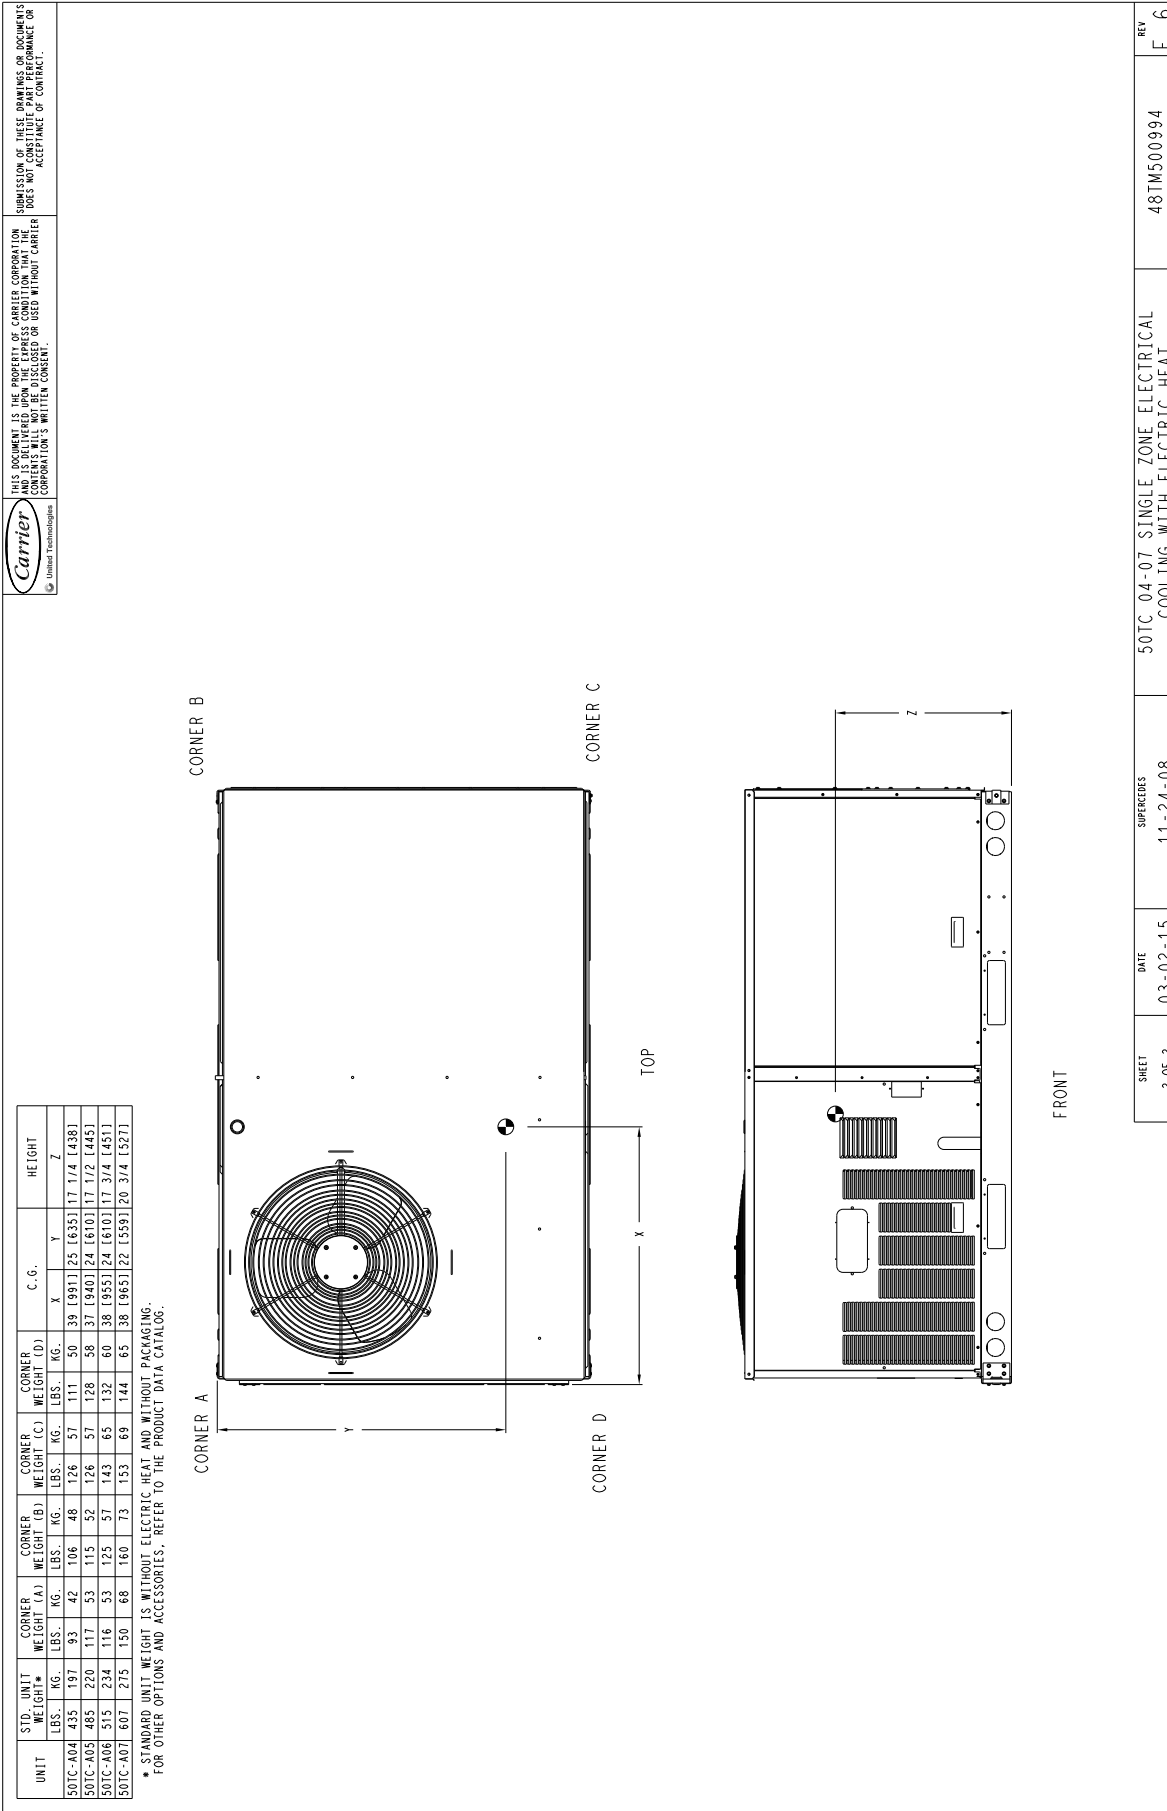


Fig. 2 - Dimensions 50TC 04-07 (Sheet 2 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

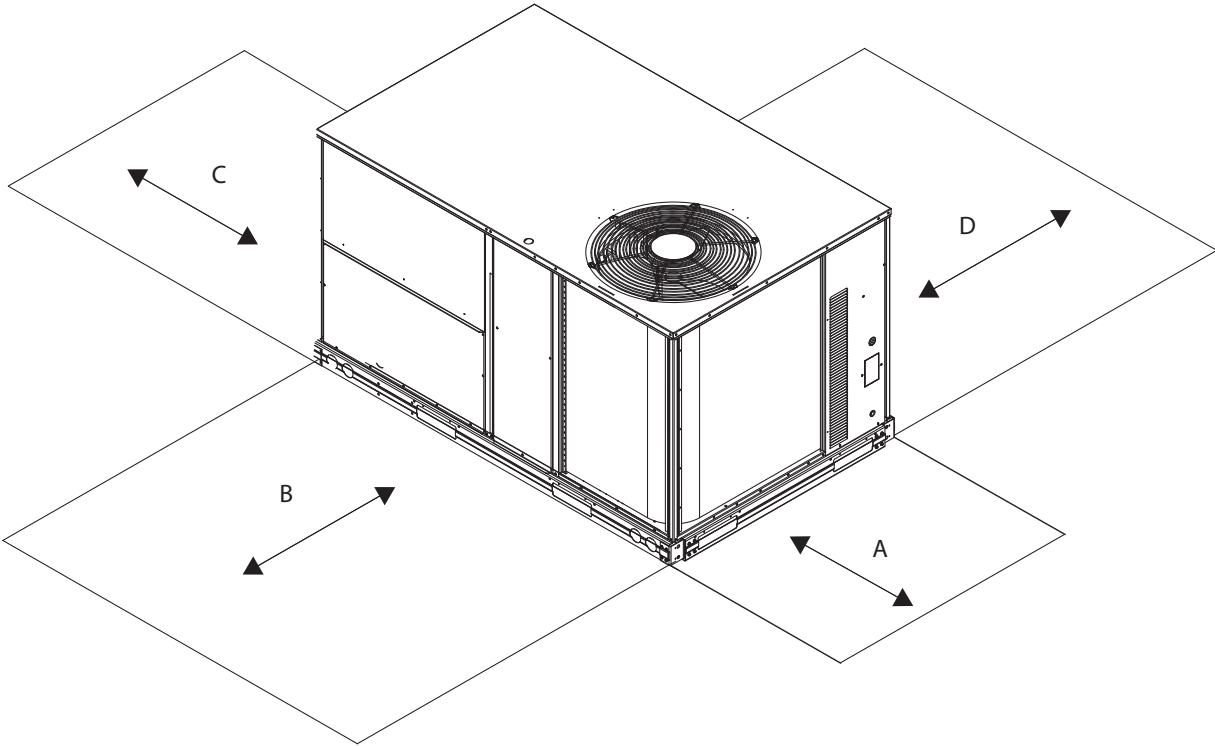


Fig. 3 - Service Clearance

C08337

LOC	DIMENSION	CONDITION
A	48-in (1219 mm)	Unit disconnect is mounted on panel
	18-in (457 mm)	No disconnect, convenience outlet option
	18-in (457 mm)	Recommended service clearance
	12-in (305 mm)	Minimum clearance
B	42-in (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall)
	36-in (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36-in (914 mm)	Side condensate drain is used
	18-in (457 mm)	Minimum clearance
D	42-in (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36-in (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

NOTE: Unit not designed to have overhead obstruction. Contact Application Engineering for guidance on any application planning overhead obstruction or vertical clearances.

CURBS, WEIGHTS & DIMENSIONS (cont.)

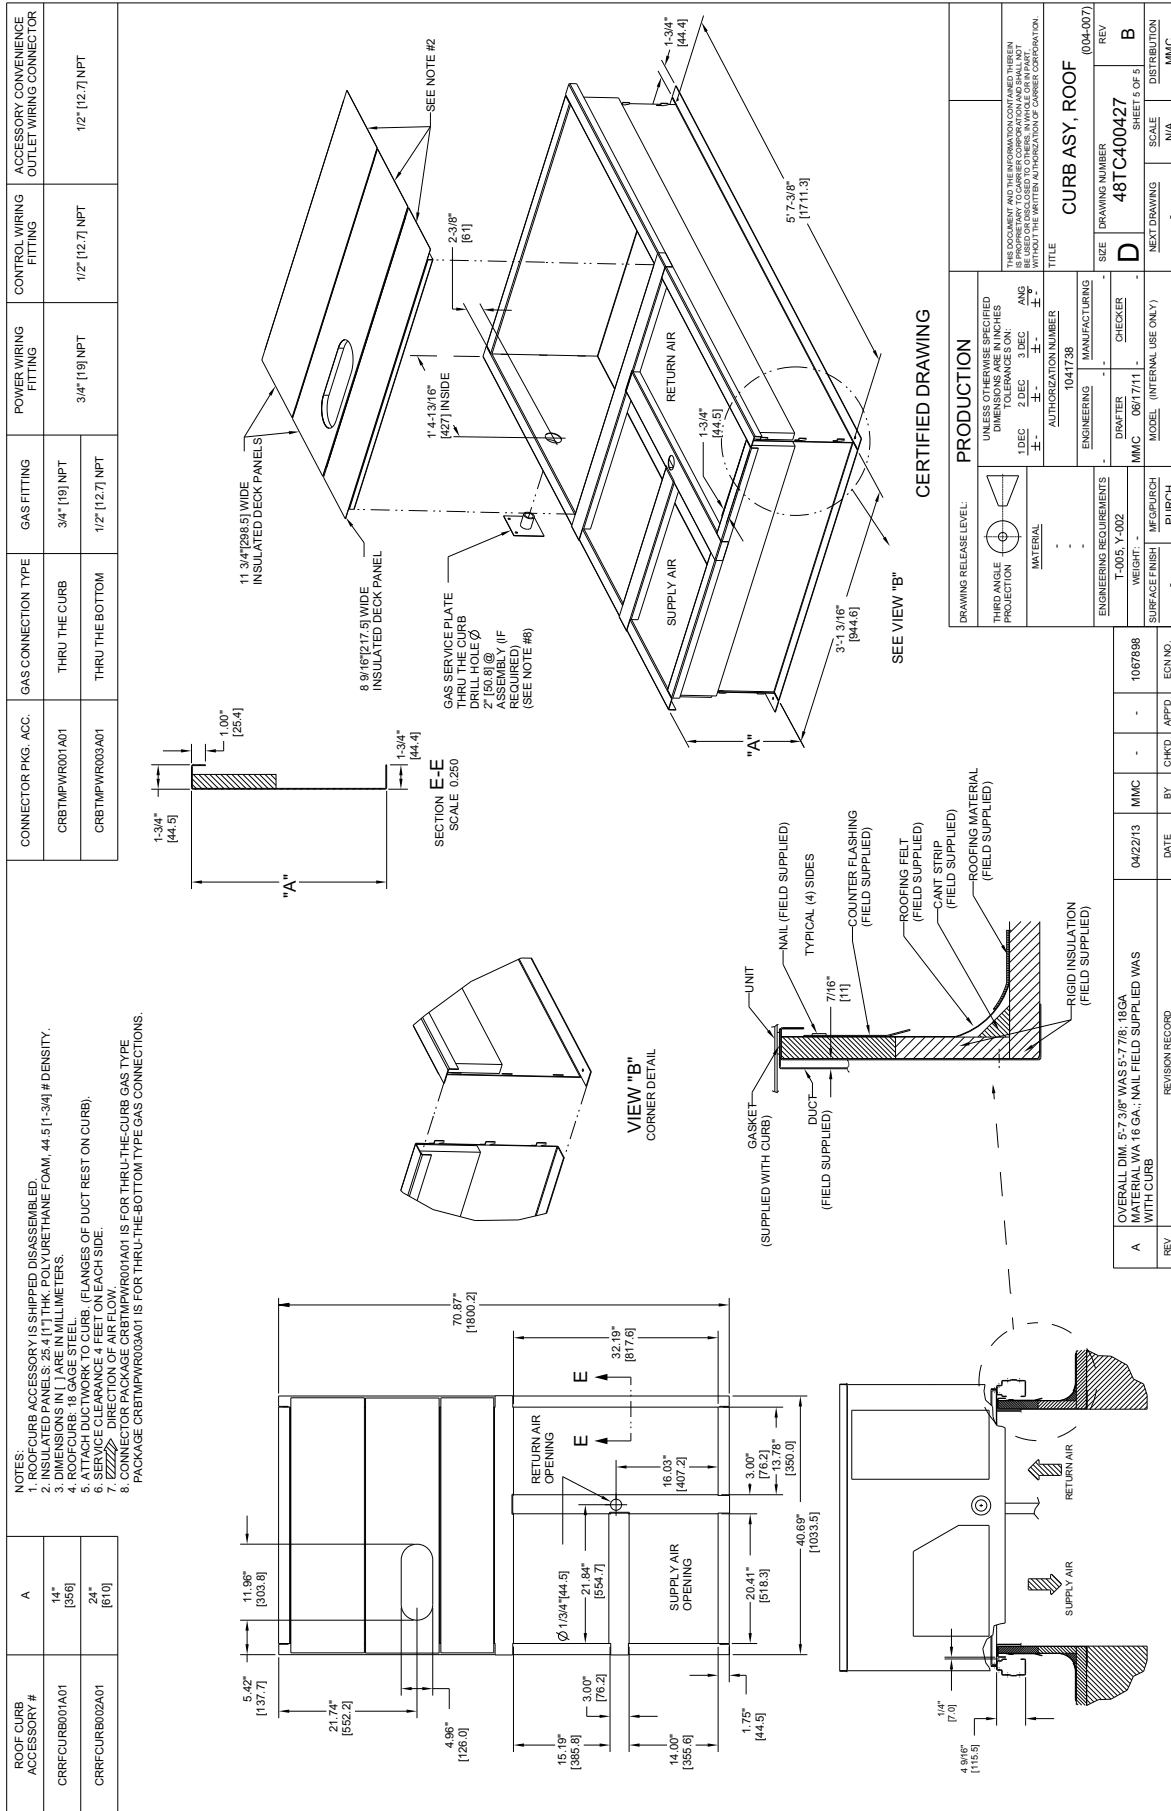


Fig. 4 - Roof Curb Details 50TC 04-07

CURBS, WEIGHTS & DIMENSIONS (cont.)

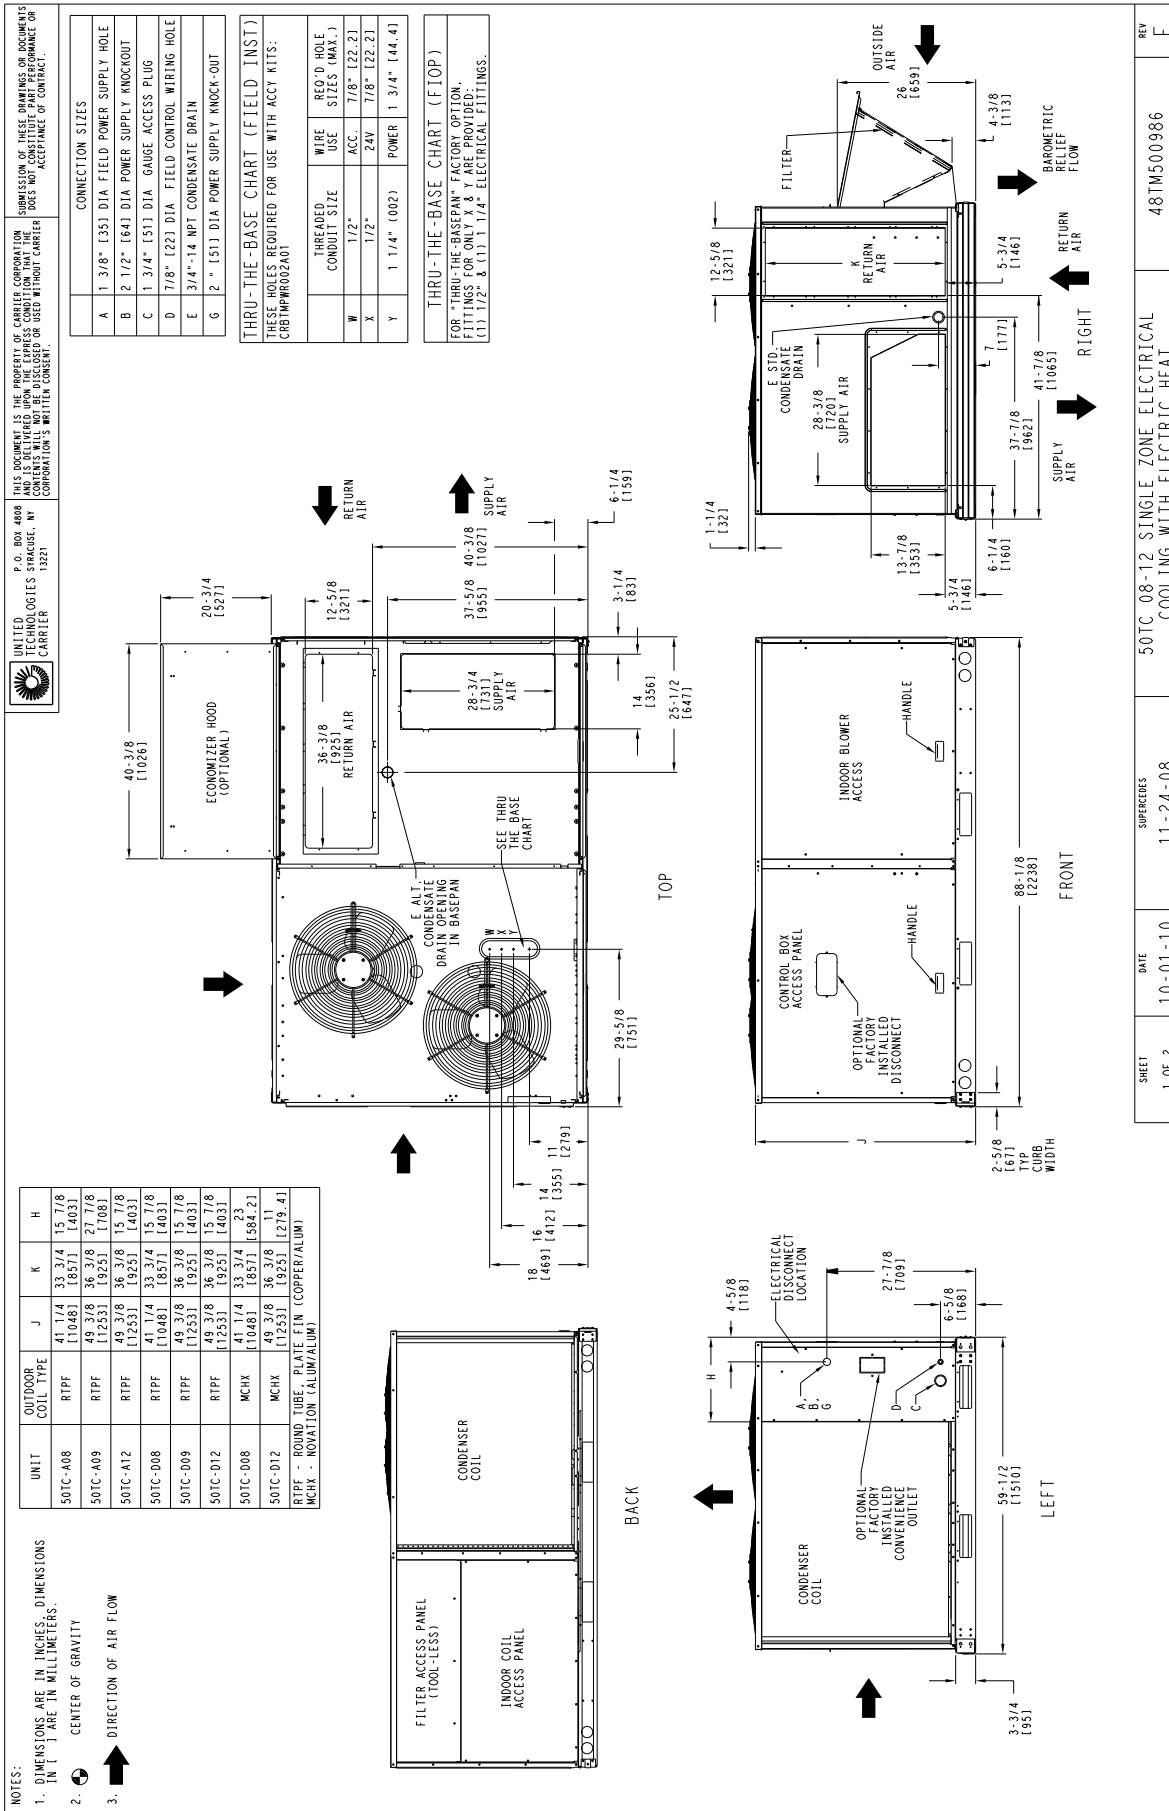


Fig. 5 - Dimensions 50TC 08-12 (Sheet 1 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

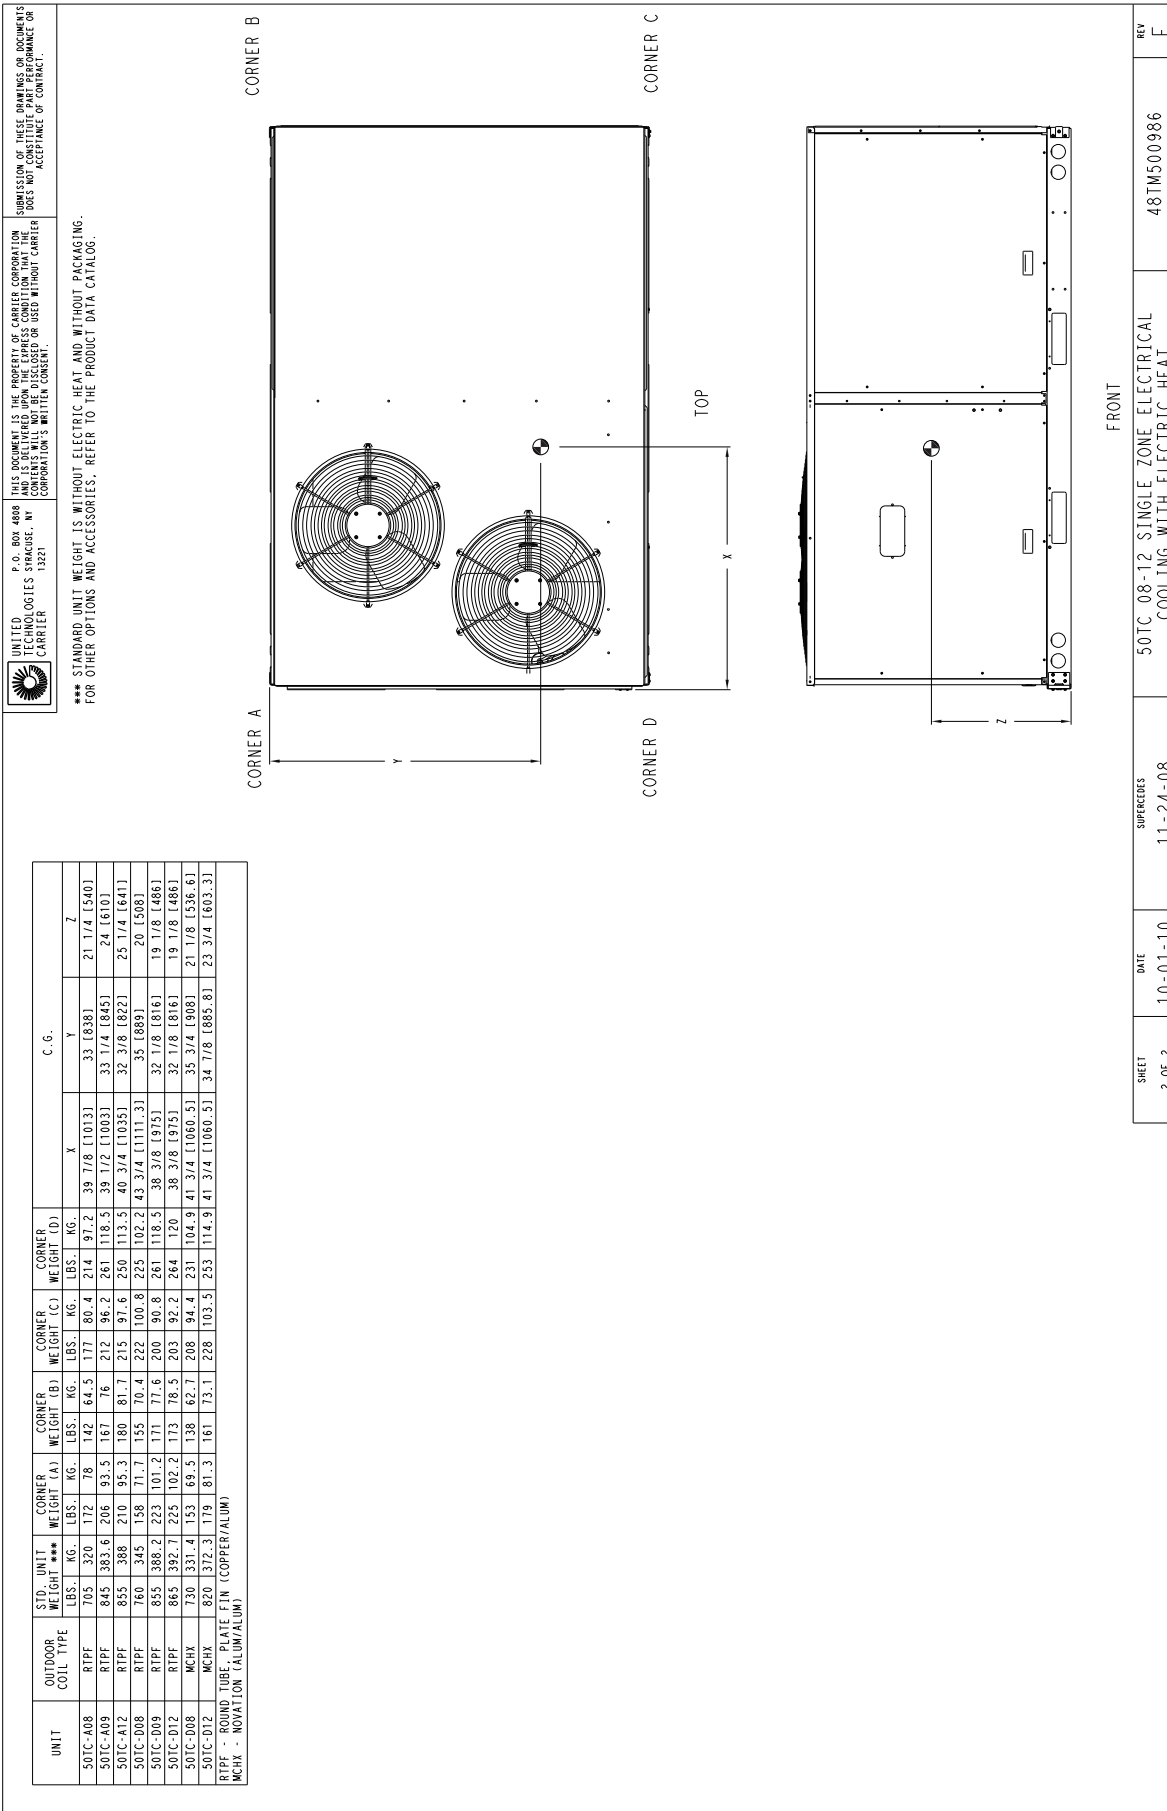


Fig. 6 - Dimensions 50TC 08-12 (Sheet 2 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

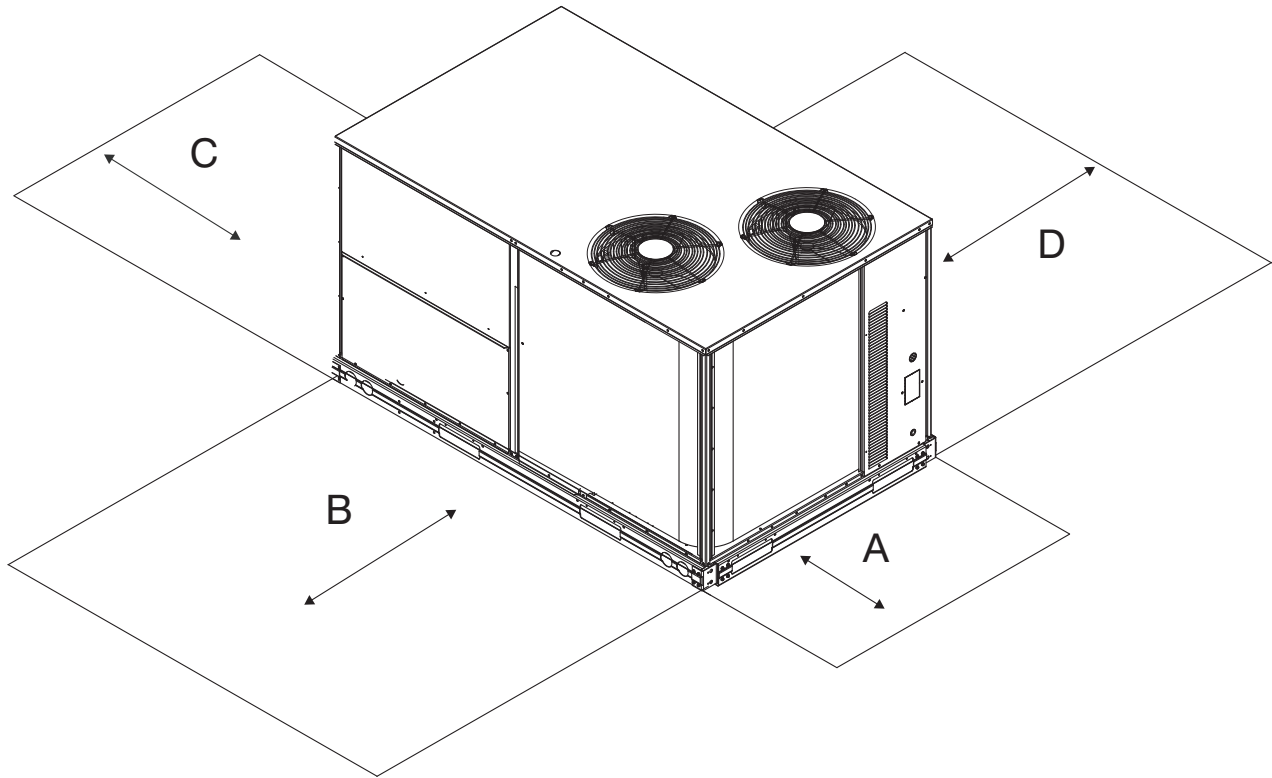


Fig. 7 - Service Clearance

C11247

LOC	DIMENSION	CONDITION
A	48-in (1219 mm)	Unit disconnect is mounted on panel
	36-in (914 mm)	If dimension-B is 12-in (305 mm)
	18-in (457 mm)	No disconnect, convenience outlet option
	18-in (457 mm)	Recommended service clearance (use electric screwdriver)
B	12-in (305 mm)	Minimum clearance (use manual ratchet screwdriver)
	36-in (914 mm)	Unit has economizer
	12-in (305 mm)	If dimension-A is 36-in (914 mm)
C	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
	36-in (914 mm)	Side condensate drain is used
D	18-in (457 mm)	Minimum clearance
	42-in (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36-in (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

NOTE: Unit not designed to have overhead obstruction. Contact Application Engineering for guidance on any application planning overhead obstruction or vertical clearances.

CURBS, WEIGHTS & DIMENSIONS (cont.)


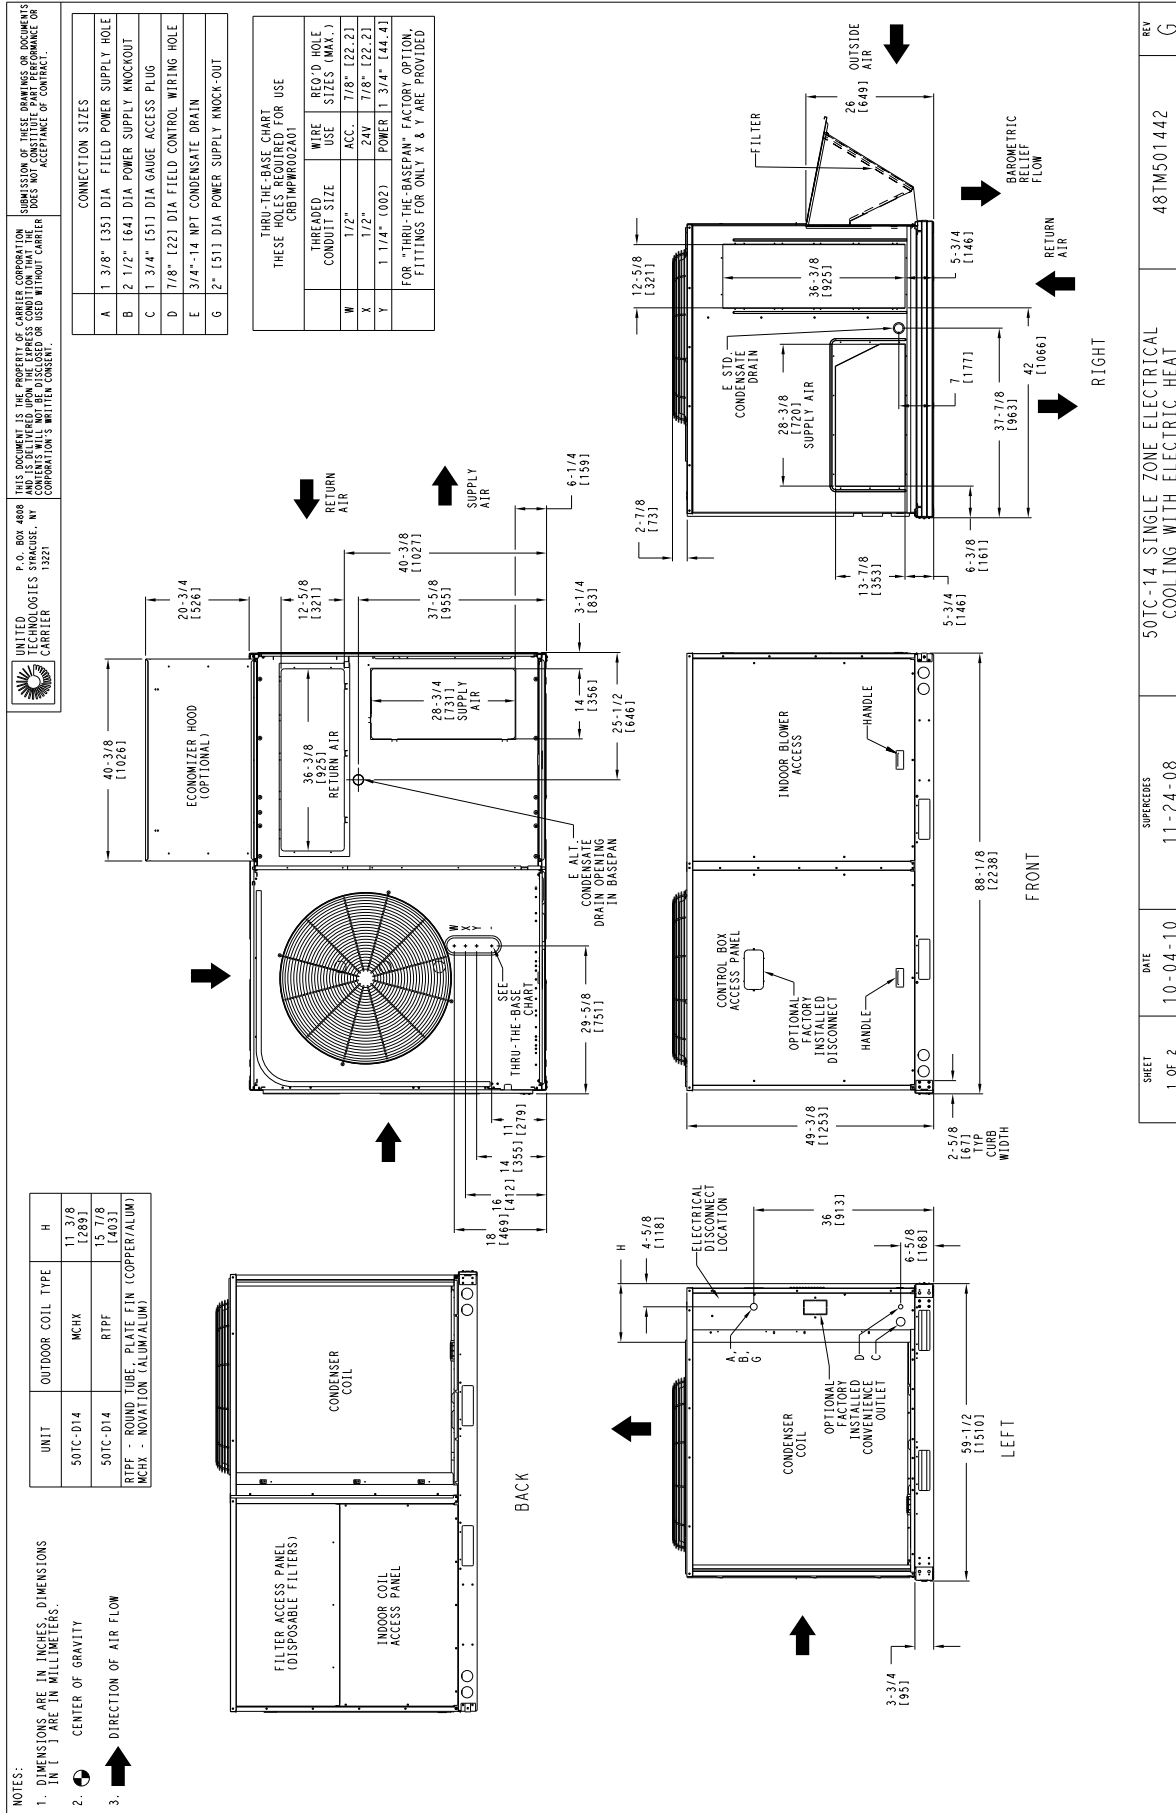


Fig. 8 - Dimensions 50TC 14 (Sheet 1 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

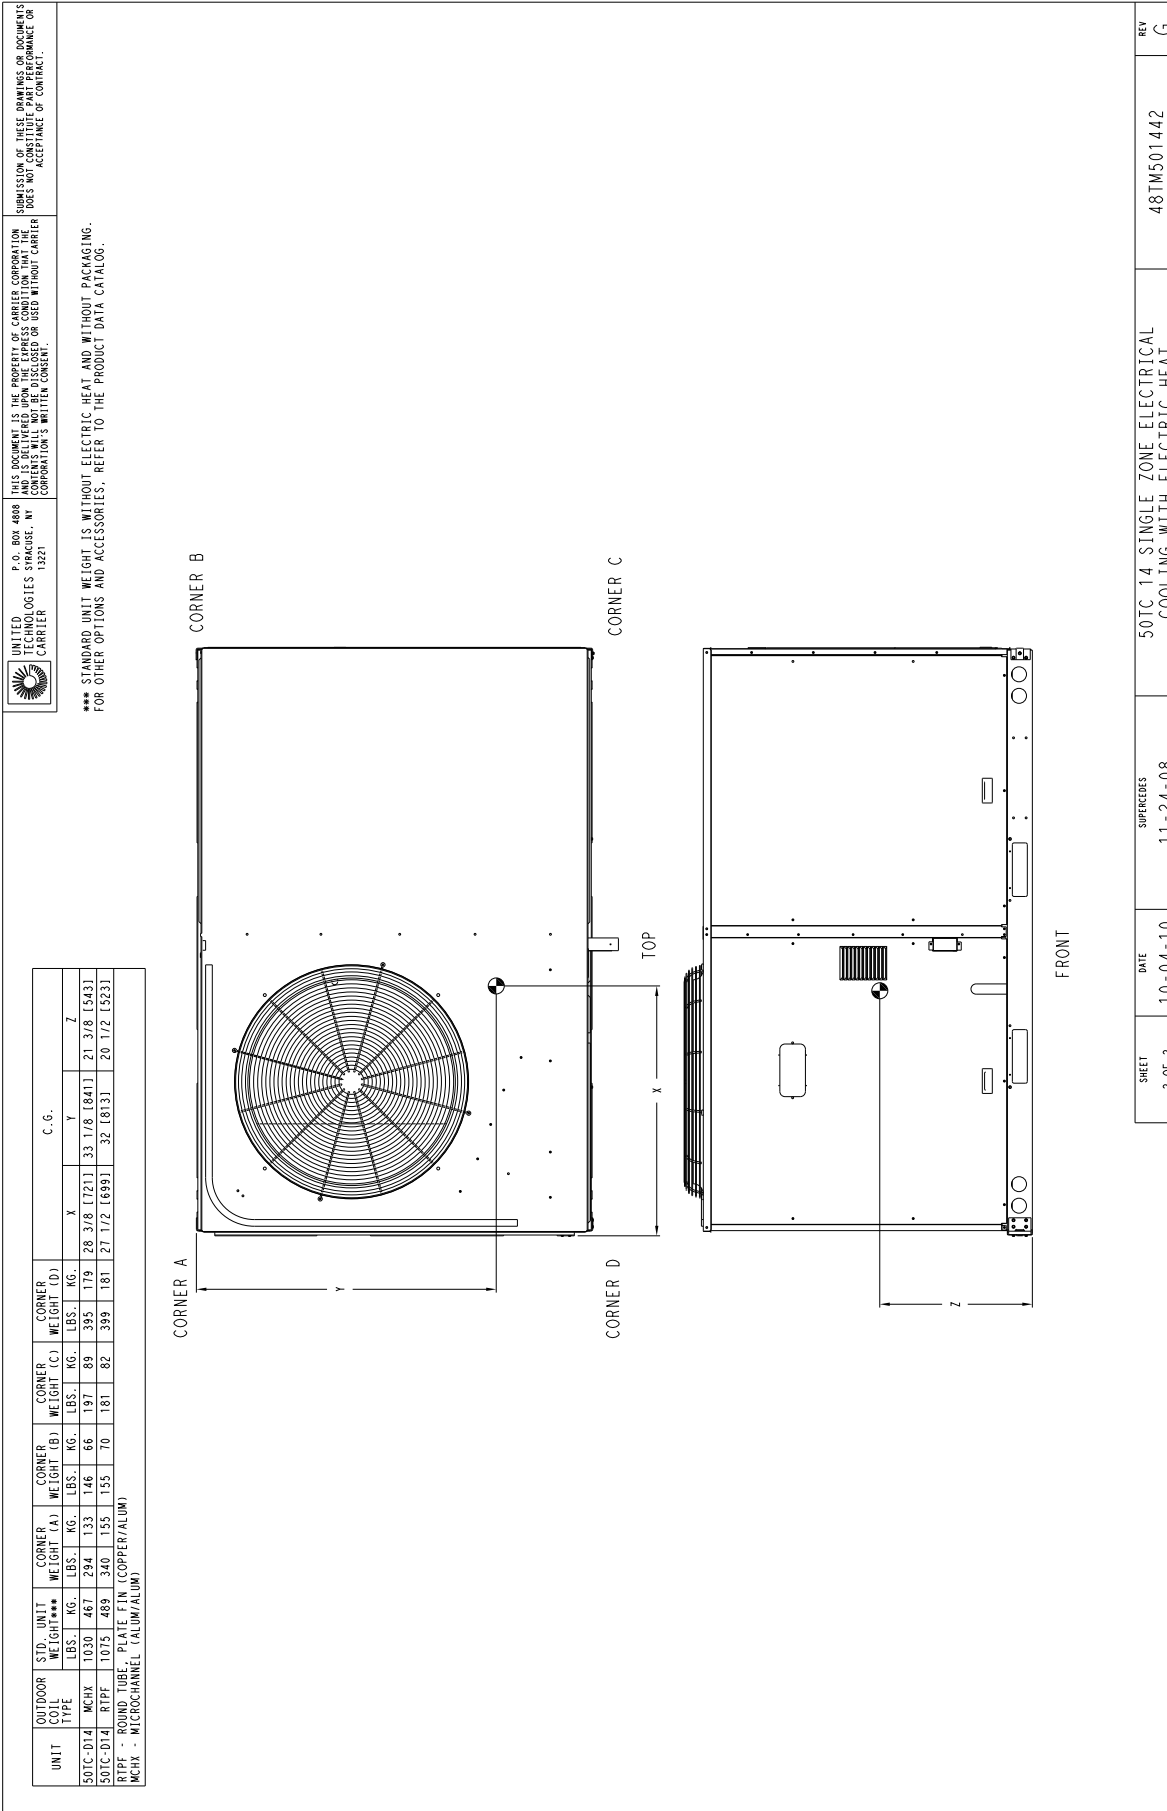

SHEET 2 OF 2	DATE 10-04-10	SUPERSEDES 11-24-08	50TC 14 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	48TM501442	REV G
-----------------	------------------	------------------------	--	------------	----------

Fig. 9 - Dimensions 50TC 14 (Sheet 2 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

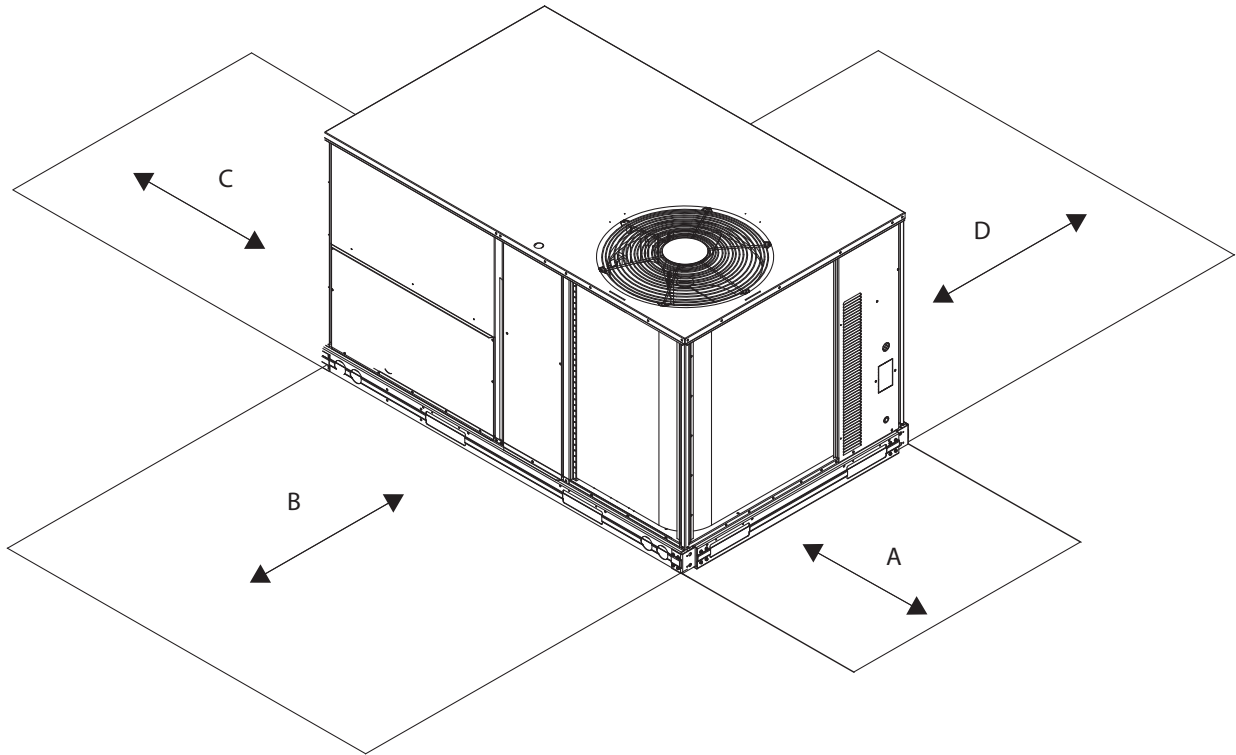


Fig. 10 - Service Clearance

C08337

LOC	DIMENSION	CONDITION
A	48-in (1219 mm)	Unit disconnect is mounted on panel
	18-in (457 mm)	No disconnect, convenience outlet option
	18-in (457 mm)	Recommended service clearance
	12-in (305 mm)	Minimum clearance
B	42-in (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall)
	36-in (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36-in (914 mm)	Side condensate drain is used
	18-in (457 mm)	Minimum clearance
D	42-in (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36-in (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

NOTE: Unit not designed to have overhead obstruction. Contact Application Engineering for guidance on any application planning overhead obstruction or vertical clearances.

CURBS, WEIGHTS & DIMENSIONS (cont.)

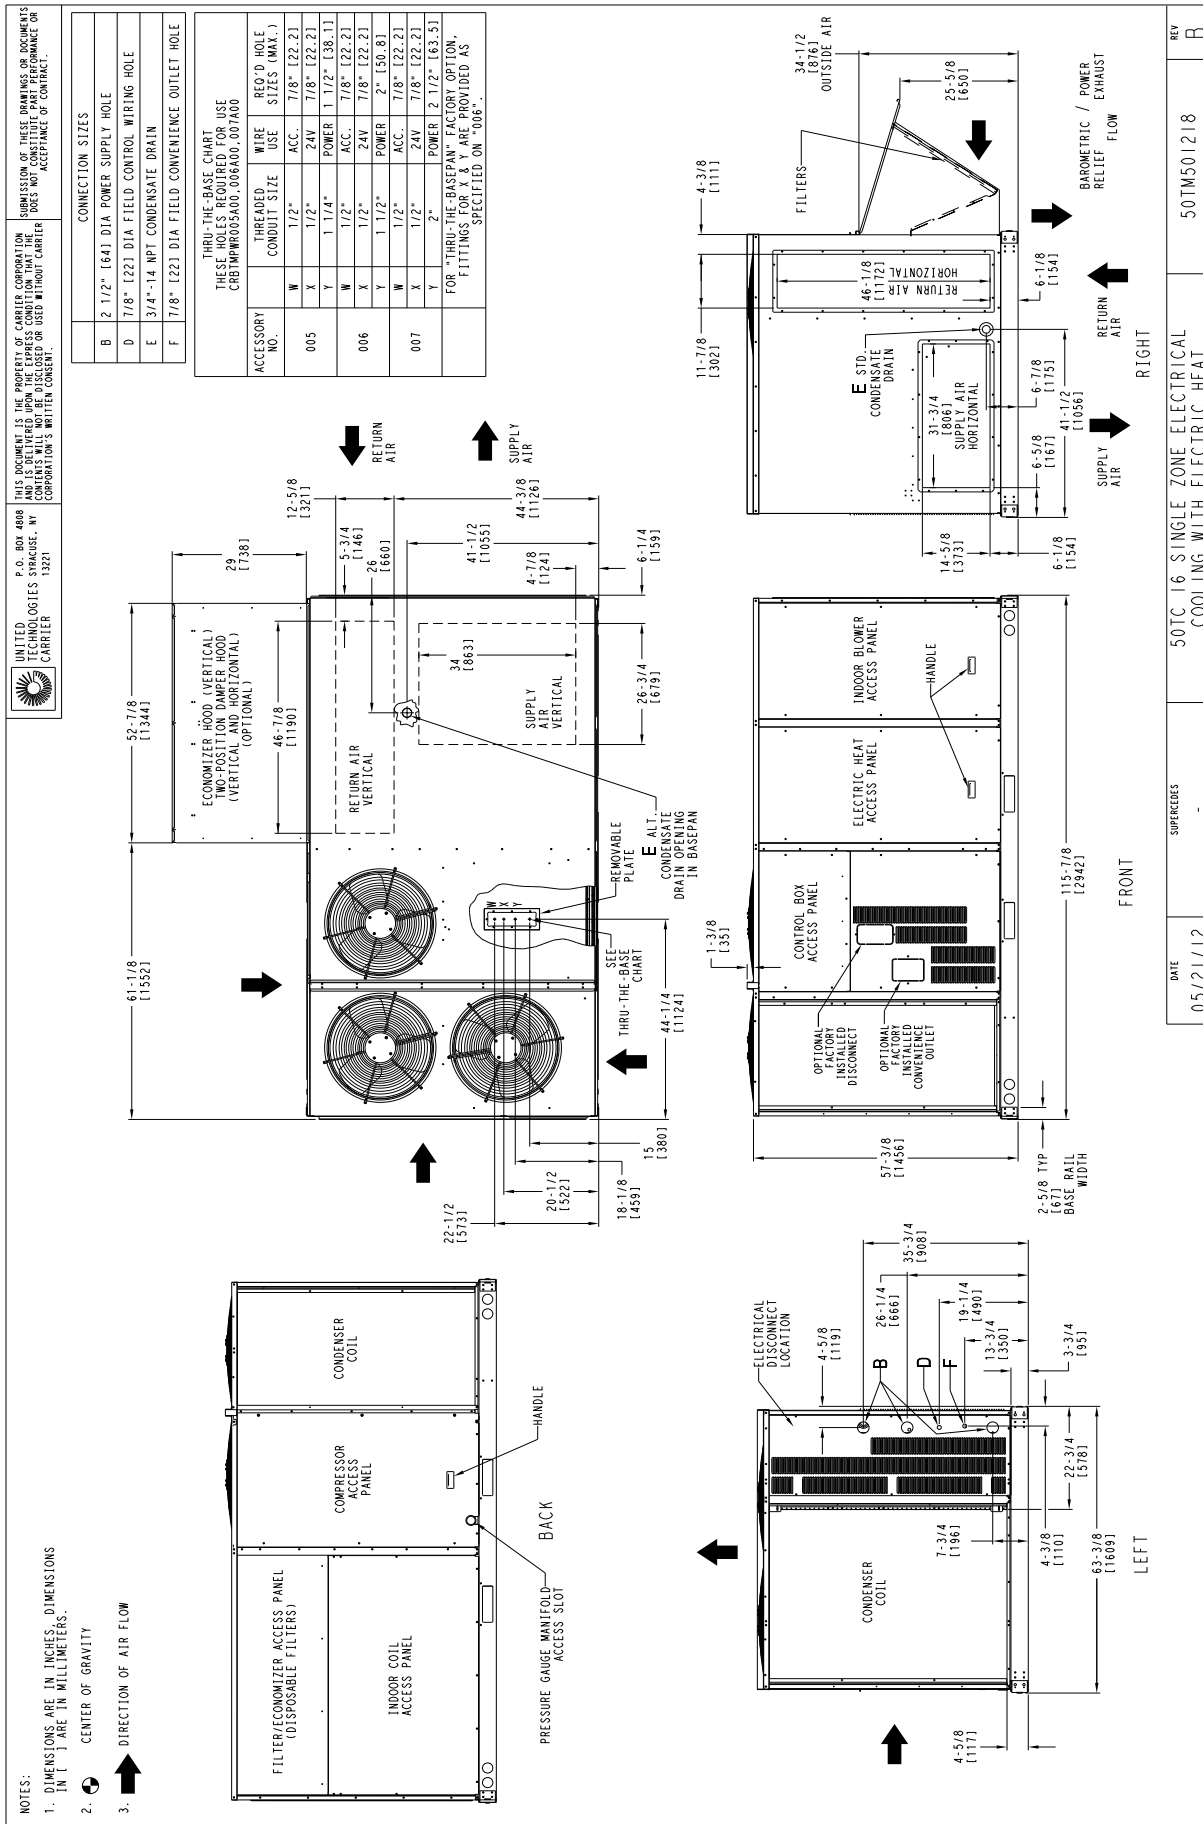


Fig. 12 - Dimensions 50TC 16 (Sheet 1 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

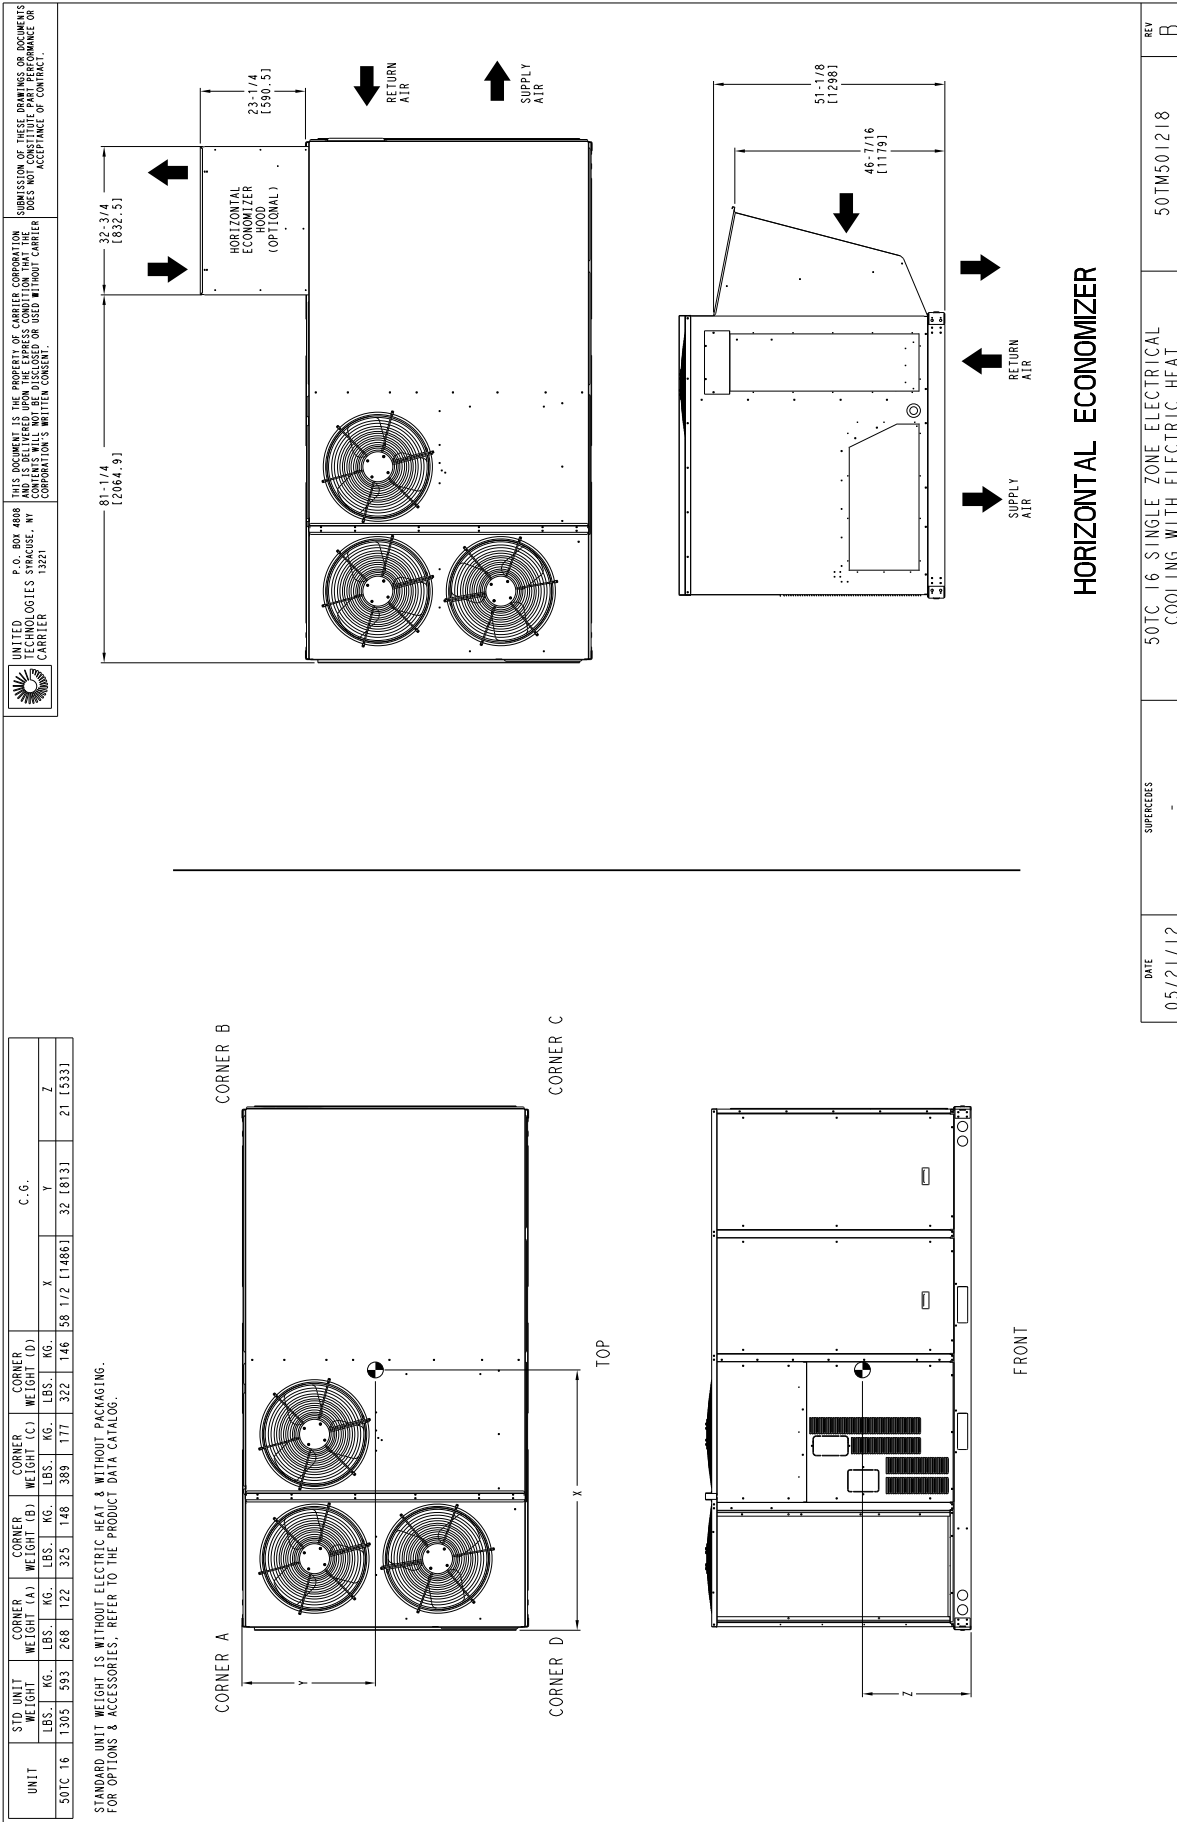


Fig. 13 - Dimensions 50TC 16 (Sheet 2 of 2)

CURBS, WEIGHTS & DIMENSIONS (cont.)

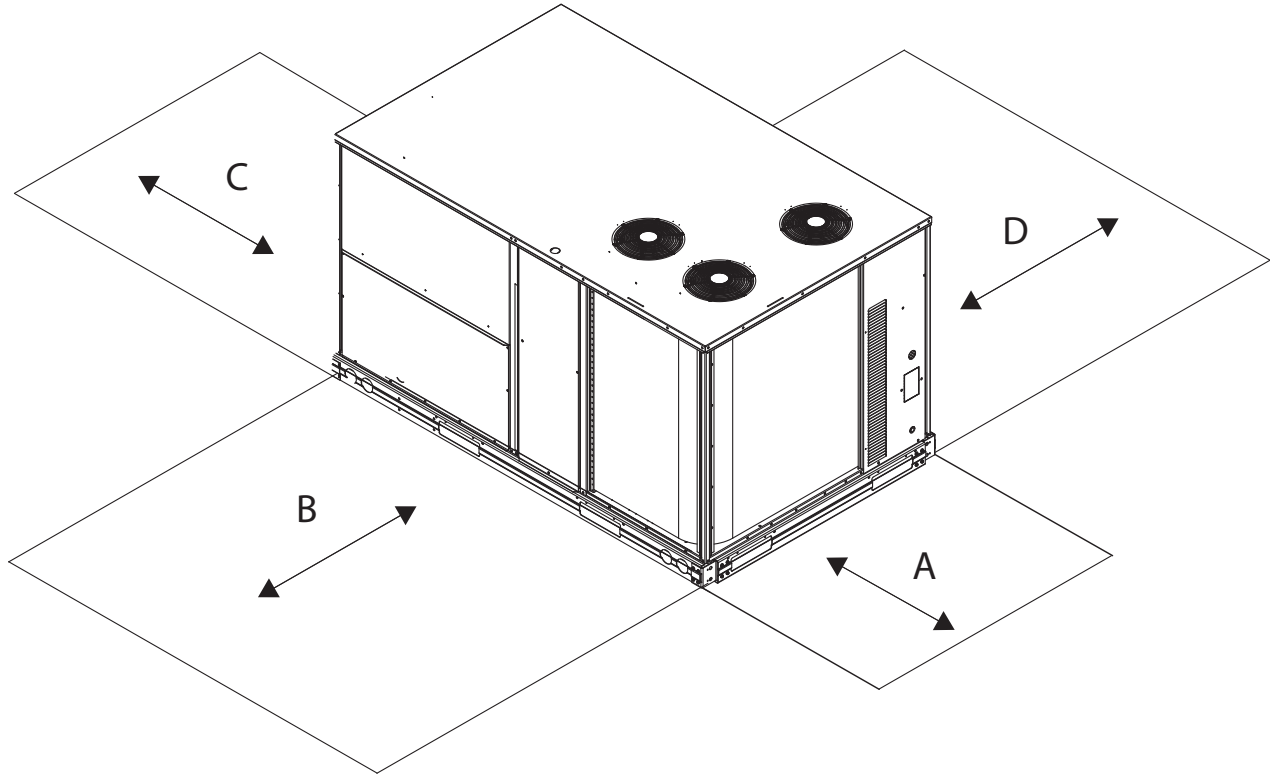


Fig. 14 - Service Clearance

C10578B

LOC	DIMENSION	CONDITION
A	48-in (1219 mm) 18-in (457 mm) 18-in (457 mm) 12-in (305 mm)	Unit disconnect is mounted on panel No disconnect, convenience outlet option Recommended service clearance Minimum clearance
B	42-in (1067 mm) 36-in (914 mm) Special	Surface behind servicer is grounded (e.g., metal, masonry wall) Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass) Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36-in (914 mm) 18-in (457 mm)	Side condensate drain is used Minimum clearance
D	48-in (1219 mm) 42-in (1067 mm) 36-in (914 mm) Special	No flue discharge accessory installed, surface is combustible material Surface behind servicer is grounded (e.g., metal, masonry wall, another unit) Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass) Check for adjacent units or building fresh air intakes within 10-ft of this unit's flue outlet

NOTE: Unit not designed to have overhead obstruction. Contact Application Engineering for guidance on any application planning overhead obstruction or vertical clearances.

CURBS, WEIGHTS & DIMENSIONS (cont.)

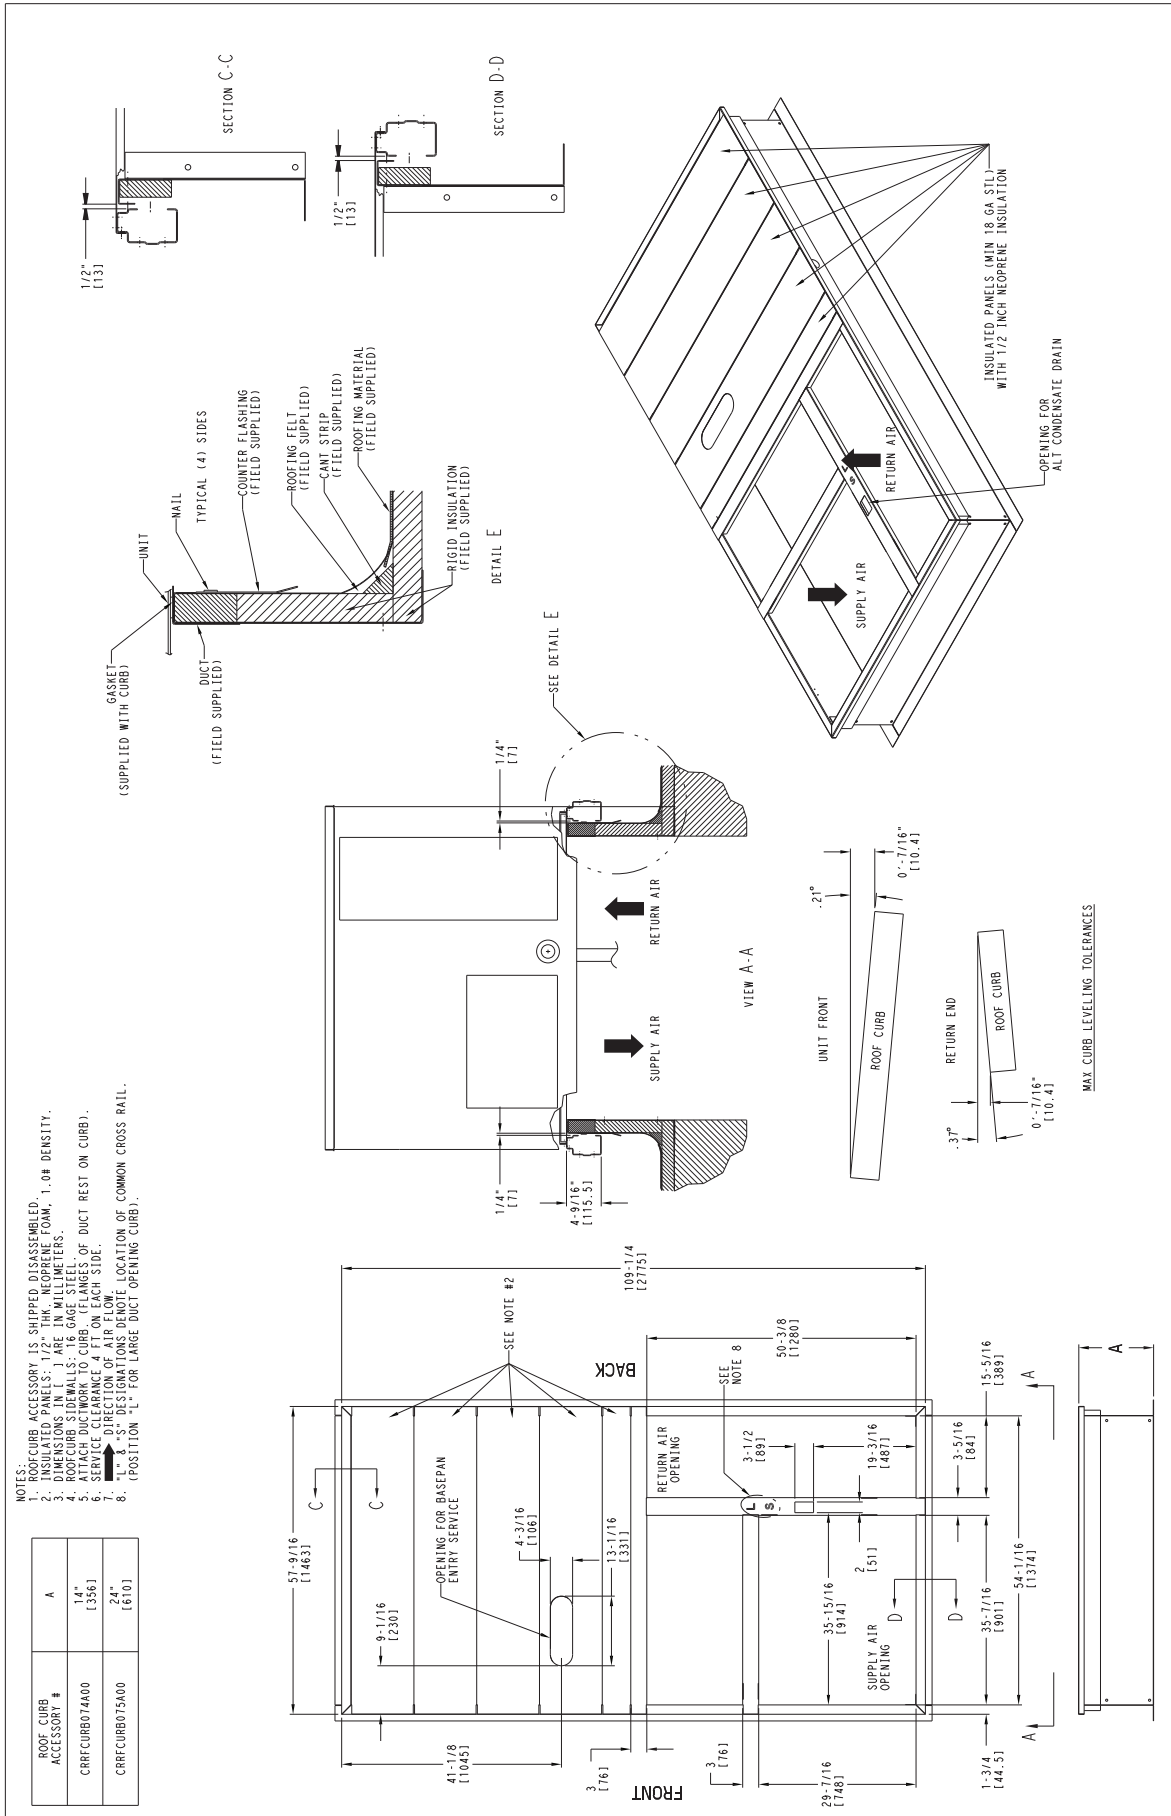


Fig. 15 - Roof Curb Details 50TC 16

OPTION / ACCESSORY WEIGHTS

OPTION / ACCESSORY	OPTION / ACCESSORY WEIGHTS																	
	04		05		06		07		08		09		12		14		16	
	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg
Humidi–MiZer ^{®1, 3}	50	23	50	23	50	23	55	25	80	36	80	36	80	36	85	39	90	41
Power Exhaust – vertical	50	23	50	23	50	23	50	23	75	34	75	34	75	34	75	34	85	39
Power Exhaust – horizontal	30	14	30	14	30	14	30	14	30	14	30	14	30	14	30	14	75	34
EconoMi\$er (IV, X or 2)	50	23	50	23	50	23	50	23	75	34	75	34	75	34	75	34	115	52
Two Position damper	39	18	39	18	39	18	39	18	58	26	58	26	58	26	58	26	65	29
Manual Dampers	12	5	12	5	12	5	12	5	18	8	18	8	18	8	18	8	25	11
Hail Guard (louvered)	16	7	16	7	16	7	16	7	34	15	34	15	34	15	34	15	45	20
Cu/Cu Condenser Coil ²	6	3	13	6	13	6	15	7	12	5	23	10	23	10	23	10	190	86
Cu/Cu Cond. & Evaporator Coils ²	12	5	19	9	21	10	26	12	25	11	49	22	49	22	49	22	280	127
Roof Curb (14–in. curb)	115	52	115	52	115	52	115	52	143	65	143	65	143	65	143	65	180	82
Roof Curb (24–in. curb)	197	89	197	89	197	89	197	89	245	111	245	111	245	111	245	111	255	116
CO ₂ sensor	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Electric Heater	30	14	30	14	30	14	30	14	45	20	45	20	45	20	45	20	25	11
Single Point Kit	10	5	10	5	10	5	10	5	12	5	12	5	12	5	15	7	25	11
Optional Indoor Motor / Drive	10	5	10	5	10	5	10	5	15	7	15	7	15	7	15	7	45	20
Motor Master Controller	35	16	35	16	35	16	35	16	35	16	35	16	35	16	40	18	35	16
Return Smoke Detector	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Supply Smoke Detector	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Non–Fused Disconnect	15	7	15	7	15	7	15	7	15	7	15	7	15	7	15	7	15	7
Powered Convenience outlet	35	16	35	16	35	16	35	16	35	16	35	16	35	16	35	16	35	16
Non–Powered Convenience outlet	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Enthalpy Sensor	2	1	2	1	2	1	2	1	2	1	2	1	2	1	2	1	2	1
Differential Enthalpy Sensor	3	1	3	1	3	1	3	1	3	1	3	1	3	1	3	1	3	1
SAV System with VFD	–	–	–	–	–	–	–	–	20	9	20	9	20	9	20	9	20	9

NOTE: Where multiple variations are available, the heaviest combination is listed.

– Not Available

¹ For Humidi–MiZer add MotorMaster Controller.

² Where available.

³ The last order date for 48TC 04–06 units with Humidi–MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.

APPLICATION DATA

Min operating ambient temp (cooling):

In mechanical cooling mode, your Carrier rooftop can safely operate down to an outdoor ambient temperature of 40°F (4°C) and 25°F (-4°C), with an accessory winter start kit. It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

Max operating ambient temp (cooling):

The maximum operating ambient temperature for cooling mode is 115°F (46°C). While cooling operation above 115°F (46°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

Min and max airflow (cooling mode):

To maintain safe and reliable operation of your rooftop, operate within the cooling airflow limits. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up.

Airflow:

All units are draw-through in cooling mode.

Outdoor air application strategies:

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local Carrier representative for assistance.

Motor limits, Brake horsepower (BHP):

Due to Carrier's internal unit design, air path, and specially designed motors, the full horsepower (maximum continuous BHP) band, as listed in the Physical Data tables, can be used with the utmost confidence. There is no need for extra safety factors, as Carrier's motors are designed and rigorously tested to use the entire, listed BHP range without either nuisance tripping or premature motor failure.

Sizing a rooftop

Bigger isn't necessarily better. While an air conditioner needs to have enough capacity to meet the load, it doesn't need excess capacity. In fact, having excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, and rounding up to the next largest unit, are all signs of oversizing air conditioners. Oversizing can cause short-cycling, and short cycling leads to poor humidity control, reduced efficiency, higher utility bills, drastic indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, wise contractors and engineers "right-size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures.

Low ambient applications

When equipped with a Carrier economizer, your rooftop unit can cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based "free cooling" is the preferred less costly and energy conscious method.

In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your Carrier rooftop can operate at ambient temperatures down to -20°F (-29°C) using the recommended accessory Motormaster low ambient controller.

Winter start

Carrier's winter start kit extends the low ambient limit of your rooftop to 25°F (-4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

APPLICATION DATA (cont.)

Staged Air Volume (SAV) with Variable Frequency Drive (VFD)

Carrier's Staged Air Volume (SAV) system utilizes a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed in sequence with the units cooling operation. Per ASHRAE 90.1 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%). During the heating mode, the VFD will allow total design cfm (100%) operation and during the ventilation mode the VFD will allow operation to 2/3rd of total cfm.

The VFD used in Carrier's SAV system has soft start capabilities to slowly ramp up the speeds, thus eliminating any high inrush air volume during initial start-up. It also has internal over current protection for the fan motor and a field installed display kit that allows adjustment and in depth diagnostics of the VFD.

This SAV system is available on models with 2-stage cooling operation with electrical mechanical or RTU Open (multi Protocol) controls. Both space sensor and conventional thermostats/controls can be used to provide accurate control in any application.

The SAV system is very flexible for initial fan performance set up and adjustment. The standard factory shipped VFD is pre programmed to automatically stage the fan speed between the first and second stage of cooling. The unit fan performance static pressure and cfm can be easily adjusted using the traditional means of pulley adjustments. The other means to adjust the unit static and cfm performance is to utilize the field installed display module and adjust the frequency and voltage in the VFD to required performance requirements. In either case, once set up the VFD will automatically adjust the speed between the cooling stage operation.

50TC - Staged Air volume (SAV) - Variable Frequency Drive (VFD) HP Rating

UNIT SIZE	VOLTAGE	STATIC OPTION	VFD HP RATING
08	208/230, 460, 575	STD	3
	208/230, 460	MED	3
	575	MED	5
	208/230, 460, 575	HIGH	7.5
09	208/230, 460, 575	STD	3
	208/230, 460, 575	MED	3
	208/230, 460, 575	HIGH	5
12	208/230, 460, 575	STD	3
	208/230, 460, 575	MED	3
	208/230, 460, 575	HIGH	7.5
14	208/230, 460	STD	3
	575	STD	5
	208/230, 460, 575	MED	5
	208/230, 460, 575	HIGH	7.5
16	208/230, 460	STD	3
	575	STD	5
	208/230, 460, 575	MED	5
	208/230, 460, 575	HIGH	7.5

SELECTION PROCEDURE (WITH 50TC-A07 EXAMPLE)¹

I. Determine cooling and heating loads.

Given:

Mixed Air Drybulb	80°F (27°C)
Mixed Air Wetbulb	67°F (19°C)
Ambient Drybulb	95°F (35°C)
TC _{Load}	69.0 MBH
SHC _{Load}	51.0 MBH
Vertical Supply Air	2100 CFM
External Static Pressure	0.66 in.wg
Electrical Characteristics	230-3-60

II. Make an initial guess at cooling tons.

Refrig. tons = TC_{Load} / 12 MBH per ton

Refrig. tons = 69.0 / 12 = 5.75 tons

In this case, start by looking at the 50TC-*07.

III. Look up the rooftop's TC and SHC.

Table 16 shows that, at the application's supply air CFM, mixed air and ambient temperatures, the 50TC-A07 supplies:

TC_{Load} = 73.7 MBH

SHC_{Load} = 54.4 MBH.

IV. Calculate the building Latent Heat Load.

LC_{Load} = TC_{Load} - SHC_{Load}

LC_{Load} = 69.0 MBH - 51.0 MBH = 18.0 MBH

V. Calculate RTU Latent Heat Capacity

LC = TC - SHC

LC = 73.7 MBH - 54.4 MBH = 19.3 MBH

VI. Compare RTU capacities to loads.^{2,3}

Compare the rooftop's SHC and LC to the building's Sensible and Latent Heat Loads.

VII. Select factory options (FIOP)

Local code requires an economizer for any unit with TC larger than 65.0 MBH.

VIII. Calculate the total static pressure.

External static pressure	0.66 in. wg
Sum of FIOP/Accessory static	+0.14 in. wg
Total Static Pressure	0.80 in. wg

IX. Look up the Indoor Fan RPM & BHP.

Table 50 shows, at 2100 CFM & ESP= 0.8, RPM = 1268 & BHP = 1.52

X. Determine electrical requirements

The MCA and MOCP tables show a 50TC-A07 (without convenience outlet) as:

MCA = 30.5 amps & MOCP = 45 amps

Min. Disconnect Size: FLA = 30 & LRA = 157.

Legend:

BHP	— Brake horsepower
FLA	— Full load amps
LC	— Latent capacity
LRA	— Lock rotor amp
MBH	— (1,000) BTUH
MCA	— Min. circuit ampacity
MOCP	— Max. over-current protection
RPM	— Revolutions per minute
RTU	— Rooftop unit
SHC	— Sensible heat capacity
TC	— Total capacity

NOTES:

1. Selection software by Carrier saves time by performing many of the steps above. Contact your Carrier sales representative for assistance.
2. Selecting a unit with a SHC slightly lower than the SHC_{Load} is often better than oversizing. Slightly lower SHC's will help control indoor humidity, and prevent temperature swings.
3. If the rooftop's capacity meets the Sensible Heat Load, but not the Latent Heat Load.
4. Indoor Fan Motor efficiency is available in Electrical Information. Use the decimal form in the equation eg. 80% = .8.

Table 10 – COOLING CAPACITIES

1-STAGE COOLING

3 TONS

50TC–A04 (RTPF)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
900 Cfm	EAT (wb)	58	TC	29.0	29.0	32.9	26.8	26.8	30.5	24.5	24.5	28.0	22.0	22.0	25.3
			SHC	25.1	29.0	32.9	23.1	26.8	30.5	21.0	24.5	28.0	18.8	22.0	25.3
		62	TC	31.3	31.3	31.4	28.4	28.4	29.8	25.4	25.4	28.1	22.2	22.2	26.1
			SHC	22.8	27.1	31.4	21.2	25.5	29.8	19.5	23.8	28.1	17.6	21.9	26.1
		67	TC	35.3	35.3	35.3	32.6	32.6	32.6	29.7	29.7	29.7	26.3	26.3	26.3
			SHC	19.0	23.2	27.3	17.5	21.7	25.9	16.0	20.3	24.6	14.4	18.7	23.0
		72	TC	39.3	39.3	39.3	36.9	36.9	36.9	34.1	34.1	34.1	30.8	30.8	30.8
			SHC	15.1	19.1	23.0	13.9	17.9	21.8	12.4	16.5	20.5	10.8	14.9	19.0
		76	TC	–	42.1	42.1	–	40.0	40.0	–	37.5	37.5	–	–	–
			SHC	–	15.7	20.7	–	14.5	19.5	–	13.3	18.3	–	–	–
1050 Cfm	EAT (wb)	58	TC	31.1	31.1	35.2	28.8	28.8	32.7	26.4	26.4	30.1	23.8	23.8	27.2
			SHC	26.9	31.1	35.2	24.8	28.8	32.7	22.7	26.4	30.1	20.4	23.8	27.2
		62	TC	32.6	32.6	34.6	29.7	29.7	33.0	26.6	26.6	30.8	24.0	24.0	27.8
			SHC	24.8	29.7	34.6	23.1	28.1	33.0	21.2	26.0	30.8	19.0	23.4	27.8
		67	TC	36.6	36.6	36.6	33.9	33.9	33.9	30.8	30.8	30.8	27.4	27.4	27.4
			SHC	20.2	25.0	29.8	18.9	23.8	28.7	17.3	22.3	27.2	15.7	20.6	25.6
		72	TC	40.4	40.4	40.4	38.1	38.1	38.1	35.2	35.2	35.2	32.0	32.0	32.0
			SHC	15.7	20.2	24.8	14.4	19.1	23.8	13.0	17.8	22.5	11.5	16.3	21.1
		76	TC	–	43.4	43.4	–	41.1	41.1	–	38.6	38.6	–	–	–
			SHC	–	16.4	22.1	–	15.3	19.5	–	14.1	18.4	–	–	–
1200 Cfm	EAT (wb)	58	TC	32.8	32.8	37.2	30.5	30.5	34.6	28.0	28.0	31.9	25.3	25.3	28.9
			SHC	28.4	32.8	37.2	26.3	30.5	34.6	24.1	28.0	31.9	21.7	25.3	28.9
		62	TC	33.7	33.7	37.5	30.7	30.7	35.5	28.3	28.3	32.6	25.4	25.4	30.2
			SHC	26.5	32.0	37.5	24.7	30.1	35.5	22.5	27.6	32.6	20.5	25.4	30.2
		67	TC	37.6	37.6	37.6	34.9	34.9	34.9	31.7	31.7	31.7	28.2	28.2	28.2
			SHC	21.3	26.7	32.0	20.1	25.6	31.1	18.6	24.2	29.7	16.9	22.5	28.1
		72	TC	41.2	41.2	41.2	39.0	39.0	39.0	36.1	36.1	36.1	32.7	32.7	32.7
			SHC	16.1	21.3	26.4	15.0	20.2	25.5	13.6	19.0	24.3	12.0	17.5	22.9
		76	TC	–	44.2	44.2	–	41.8	41.8	–	–	–	–	–	–
			SHC	–	17.0	21.8	–	15.9	20.9	–	–	–	–	–	–
1350 Cfm	EAT (wb)	58	TC	34.3	34.3	38.9	31.9	31.9	36.2	29.4	29.4	33.4	26.6	26.6	30.4
			SHC	29.7	34.3	38.9	27.6	31.9	36.2	25.3	29.4	33.4	22.8	26.6	30.4
		62	TC	34.7	34.7	39.6	32.3	32.3	37.0	29.4	29.4	34.8	26.7	26.7	31.7
			SHC	27.9	33.7	39.6	25.9	31.4	37.0	24.0	29.4	34.8	21.6	26.7	31.7
		67	TC	38.5	38.5	38.5	35.7	35.7	35.7	32.5	32.5	32.5	28.9	28.9	30.4
			SHC	22.4	28.2	34.0	21.2	27.3	33.3	19.8	25.9	32.1	18.0	24.2	30.4
		72	TC	42.0	42.0	42.0	39.6	39.6	39.6	36.7	36.7	36.7	–	–	–
			SHC	16.6	22.2	27.8	15.4	21.2	26.9	14.1	20.0	26.0	–	–	–
		76	TC	–	44.9	44.9	–	42.5	42.5	–	–	–	–	–	–
			SHC	–	17.6	23.0	–	16.5	22.0	–	–	–	–	–	–
1500 Cfm	EAT (wb)	58	TC	35.5	35.5	40.2	33.2	33.2	37.7	30.5	30.5	34.7	27.7	27.7	31.6
			SHC	30.8	35.5	40.2	28.7	33.2	37.7	26.3	30.5	34.7	23.8	27.7	31.6
		62	TC	35.8	35.8	40.9	33.7	33.7	38.3	30.6	30.6	36.2	27.8	27.8	33.0
			SHC	28.9	34.9	40.9	26.9	32.6	38.3	25.0	30.6	36.2	22.6	27.8	33.0
		67	TC	39.1	39.1	39.1	36.3	36.3	36.3	33.1	33.1	34.4	29.4	29.4	32.7
			SHC	23.3	29.6	35.9	22.2	28.8	35.4	20.9	27.6	34.4	19.1	25.9	32.7
		72	TC	42.6	42.6	42.6	40.1	40.1	40.1	37.4	37.4	37.4	–	–	–
			SHC	17.0	23.1	29.2	15.8	22.1	28.3	14.5	21.0	27.5	–	–	–
		76	TC	–	45.4	45.4	–	43.0	43.0	–	–	–	–	–	–
			SHC	–	18.0	24.0	–	16.9	23.0	–	–	–	–	–	–

LEGEND:

- Do not operate
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

50TC 04 (3 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
NOTE: Last order date for 50TC 04 units with Humidi-MiZer is 10/12/2015. Use KC, HC or LC models after the last order date.										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		80 dry bulb			80 dry bulb			80 dry bulb		
		72 wet bulb			67 wet bulb			62 wet bulb		
		900	1200	1500	900	1200	1500	900	1200	1500
75	TC	40.6	43.2	45.3	37.0	39.4	41.3	33.4	35.6	37.4
	SHC	21.6	23.9	25.6	25.6	27.7	29.3	29.6	31.6	33.1
	kW	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0
85	TC	37.0	39.6	41.7	33.6	36.0	37.9	30.2	32.3	34.1
	SHC	17.7	20.2	22.2	22.7	25.0	26.9	27.7	29.9	31.6
	kW	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
95	TC	33.5	36.0	38.1	30.2	32.5	34.4	26.9	29.1	30.8
	SHC	13.7	16.6	18.8	19.7	22.4	24.4	25.7	28.2	30.1
	kW	2.6	2.6	2.6	2.5	2.5	2.5	2.5	2.5	2.5
105	TC	29.9	32.4	34.5	26.8	29.1	31.0	23.6	25.8	27.5
	SHC	9.8	12.9	15.3	16.8	19.7	22.0	23.8	26.5	28.6
	kW	2.9	2.9	2.9	2.8	2.8	2.8	2.8	2.8	2.8
115	TC	26.3	28.8	30.9	23.3	25.7	27.5	20.4	22.5	24.2
	SHC	5.8	9.2	11.9	13.8	17.0	19.5	21.9	24.8	27.1
	kW	3.2	3.2	3.2	3.1	3.1	3.1	3.1	3.1	3.1

50TC 04 (3 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
NOTE: Last order date for 50TC 04 units with Humidi-MiZer is 10/12/2015. Use KC, HC or LC models after the last order date.										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		75 dry bulb			75 dry bulb			75 dry bulb		
		62.5 wet bulb (50% relative)			64 wet bulb (55% relative)			65.3 wet bulb (60% relative)		
		1050	1200	1350	1050	1200	1350	1050	1200	1350
80	TC	14.7	15.5	16.2	15.9	16.7	17.4	16.9	17.7	18.4
	SHC	6.7	7.6	8.5	4.8	5.7	6.6	3.2	4.1	5.0
	kW	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0
75	TC	15.1	15.8	16.4	16.2	17.0	17.6	17.2	18.0	18.6
	SHC	7.5	8.4	9.2	5.8	6.7	7.5	4.4	5.2	6.0
	kW	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0	2.0
70	TC	15.5	16.1	16.7	16.6	17.3	17.9	17.5	18.2	18.8
	SHC	8.4	9.3	10.0	6.9	7.7	8.5	5.5	6.4	7.1
	kW	1.9	1.9	1.9	1.9	1.9	1.9	1.9	1.9	1.9
60	TC	16.2	16.8	17.3	17.2	17.8	18.3	18.1	18.7	19.2
	SHC	10.2	10.9	11.6	8.9	9.7	10.4	7.8	8.6	9.3
	kW	1.8	1.8	1.8	1.8	1.8	1.8	1.9	1.9	1.9
50	TC	17.0	17.5	17.9	17.9	18.4	18.8	18.7	19.2	19.6
	SHC	11.9	12.6	13.2	11.0	11.6	12.2	10.1	10.8	11.4
	kW	1.7	1.7	1.7	1.8	1.8	1.8	1.8	1.8	1.8
40	TC	17.7	18.1	18.5	18.6	19.0	19.3	19.3	19.7	20.1
	SHC	13.7	14.3	14.8	13.0	13.6	14.1	12.4	13.0	13.5
	kW	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7

LEGEND

- Edb – Entering Dry-Bulb
- Ewb – Entering Wet-Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry-Bulb
- lwb – Leaving Wet-Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 12 – COOLING CAPACITIES

1-STAGE COOLING

4 TONS

50TC–A05 (RTPF)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
1200 Cfm	EAT (wb)	58	TC	39.1	39.1	42.6	36.6	36.6	39.6	33.1	33.1	37.8	30.1	30.1	34.4
			SHC	32.9	37.7	42.6	30.5	35.0	39.6	28.5	33.1	37.8	25.8	30.1	34.4
		62	TC	42.3	42.3	42.3	39.1	39.1	39.1	35.3	35.3	36.8	31.2	31.2	34.6
			SHC	30.0	35.2	40.5	28.3	33.7	39.0	26.2	31.5	36.8	24.0	29.3	34.6
		67	TC	47.0	47.0	47.0	44.7	44.7	44.7	40.8	40.8	40.8	36.7	36.7	36.7
			SHC	25.0	29.9	34.9	23.7	28.9	34.0	21.7	26.9	32.1	19.7	25.0	30.2
		72	TC	50.4	50.4	50.4	48.9	48.9	48.9	46.1	46.1	46.1	42.5	42.5	42.5
			SHC	19.7	24.3	28.8	18.7	23.5	28.3	17.2	22.0	26.8	15.4	20.2	25.1
		76	TC	–	52.3	52.3	–	50.9	50.9	–	49.3	49.3	–	46.3	46.3
			SHC	–	20.0	25.1	–	18.8	25.4	–	17.8	24.4	–	16.2	22.8
1400 cfm	EAT (wb)	58	TC	42.0	42.0	45.1	38.5	38.5	43.8	35.6	35.6	40.5	32.5	32.5	37.0
			SHC	35.0	40.1	45.1	33.3	38.5	43.8	30.7	35.6	40.5	27.9	32.5	37.0
		62	TC	44.4	44.4	44.7	40.7	40.7	42.8	36.9	36.9	40.7	32.9	32.9	37.8
			SHC	32.6	38.6	44.7	30.7	36.8	42.8	28.5	34.6	40.7	26.1	32.0	37.8
		67	TC	48.3	48.3	48.3	45.8	45.8	45.8	42.4	42.4	42.4	38.3	38.3	38.3
			SHC	26.2	31.8	37.3	25.1	31.0	36.9	23.4	29.3	35.3	21.5	27.6	33.6
		72	TC	51.2	51.2	51.2	49.8	49.8	49.8	47.4	47.4	47.4	43.7	43.7	43.7
			SHC	20.0	25.2	30.4	19.1	24.6	30.2	17.8	23.5	29.3	16.0	21.8	27.7
		76	TC	–	52.8	52.8	–	51.4	51.4	–	50.1	50.1	–	47.0	47.0
			SHC	–	20.3	25.7	–	19.2	26.9	–	18.5	24.0	–	17.1	22.7
1600 Cfm	EAT (wb)	58	TC	43.6	43.6	49.3	40.7	40.7	46.2	37.7	37.7	42.9	34.5	34.5	39.3
			SHC	37.8	43.6	49.3	35.2	40.7	46.2	32.5	37.7	42.9	29.6	34.5	39.3
		62	TC	45.6	45.6	47.6	42.1	42.1	46.1	38.3	38.3	43.7	34.8	34.8	39.8
			SHC	34.4	41.0	47.6	32.7	39.4	46.1	30.5	37.1	43.7	27.5	33.6	39.8
		67	TC	49.2	49.2	49.2	47.0	47.0	47.0	43.6	43.6	43.6	39.3	39.3	39.3
			SHC	27.2	33.3	39.4	26.4	32.9	39.5	24.8	31.6	38.3	22.8	29.6	36.4
		72	TC	51.8	51.8	51.8	50.4	50.4	50.4	48.2	48.2	48.2	44.6	44.6	44.6
			SHC	20.3	26.0	31.7	19.5	25.5	31.6	18.3	24.7	31.2	16.6	23.2	29.8
		76	TC	–	53.2	53.2	–	51.6	51.6	–	50.5	50.5	–	47.8	47.8
			SHC	–	20.6	26.4	–	19.7	25.8	–	19.1	25.4	–	17.8	24.3
1800 Cfm	EAT (wb)	58	TC	45.3	45.3	51.2	42.6	42.6	48.3	39.5	39.5	44.9	36.2	36.2	41.2
			SHC	39.3	45.3	51.2	36.9	42.6	48.3	34.1	39.5	44.9	31.1	36.2	41.2
		62	TC	46.5	46.5	50.1	43.5	43.5	49.0	40.0	40.0	45.4	36.7	36.7	41.7
			SHC	36.0	43.0	50.1	34.5	41.7	49.0	31.7	38.6	45.4	29.0	35.3	41.7
		67	TC	50.0	50.0	50.0	48.1	48.1	48.1	44.5	44.5	44.5	40.4	40.4	40.4
			SHC	28.1	34.7	41.3	27.8	35.1	42.3	26.1	33.6	41.0	24.3	31.8	39.4
		72	TC	52.2	52.2	52.2	50.9	50.9	50.9	48.7	48.7	48.7	45.4	45.4	45.4
			SHC	20.6	26.7	32.8	19.8	26.4	33.0	18.7	25.8	32.8	17.2	24.4	31.6
		76	TC	–	53.5	53.5	–	51.9	51.9	–	51.0	51.0	–	48.2	48.2
			SHC	–	21.1	27.7	–	20.2	26.9	–	19.6	26.5	–	18.4	25.5
2000 Cfm	EAT (wb)	58	TC	46.6	46.6	52.7	44.2	44.2	50.1	41.1	41.1	46.6	37.6	37.6	42.8
			SHC	40.5	46.6	52.7	38.3	44.2	50.1	35.5	41.1	46.6	32.4	37.6	42.8
		62	TC	47.4	47.4	51.9	44.9	44.9	50.8	41.6	41.6	47.0	37.7	37.7	44.6
			SHC	37.1	44.5	51.9	35.9	43.4	50.8	32.9	39.9	47.0	30.7	37.7	44.6
		67	TC	50.4	50.4	50.4	48.6	48.6	48.6	45.2	45.2	45.2	41.3	41.3	42.1
			SHC	28.8	35.8	42.8	28.5	36.2	43.8	27.3	35.3	43.3	25.6	33.8	42.1
		72	TC	52.5	52.5	52.5	51.0	51.0	51.0	49.4	49.4	49.4	46.0	46.0	46.0
			SHC	20.8	27.4	33.9	20.0	26.9	33.8	19.1	26.7	34.2	17.6	25.5	33.3
		76	TC	–	53.7	53.7	–	52.1	52.1	–	51.1	51.1	–	48.5	48.5
			SHC	–	21.6	28.8	–	20.6	27.8	–	20.0	27.4	–	18.9	26.6

LEGEND:

- Do not operate
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

50TC 05 (4 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
NOTE: Last order date for 50TC 05 units with Humidi-MiZer is 10/12/2015. Use KC, HC or LC models after the last order date.										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		80 dry bulb 72 wet bulb			80 dry bulb 67 wet bulb			80 dry bulb 62 wet bulb		
		1200	1600	2000	1200	1600	2000	1200	1600	2000
		75	TC	52.5	55.9	58.6	47.1	50.2	52.7	41.7
	SHC	22.6	25.5	27.8	27.1	29.9	32.0	31.6	34.2	36.2
	kW	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
85	TC	48.7	52.2	54.9	43.4	46.5	49.0	38.0	40.8	43.1
	SHC	18.0	21.3	23.9	23.6	26.8	29.2	29.3	32.2	34.4
	kW	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
95	TC	44.9	48.4	51.2	39.6	42.8	45.3	34.3	37.1	39.4
	SHC	13.4	17.2	20.0	20.2	23.7	26.4	27.0	30.2	32.7
	kW	3.4	3.4	3.4	3.3	3.3	3.3	3.3	3.3	3.3
105	TC	41.1	44.7	47.5	35.9	39.1	41.7	30.6	33.5	35.8
	SHC	8.8	13.0	16.1	16.7	20.6	23.6	24.6	28.2	31.0
	kW	3.8	3.8	3.8	3.7	3.7	3.7	3.7	3.7	3.7
115	TC	37.4	41.0	43.9	32.1	35.4	38.0	26.8	29.8	32.1
	SHC	4.3	8.8	12.2	13.3	17.5	20.7	22.3	26.2	29.2
	kW	4.2	4.2	4.2	4.2	4.2	4.2	4.1	4.1	4.1

50TC 05 (4 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
NOTE: Last order date for 50TC 05 units with Humidi-MiZer is 10/12/2015. Use KC, HC or LC models after the last order date.										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		75 dry bulb 62.5 wet bulb (50% relative)			75 dry bulb 64 wet bulb (55% relative)			75 dry bulb 65.3 wet bulb (60% relative)		
		1200	1600	2000	1200	1600	2000	1200	1600	2000
		80	TC	11.6	13.8	15.5	13.5	15.8	17.6	15.2
	SHC	-1.0	1.2	3.0	-3.1	-0.8	0.9	-4.8	-2.6	-0.9
	kW	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
75	TC	12.5	14.6	16.2	14.3	16.4	18.1	15.9	18.1	19.8
	SHC	-0.7	1.4	3.0	-2.7	-0.6	1.1	-4.3	-2.2	-0.6
	kW	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
70	TC	13.4	15.3	16.8	15.1	17.1	18.7	16.6	18.7	20.3
	SHC	-0.5	1.5	3.0	-2.3	-0.3	1.2	-3.8	-1.9	-0.3
	kW	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
60	TC	15.1	16.8	18.1	16.7	18.4	19.8	18.1	19.9	21.2
	SHC	0.0	1.7	3.1	-1.5	0.2	1.5	-2.8	-1.1	0.2
	kW	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
50	TC	16.9	18.3	19.4	18.3	19.8	20.9	19.6	21.0	22.2
	SHC	0.6	2.0	3.1	-0.7	0.7	1.8	-1.8	-0.4	0.7
	kW	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
40	TC	18.7	19.8	20.7	19.9	21.1	22.0	21.0	22.2	23.2
	SHC	1.1	2.2	3.1	0.1	1.2	2.1	-0.8	0.4	1.3
	kW	2.6	2.6	2.6	2.7	2.7	2.7	2.7	2.7	2.7

LEGEND

- Edb – Entering Dry-Bulb
- Ewb – Entering Wet-Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry-Bulb
- lwb – Leaving Wet-Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 14 – COOLING CAPACITIES

1-STAGE COOLING

5 TONS

50TC–A06 (RTPF)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
1500 Cfm	EAT (wb)	58	TC	52.4	52.4	59.3	48.8	48.8	55.4	45.1	45.1	51.3	41.2	41.2	46.9
			SHC	45.4	52.4	59.3	42.3	48.8	55.4	38.9	45.1	51.3	35.4	41.2	46.9
		62	TC	56.1	56.1	56.5	51.5	51.5	54.1	46.5	46.5	51.5	41.5	41.5	48.4
			SHC	41.2	48.8	56.5	38.8	46.5	54.1	36.2	43.9	51.5	33.4	40.9	48.4
		67	TC	62.7	62.7	62.7	58.7	58.7	58.7	53.6	53.6	53.6	48.2	48.2	48.2
			SHC	34.2	41.7	49.1	32.2	39.8	47.4	29.8	37.4	45.0	27.3	34.9	42.6
		72	TC	69.6	69.6	69.6	65.8	65.8	65.8	61.0	61.0	61.0	55.7	55.7	55.7
			SHC	27.3	34.4	41.5	25.3	32.6	39.8	23.1	30.5	37.8	20.8	28.2	35.6
		76	TC	–	74.9	74.9	–	71.2	71.2	–	66.9	66.9	–	62.0	62.0
			SHC	–	28.0	36.3	–	26.2	34.5	–	24.6	32.8	–	22.5	30.8
1750 Cfm	EAT (wb)	58	TC	56.1	56.1	63.5	52.6	52.6	59.6	48.4	48.4	55.0	44.2	44.2	50.3
			SHC	48.7	56.1	63.5	45.6	52.6	59.6	41.8	48.4	55.0	38.1	44.2	50.3
		62	TC	58.5	58.5	62.4	53.8	53.8	59.9	48.7	48.7	56.6	44.5	44.5	51.6
			SHC	44.9	53.7	62.4	42.4	51.1	59.9	39.4	48.0	56.6	35.7	43.7	51.6
		67	TC	64.6	64.6	64.6	60.7	60.7	60.7	55.6	55.6	55.6	49.9	49.9	49.9
			SHC	36.4	44.9	53.5	34.6	43.4	52.2	32.2	41.0	49.8	29.6	38.4	47.2
		72	TC	71.6	71.6	71.6	67.7	67.7	67.7	63.2	63.2	63.2	57.5	57.5	57.5
			SHC	28.2	36.6	44.9	26.3	34.8	43.3	24.3	32.8	41.4	21.8	30.5	39.1
		76	TC	–	76.8	76.8	–	72.9	72.9	–	68.5	68.5	–	63.7	63.7
			SHC	–	29.4	39.1	–	27.7	35.0	–	25.9	33.7	–	23.9	31.9
2000 Cfm	EAT (wb)	58	TC	58.9	58.9	66.7	55.5	55.5	62.8	51.2	51.2	58.1	46.8	46.8	53.2
			SHC	51.2	58.9	66.7	48.1	55.5	62.8	44.3	51.2	58.1	40.4	46.8	53.2
		62	TC	60.0	60.0	67.6	55.8	55.8	64.5	51.5	51.5	59.5	46.8	46.8	55.4
			SHC	47.9	57.8	67.6	45.3	54.9	64.5	41.6	50.6	59.5	38.3	46.8	55.4
		67	TC	66.5	66.5	66.5	62.3	62.3	62.3	57.3	57.3	57.3	51.2	51.2	51.7
			SHC	38.7	48.5	58.4	36.8	46.7	56.6	34.4	44.4	54.3	31.7	41.7	51.7
		72	TC	73.2	73.2	73.2	69.1	69.1	69.1	64.6	64.6	64.6	59.0	59.0	59.0
			SHC	29.1	38.6	48.1	27.3	36.8	46.4	25.2	34.9	44.6	22.9	32.6	42.4
		76	TC	–	78.4	78.4	–	74.3	74.3	–	69.8	69.8	–	–	–
			SHC	–	30.7	39.4	–	28.9	37.9	–	27.0	36.2	–	–	–
2250 Cfm	EAT (wb)	58	TC	61.5	61.5	69.5	57.9	57.9	65.5	53.6	53.6	60.8	49.0	49.0	55.7
			SHC	53.4	61.5	69.5	50.2	57.9	65.5	46.4	53.6	60.8	42.3	49.0	55.7
		62	TC	61.9	61.9	71.3	58.1	58.1	67.0	53.7	53.7	63.3	49.0	49.0	58.0
			SHC	50.4	60.8	71.3	47.1	57.1	67.0	44.1	53.7	63.3	40.1	49.0	58.0
		67	TC	67.9	67.9	67.9	63.5	63.5	63.5	58.6	58.6	58.7	52.4	52.4	56.0
			SHC	40.8	51.7	62.6	38.7	49.7	60.7	36.6	47.6	58.7	33.8	44.9	56.0
		72	TC	74.4	74.4	74.4	70.3	70.3	70.3	65.7	65.7	65.7	60.2	60.2	60.2
			SHC	29.9	40.5	51.1	28.1	38.8	49.5	26.1	36.9	47.7	23.8	34.8	45.7
		76	TC	–	79.6	79.6	–	75.5	75.5	–	70.9	70.9	–	–	–
			SHC	–	31.7	41.7	–	30.0	40.2	–	28.1	38.5	–	–	–
2500 Cfm	EAT (wb)	58	TC	63.6	63.6	71.9	60.0	60.0	67.9	55.7	55.7	63.1	50.9	50.9	57.8
			SHC	55.3	63.6	71.9	52.1	60.0	67.9	48.2	55.7	63.1	44.0	50.9	57.8
		62	TC	64.0	64.0	74.0	60.6	60.6	69.5	55.7	55.7	65.7	51.0	51.0	60.2
			SHC	52.2	63.1	74.0	49.0	59.2	69.5	45.8	55.7	65.7	41.7	51.0	60.2
		67	TC	68.9	68.9	68.9	64.6	64.6	64.8	59.7	59.7	62.8	53.4	53.4	60.1
			SHC	42.7	54.7	66.7	40.7	52.7	64.8	38.5	50.7	62.8	35.7	47.9	60.1
		72	TC	75.4	75.4	75.4	71.2	71.2	71.2	66.6	66.6	66.6	61.1	61.1	61.1
			SHC	30.7	42.3	53.9	28.9	40.7	52.4	26.9	38.8	50.6	24.6	36.6	48.7
		76	TC	–	80.6	80.6	–	76.4	76.4	–	–	–	–	–	–
			SHC	–	32.7	43.8	–	31.0	42.3	–	–	–	–	–	–

LEGEND:

- Do not operate
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

50TC 06 (5 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
NOTE: Last order date for 50TC 06 units with Humidi-MiZer is 10/12/2015. Use KC, HC or LC models after the last order date.										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		80 dry bulb 72 wet bulb			80 dry bulb 67 wet bulb			80 dry bulb 62 wet bulb		
		1750	2000	2250	1750	2000	2250	1750	2000	2250
		75	TC	73.1	78.7	84.5	63.2	66.9	70.8	53.2
	SHC	35.3	37.2	38.8	42.0	43.7	45.3	48.7	50.3	51.8
	kW	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3
85	TC	67.6	71.2	75.0	59.1	61.2	63.3	50.6	51.1	51.5
	SHC	27.9	30.0	31.9	36.3	38.3	40.1	44.8	46.6	48.2
	kW	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8
95	TC	62.1	63.8	65.5	55.1	55.4	55.8	48.0	47.0	46.0
	SHC	20.5	22.9	24.9	30.7	32.9	34.8	40.9	42.9	44.7
	kW	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
105	TC	56.6	56.3	56.0	51.0	49.6	48.3	45.4	43.0	40.5
	SHC	13.1	15.7	18.0	25.0	27.5	29.6	36.9	39.2	41.2
	kW	4.8	4.8	4.8	4.8	4.8	4.8	4.7	4.7	4.7
115	TC	51.1	48.8	46.5	46.9	43.9	40.7	42.8	39.0	35.0
	SHC	5.8	8.6	11.0	19.4	22.0	24.4	33.0	35.5	37.7
	kW	5.3	5.3	5.3	5.3	5.3	5.3	5.2	5.2	5.2

50TC 06 (5 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
NOTE: Last order date for 50TC 06 units with Humidi-MiZer is 10/12/2015. Use KC, HC or LC models after the last order date.										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		75 dry bulb 62.5 wet bulb (50% relative)			75 dry bulb 64 wet bulb (55% relative)			75 dry bulb 65.3 wet bulb (60% relative)		
		1750	2000	2250	1750	2000	2250	1750	2000	2250
		80	TC	23.0	24.4	25.6	24.7	26.2	27.4	26.3
	SHC	5.3	6.1	6.8	3.2	4.0	4.7	1.4	2.2	2.9
	kW	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
75	TC	23.3	24.6	25.7	25.0	26.3	27.5	26.4	27.8	29.0
	SHC	5.1	5.8	6.5	3.1	3.9	4.5	1.4	2.2	2.8
	kW	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
70	TC	23.5	24.8	25.9	25.2	26.4	27.5	26.6	27.9	29.0
	SHC	4.8	5.5	6.2	3.0	3.7	4.3	1.4	2.1	2.8
	kW	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
60	TC	24.1	25.2	26.1	25.6	26.7	27.7	26.9	28.0	29.0
	SHC	4.3	5.0	5.5	2.8	3.4	3.9	1.4	2.0	2.6
	kW	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
50	TC	24.7	25.6	26.4	26.1	27.0	27.8	27.2	28.2	29.0
	SHC	3.8	4.4	4.8	2.5	3.1	3.5	1.4	2.0	2.4
	kW	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1
40	TC	25.3	26.0	26.7	26.5	27.3	27.9	27.6	28.3	29.0
	SHC	3.3	3.8	4.2	2.3	2.8	3.1	1.4	1.9	2.3
	kW	3.1	3.1	3.1	3.2	3.2	3.2	3.2	3.2	3.2

LEGEND

- Edb – Entering Dry-Bulb
- Ewb – Entering Wet-Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry-Bulb
- lwb – Leaving Wet-Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 16 – COOLING CAPACITIES

1-STAGE COOLING

6 TONS

50TC-A07 (RTPF)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
1800 Cfm	EAT (wb)	58	TC	64.9	64.9	73.3	62.1	62.1	70.0	58.9	58.9	66.4	55.6	55.6	62.7
			SHC	56.6	64.9	73.3	54.1	62.1	70.0	51.4	58.9	66.4	48.5	55.6	62.7
		62	TC	68.7	68.7	70.3	64.9	64.9	68.5	60.8	60.8	66.4	56.4	56.4	64.0
			SHC	51.7	61.0	70.3	49.9	59.2	68.5	47.9	57.2	66.4	45.7	54.9	64.0
		67	TC	75.6	75.6	75.6	71.7	71.7	71.7	67.4	67.4	67.4	62.5	62.5	62.5
			SHC	42.8	52.2	61.5	41.2	50.5	59.8	39.3	48.6	58.0	37.2	46.5	55.8
		72	TC	82.6	82.6	82.6	78.5	78.5	78.5	73.7	73.7	73.7	67.8	67.8	67.8
			SHC	33.5	42.8	52.2	31.9	41.3	50.6	30.0	39.3	48.6	27.8	36.9	45.9
		76	TC	-	87.5	87.5	-	83.3	83.3	-	77.7	77.7	-	70.9	70.9
			SHC	-	35.0	44.9	-	33.5	43.4	-	31.6	41.5	-	29.3	39.1
2100 Cfm	EAT (wb)	58	TC	68.9	68.9	77.7	65.9	65.9	74.3	62.5	62.5	70.5	58.7	58.7	66.2
			SHC	60.1	68.9	77.7	57.4	65.9	74.3	54.5	62.5	70.5	51.2	58.7	66.2
		62	TC	70.9	70.9	76.9	67.1	67.1	75.0	63.0	63.0	72.5	58.7	58.7	68.7
			SHC	55.6	66.3	76.9	53.8	64.4	75.0	51.6	62.1	72.5	48.7	58.7	68.7
		67	TC	77.8	77.8	77.8	73.7	73.7	73.7	69.2	69.2	69.2	64.0	64.0	64.0
			SHC	45.4	56.1	66.8	43.7	54.4	65.2	41.8	52.5	63.2	39.6	50.2	60.7
		72	TC	84.5	84.5	84.5	80.3	80.3	80.3	75.1	75.1	75.1	68.8	68.8	68.8
			SHC	34.5	45.2	55.9	32.9	43.5	54.2	30.9	41.4	52.0	28.5	38.7	48.9
		76	TC	-	89.2	89.2	-	84.7	84.7	-	78.8	78.8	-	71.6	71.6
			SHC	-	36.3	47.8	-	34.7	46.0	-	32.6	43.7	-	30.1	40.9
2400 Cfm	EAT (wb)	58	TC	72.0	72.0	81.2	68.7	68.7	77.5	65.2	65.2	73.5	61.1	61.1	68.9
			SHC	62.8	72.0	81.2	60.0	68.7	77.5	56.9	65.2	73.5	53.3	61.1	68.9
		62	TC	72.8	72.8	82.8	68.9	68.9	80.7	65.2	65.2	76.4	61.2	61.2	71.6
			SHC	59.1	71.0	82.8	57.2	68.9	80.7	54.1	65.2	76.4	50.7	61.2	71.6
		67	TC	79.4	79.4	79.4	75.2	75.2	75.2	70.5	70.5	70.5	65.1	65.1	65.3
			SHC	47.7	59.8	71.8	46.0	58.1	70.2	44.0	56.0	68.1	41.6	53.5	65.3
		72	TC	86.0	86.0	86.0	81.6	81.6	81.6	76.1	76.1	76.1	69.6	69.6	69.6
			SHC	35.3	47.2	59.2	33.7	45.6	57.5	31.7	43.3	55.0	29.1	40.3	51.4
		76	TC	-	90.3	90.3	-	85.7	85.7	-	79.6	79.6	-	72.1	72.1
			SHC	-	37.3	49.8	-	35.6	48.0	-	33.5	45.6	-	30.8	42.5
2700 Cfm	EAT (wb)	58	TC	60.3	60.3	74.1	71.1	71.1	80.2	67.4	67.4	76.0	63.0	63.0	71.1
			SHC	46.4	60.3	74.1	62.0	71.1	80.2	58.8	67.4	76.0	55.0	63.0	71.1
		62	TC	65.4	65.4	69.3	71.2	71.2	83.3	67.5	67.5	79.0	63.1	63.1	73.8
			SHC	41.0	55.1	69.3	59.0	71.2	83.3	55.9	67.5	79.0	52.3	63.1	73.8
		67	TC	72.7	72.7	72.7	76.3	76.3	76.3	71.5	71.5	72.6	65.8	65.8	69.4
			SHC	33.8	48.0	62.2	48.2	61.6	74.9	46.1	59.3	72.6	43.5	56.5	69.4
		72	TC	79.7	79.7	79.7	82.5	82.5	82.5	76.9	76.9	76.9	70.1	70.1	70.1
			SHC	25.8	40.2	54.6	34.5	47.5	60.5	32.3	45.0	57.7	29.7	41.7	53.8
		76	TC	-	85.1	85.1	-	86.4	86.4	-	80.2	80.2	-	72.5	72.5
			SHC	-	33.5	48.4	-	36.5	49.9	-	34.3	47.3	-	31.5	44.0
3000 Cfm	EAT (wb)	58	TC	64.9	64.9	78.8	73.1	73.1	82.5	69.2	69.2	78.0	64.5	64.5	72.7
			SHC	51.1	64.9	78.8	63.8	73.1	82.5	60.3	69.2	78.0	56.2	64.5	72.7
		62	TC	68.7	68.7	76.5	73.2	73.2	85.7	69.2	69.2	81.0	64.5	64.5	75.5
			SHC	45.5	61.0	76.5	60.7	73.2	85.7	57.4	69.2	81.0	53.5	64.5	75.5
		67	TC	75.6	75.6	75.6	77.2	77.2	79.4	72.2	72.2	76.8	66.3	66.3	73.0
			SHC	36.6	52.2	67.7	50.2	64.8	79.4	48.0	62.4	76.8	45.1	59.1	73.0
		72	TC	82.6	82.6	82.6	83.3	83.3	83.3	77.5	77.5	77.5	70.5	70.5	70.5
			SHC	27.2	42.8	58.5	35.1	49.2	63.3	32.9	46.6	60.3	30.2	43.0	55.9
		76	TC	-	87.5	87.5	-	86.9	86.9	-	80.6	80.6	-	72.8	72.8
			SHC	-	35.0	51.5	-	37.3	51.6	-	35.0	48.9	-	32.1	45.3

LEGEND:

- Do not operate in this region
- Cfm - Cubic feet per minute (supply air)
- EAT(db) - Entering air temperature (dry bulb)
- EAT(wb) - Entering air temperature (wet bulb)
- SHC - Sensible heat capacity
- TC - Total capacity

50TC 07 (6 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		80 dry bulb			80 dry bulb			80 dry bulb		
		72 wet bulb			67 wet bulb			62 wet bulb		
		2100	2400	2700	2100	2400	2700	2100	2400	2700
75	TC	86.7	89.9	92.8	79.3	82.3	84.9	71.9	74.6	77.0
	SHC	40.1	41.8	43.3	46.9	48.5	49.9	53.7	55.2	56.5
	kW	4.3	4.3	4.3	4.2	4.2	4.2	4.2	4.2	4.2
85	TC	79.5	82.6	85.4	72.5	75.3	77.9	65.4	68.0	70.3
	SHC	32.1	34.0	35.7	40.7	42.5	44.1	49.4	51.0	52.5
	kW	5.0	5.0	5.0	5.0	5.0	5.0	4.9	4.9	4.9
95	TC	72.4	75.3	78.1	65.6	68.3	70.8	58.8	61.3	63.6
	SHC	24.1	26.3	28.1	34.6	36.6	38.3	45.1	46.9	48.5
	kW	5.8	5.8	5.8	5.7	5.7	5.7	5.6	5.6	5.6
105	TC	65.2	68.1	70.7	58.7	61.4	63.8	52.3	54.7	56.8
	SHC	16.2	18.5	20.5	28.5	30.6	32.6	40.7	42.8	44.6
	kW	6.5	6.5	6.5	6.4	6.4	6.4	6.3	6.3	6.3
115	TC	58.0	60.8	63.3	51.9	54.4	56.7	45.7	48.0	50.1
	SHC	8.2	10.7	13.0	22.3	24.7	26.8	36.4	38.6	40.6
	kW	7.2	7.2	7.2	7.1	7.1	7.1	7.0	7.0	7.0

50TC 07 (6 TONS) – UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
Air Entering Evaporator – CFM										
Temp (F) Air Ent Condenser (Edb)		75 dry bulb			75 dry bulb			75 dry bulb		
		62.5 wet bulb (50% relative)			64 wet bulb (55% relative)			65.3 wet bulb (60% relative)		
		2100	2400	2700	2100	2400	2700	1750	2000	2700
80	TC	16.7	19.8	22.5	18.8	21.9	24.7	16.2	19.4	26.7
	SHC	0.6	0.6	0.6	-0.4	-0.4	-0.4	-1.3	-1.3	-1.3
	kW	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
75	TC	17.7	20.6	23.1	19.6	22.6	25.3	17.3	20.3	27.1
	SHC	0.6	0.6	0.6	-0.3	-0.3	-0.3	-1.2	-1.2	-1.2
	kW	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
70	TC	18.6	21.3	23.7	20.5	23.3	25.8	18.3	21.1	27.6
	SHC	0.7	0.7	0.7	-0.2	-0.2	-0.2	-1.0	-1.0	-1.0
	kW	4.0	4.0	4.0	4.1	4.1	4.1	4.1	4.1	4.1
60	TC	20.5	22.9	25.0	22.2	24.7	26.8	20.4	22.8	28.5
	SHC	0.7	0.7	0.7	-0.0	-0.0	-0.0	-0.7	-0.7	-0.7
	kW	4.1	4.1	4.1	4.1	4.1	4.1	4.1	4.1	4.1
50	TC	22.4	24.4	26.2	24.0	26.0	27.9	22.4	24.5	29.3
	SHC	0.8	0.8	0.8	0.1	0.1	0.1	-0.4	-0.4	-0.4
	kW	4.1	4.1	4.1	4.1	4.1	4.1	4.2	4.2	4.2
40	TC	24.3	25.9	27.4	25.7	27.4	28.9	24.5	26.3	30.2
	SHC	0.8	0.8	0.8	0.3	0.3	0.3	-0.1	-0.1	-0.1
	kW	4.1	4.1	4.1	4.2	4.2	4.2	4.2	4.2	4.2

LEGEND

- Edb – Entering Dry-Bulb
- Ewb – Entering Wet-Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry-Bulb
- lwb – Leaving Wet-Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 18 – COOLING CAPACITIES

1-STAGE COOLING

7.5 TONS

50TC–A08 (RTPF)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EA (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
2250 Cfm	EAT (wb)	58	TC	81.2	81.2	91.8	77.5	77.5	87.7	73.6	73.6	83.3	69.5	69.5	78.7
		SHC	70.5	81.2	91.8	67.3	77.5	87.7	63.9	73.6	83.3	60.4	69.5	78.7	
		62	TC	86.9	86.9	86.9	82.3	82.3	84.0	77.2	77.2	81.5	71.9	71.9	78.8
		SHC	63.6	74.9	86.2	61.4	72.7	84.0	58.9	70.2	81.5	56.3	67.6	78.8	
		67	TC	95.2	95.2	95.2	90.7	90.7	90.7	85.7	85.7	85.7	79.9	79.9	79.9
		SHC	52.8	64.2	75.6	50.9	62.2	73.6	48.8	60.1	71.5	46.3	57.6	68.9	
		72	TC	103.5	103.5	103.5	98.9	98.9	98.9	93.8	93.8	93.8	87.3	87.3	87.3
		SHC	41.5	53.1	64.6	39.7	51.2	62.7	37.7	49.2	60.6	35.3	46.6	57.8	
		76	TC	–	109.6	109.6	–	104.8	104.8	–	99.1	99.1	–	91.6	91.6
		SHC	–	43.7	56.0	–	42.0	54.3	–	40.0	52.4	–	37.4	49.8	
2625 Cfm	EAT (wb)	58	TC	85.9	85.9	97.2	82.2	82.2	93.1	78.1	78.1	88.4	73.9	73.9	83.6
		SHC	74.6	85.9	97.2	71.4	82.2	93.1	67.9	78.1	88.4	64.1	73.9	83.6	
		62	TC	89.6	89.6	94.1	85.1	85.1	91.7	80.1	80.1	89.1	74.6	74.6	86.0
		SHC	68.1	81.1	94.1	65.9	78.8	91.7	63.4	76.3	89.1	60.6	73.3	86.0	
		67	TC	97.9	97.9	97.9	93.2	93.2	93.2	88.1	88.1	88.1	82.0	82.0	82.0
		SHC	55.7	68.7	81.7	53.7	66.7	79.8	51.6	64.6	77.6	49.0	62.0	74.9	
		72	TC	106.0	106.0	106.0	101.3	101.3	101.3	95.9	95.9	95.9	89.0	89.0	89.0
		SHC	42.7	55.8	68.9	40.9	53.9	67.0	38.8	51.8	64.7	36.2	48.9	61.7	
		76	TC	–	111.8	111.8	–	106.9	106.9	–	100.7	100.7	–	92.7	92.7
		SHC	–	45.3	59.8	–	43.6	58.0	–	41.4	55.6	–	38.7	52.6	
3000 Cfm	EAT (wb)	58	TC	89.6	89.6	101.4	85.9	85.9	97.2	81.7	81.7	92.5	77.0	77.0	87.1
		SHC	77.9	89.6	101.4	74.6	85.9	97.2	71.0	81.7	92.5	66.9	77.0	87.1	
		62	TC	91.8	91.8	101.1	87.2	87.2	98.6	82.3	82.3	95.5	77.1	77.1	90.6
		SHC	72.2	86.7	101.1	69.9	84.3	98.6	67.2	81.3	95.5	63.5	77.1	90.6	
		67	TC	99.9	99.9	99.9	95.2	95.2	95.2	89.9	89.9	89.9	83.6	83.6	83.6
		SHC	58.3	72.9	87.5	56.4	71.0	85.5	54.2	68.8	83.4	51.6	66.1	80.5	
		72	TC	107.9	107.9	107.9	103.0	103.0	103.0	97.3	97.3	97.3	90.1	90.1	90.1
		SHC	43.7	58.3	72.8	41.9	56.4	70.9	39.7	54.1	68.4	37.0	51.0	65.0	
		76	TC	–	113.8	113.8	–	108.4	108.4	–	102.0	102.0	–	93.4	93.4
		SHC	–	46.7	62.5	–	44.8	60.4	–	42.6	57.9	–	39.6	54.7	
3375 Cfm	EAT (wb)	58	TC	92.7	92.7	104.9	88.8	88.8	100.5	84.6	84.6	95.7	79.6	79.6	90.0
		SHC	80.5	92.7	104.9	77.1	88.8	100.5	73.4	84.6	95.7	69.1	79.6	90.0	
		62	TC	93.7	93.7	107.3	89.1	89.1	104.7	84.6	84.6	99.5	79.6	79.6	93.6
		SHC	75.8	91.6	107.3	73.5	89.1	104.7	69.8	84.6	99.5	65.6	79.6	93.6	
		67	TC	101.5	101.5	101.5	96.7	96.7	96.7	91.3	91.3	91.3	84.8	84.8	85.7
		SHC	60.8	76.9	93.0	58.8	74.9	91.0	56.7	72.8	88.9	53.9	69.8	85.7	
		72	TC	109.4	109.4	109.4	104.3	104.3	104.3	98.4	98.4	98.4	90.9	90.9	90.9
		SHC	44.6	60.5	76.4	42.8	58.6	74.4	40.5	56.2	71.8	37.7	52.8	68.0	
		76	TC	–	115.1	115.1	–	109.5	109.5	–	102.8	102.8	–	94.0	94.0
		SHC	–	47.8	64.9	–	45.9	62.7	–	43.5	60.1	–	40.4	56.5	
3750 Cfm	EAT (wb)	58	TC	95.3	95.3	107.8	91.3	91.3	103.3	86.9	86.9	98.3	81.7	81.7	92.4
		SHC	82.7	95.3	107.8	79.3	91.3	103.3	75.5	86.9	98.3	70.9	81.7	92.4	
		62	TC	95.5	95.5	112.2	91.3	91.3	107.4	87.0	87.0	102.2	81.7	81.7	96.0
		SHC	78.7	95.5	112.2	75.3	91.3	107.4	71.7	87.0	102.2	67.4	81.7	96.0	
		67	TC	102.8	102.8	102.8	97.9	97.9	97.9	92.3	92.3	94.0	85.7	85.7	90.5
		SHC	63.1	80.6	98.2	61.2	78.7	96.3	59.0	76.5	94.0	56.0	73.2	90.5	
		72	TC	110.6	110.6	110.6	105.4	105.4	105.4	99.2	99.2	99.2	91.5	91.5	91.5
		SHC	45.5	62.7	79.9	43.5	60.7	77.8	41.3	58.1	75.0	38.3	54.5	70.7	
		76	TC	–	116.1	116.1	–	110.3	110.3	–	103.5	103.5	–	94.5	94.5
		SHC	–	48.9	67.0	–	46.8	64.8	–	44.4	62.0	–	41.1	58.1	

LEGEND:

- Do not operate in this region
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

Table 19 – COOLING CAPACITIES

2-STAGE COOLING

7.5 TONS

50TC–D08 (RTPF & Novation)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EA (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
2250 Cfm	EAT (wb)	58	TC	77.4	77.4	87.8	73.8	73.8	83.8	70.1	70.1	79.5	66.0	66.0	74.9
			SHC	66.9	77.4	87.8	63.9	73.8	83.8	60.6	70.1	79.5	57.1	66.0	74.9
		62	TC	82.2	82.2	83.9	77.5	77.5	81.7	72.6	72.6	79.2	67.3	67.3	76.4
			SHC	60.8	72.4	83.9	58.6	70.1	81.7	56.3	67.7	79.2	53.6	65.0	76.4
		67	TC	90.1	90.1	90.1	86.0	86.0	86.0	81.4	81.4	81.4	75.9	75.9	75.9
			SHC	50.2	61.8	73.3	48.5	60.1	71.6	46.5	58.1	69.7	44.2	55.8	67.4
		72	TC	98.0	98.0	98.0	94.0	94.0	94.0	89.5	89.5	89.5	84.3	84.3	84.3
			SHC	39.1	50.7	62.4	37.5	49.2	60.9	35.8	47.5	59.2	33.8	45.5	57.2
		76	TC	–	104.3	104.3	–	100.4	100.4	–	95.9	95.9	–	90.7	90.7
			SHC	–	41.7	54.0	–	40.3	52.7	–	38.7	51.0	–	36.8	49.0
2625 Cfm	EAT (wb)	58	TC	82.1	82.1	93.2	78.4	78.4	89.0	74.4	74.4	84.4	70.0	70.0	79.5
			SHC	71.0	82.1	93.2	67.8	78.4	89.0	64.3	74.4	84.4	60.6	70.0	79.5
		62	TC	84.9	84.9	91.8	80.4	80.4	89.5	75.4	75.4	86.7	70.2	70.2	82.9
			SHC	65.4	78.6	91.8	63.2	76.3	89.5	60.6	73.7	86.7	57.6	70.2	82.9
		67	TC	92.5	92.5	92.5	88.3	88.3	88.3	83.6	83.6	83.6	78.3	78.3	78.3
			SHC	53.0	66.3	79.5	51.3	64.6	78.0	49.4	62.8	76.1	47.2	60.6	73.9
		72	TC	100.4	100.4	100.4	96.4	96.4	96.4	91.7	91.7	91.7	86.4	86.4	86.4
			SHC	40.2	53.5	66.7	38.7	52.0	65.3	36.9	50.3	63.7	35.0	48.4	61.8
		76	TC	–	106.5	106.5	–	102.6	102.6	–	98.0	98.0	–	92.7	92.7
			SHC	–	43.3	57.6	–	41.8	55.9	–	40.2	54.1	–	38.4	52.2
3000 Cfm	EAT (wb)	58	TC	85.7	85.7	97.3	82.2	82.2	93.3	78.0	78.0	88.6	73.5	73.5	83.4
			SHC	74.1	85.7	97.3	71.1	82.2	93.3	67.5	78.0	88.6	63.6	73.5	83.4
		62	TC	86.9	86.9	98.7	82.8	82.8	96.4	78.2	78.2	92.3	73.6	73.6	86.9
			SHC	69.3	84.0	98.7	67.2	81.8	96.4	64.1	78.2	92.3	60.3	73.6	86.9
		67	TC	94.3	94.3	94.3	90.1	90.1	90.1	85.2	85.2	85.2	79.8	79.8	80.1
			SHC	55.6	70.5	85.4	54.0	68.9	83.9	52.1	67.1	82.2	49.9	65.0	80.1
		72	TC	102.2	102.2	102.2	98.1	98.1	98.1	93.3	93.3	93.3	87.9	87.9	87.9
			SHC	41.2	56.0	70.7	39.7	54.6	69.5	38.0	53.0	68.0	36.0	51.1	66.2
		76	TC	–	108.1	108.1	–	104.2	104.2	–	99.5	99.5	–	94.2	94.2
			SHC	–	44.5	60.2	–	43.2	58.7	–	41.6	57.0	–	39.8	55.2
3375 Cfm	EAT (wb)	58	TC	88.5	88.5	100.4	85.0	85.0	96.4	81.0	81.0	92	76.5	76.5	86.8
			SHC	76.5	88.5	100.4	73.5	85.0	96.4	70.1	81.0	92	66.1	76.5	86.8
		62	TC	88.9	88.9	103.9	85.1	85.1	100.4	81.1	81.1	95.7	76.5	76.5	90.3
			SHC	72.3	88.1	103.9	69.7	85.1	100.4	66.5	81.1	95.7	62.7	76.5	90.3
		67	TC	95.8	95.8	95.8	91.5	91.5	91.5	86.6	86.6	87.9	81.1	81.1	85.8
			SHC	58.0	74.4	90.9	56.4	73.0	89.6	54.6	71.3	87.9	52.4	69.1	85.8
		72	TC	103.6	103.6	103.6	99.4	99.4	99.4	94.6	94.6	94.6	89.1	89.1	89.1
			SHC	42.0	58.3	74.5	40.6	57.0	73.4	38.9	55.5	72.0	37.0	53.7	70.3
		76	TC	–	109.2	109.2	–	105.4	105.4	–	100.7	100.7	–	95.3	95.3
			SHC	–	45.6	62.6	–	44.4	61.3	–	42.8	59.7	–	41.0	58.0
3750 Cfm	EAT (wb)	58	TC	90.8	90.8	103.0	87.3	87.3	99.1	83.3	83.3	94.5	78.8	78.8	89.4
			SHC	78.5	90.8	103.0	75.5	87.3	99.1	72.0	83.3	94.5	68.2	78.8	89.4
		62	TC	90.9	90.9	107.2	87.4	87.4	103.1	83.3	83.3	98.4	78.9	78.9	93.1
			SHC	74.5	90.9	107.2	71.6	87.4	103.1	68.3	83.3	98.4	64.7	78.9	93.1
		67	TC	97.0	97.0	97.0	92.6	92.6	95.1	87.6	87.6	93.4	82.1	82.1	91.2
			SHC	60.3	78.2	96.2	58.8	76.9	95.1	56.9	75.2	93.4	54.8	73.0	91.2
		72	TC	104.7	104.7	104.7	100.5	100.5	100.5	95.6	95.6	95.6	90.1	90.1	90.1
			SHC	42.9	60.5	78.1	41.4	59.3	77.1	39.8	57.8	75.9	37.9	56.1	74.3
		76	TC	–	110.2	110.2	–	106.2	106.2	–	101.6	101.6	–	96.1	96.1
			SHC	–	46.7	64.8	–	45.4	63.6	–	44.0	62.3	–	42.2	60.6

* See Minimum–Maximum Airflow Ratings in Table 4. Do not operate outside these limits.

LEGEND:

- Do not operate in this region
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

50TC 08 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		Air Entering Evaporator – CFM								
		2250/0.05			3000/0.07			3750/0.09		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	103.05	93.02	83.60	109.77	99.52	90.08	114.01	103.69	95.19
	SHC	43.66	55.34	67.09	50.99	66.29	81.31	57.49	76.27	92.20
	kW	4.90	4.83	4.77	4.82	4.88	4.96	4.99	4.91	4.85
85	TC	95.39	85.83	76.88	101.59	91.89	82.95	105.53	95.76	87.77
	SHC	36.42	48.47	60.60	43.24	58.99	74.40	49.44	68.68	84.90
	kW	5.49	5.42	5.36	5.40	5.47	5.54	5.58	5.50	5.44
95	TC	87.48	78.44	69.97	93.21	84.05	75.61	96.84	87.63	80.14
	SHC	28.98	41.46	53.97	35.32	51.53	67.34	41.21	60.92	77.41
	kW	6.16	6.09	6.03	6.08	6.14	6.21	6.24	6.17	6.11
105	TC	79.35	70.83	62.84	84.57	75.96	68.04	87.88	79.23	72.26
	SHC	21.34	34.26	47.18	27.17	43.86	60.08	32.73	52.95	69.70
	kW	6.93	6.86	6.81	6.85	6.91	6.97	7.00	6.93	6.88
115	TC	70.87	62.89	55.42	75.58	67.54	60.15	78.56	70.51	64.06
	SHC	13.40	26.79	40.14	18.70	35.89	52.54	23.94	44.68	61.67
	kW	7.79	7.74	7.69	7.73	7.78	7.83	7.86	7.80	7.76

50TC 08 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator – Cfm								
		2250	3000	3750	2250	3000	3750	2250	3000	3750
80	TC	27.60	32.75	30.19	40.09	39.43	37.73	45.06	45.25	44.25
	SHC	-3.12	5.20	6.71	3.75	5.24	6.75	3.77	5.26	6.78
	kW	4.56	4.51	4.46	4.63	4.60	4.56	4.70	4.67	4.64
75	TC	35.40	33.78	31.20	41.14	40.51	38.80	46.15	46.37	45.38
	SHC	4.67	6.17	7.69	4.71	6.21	7.73	4.74	6.24	7.76
	kW	4.41	4.36	4.39	4.41	4.36	4.36	4.41	4.39	4.36
70	TC	36.36	34.71	32.18	42.10	41.47	39.77	47.08	47.31	46.32
	SHC	5.63	7.14	8.66	5.67	7.18	8.71	5.70	7.21	8.74
	kW	4.43	4.49	4.41	4.44	4.40	4.39	4.49	4.47	4.44
60	TC	38.25	36.64	34.15	43.97	43.37	41.72	48.98	49.22	48.26
	SHC	7.56	9.09	10.62	7.60	9.13	10.66	7.62	9.15	10.69
	kW	4.56	4.55	4.43	4.57	4.53	4.46	4.56	4.55	4.50
50	TC	40.15	38.60	36.14	45.95	45.37	43.73	50.57	50.97	49.56
	SHC	9.48	11.03	12.58	9.52	11.07	12.62	9.54	11.10	12.64
	kW	4.63	4.52	4.38	4.45	4.41	4.33	5.25	4.91	5.60
40	TC	42.18	40.62	38.11	47.80	47.25	45.43	52.65	52.75	51.83
	SHC	11.41	12.98	14.54	11.45	13.02	14.58	11.47	13.04	14.60
	kW	4.32	4.37	4.37	4.65	4.60	4.89	4.96	5.20	5.12

LEGEND

- Edb – Entering Dry–Bulb
- Ewb – Entering Wet–Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry–Bulb
- lwb – Leaving Wet–Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 21 – COOLING CAPACITIES

1-STAGE COOLING

8.5 TONS

50TC–A09 (RTPF)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
2550 Cfm	EAT (wb)	58	TC	88.1	88.1	99.9	84.1	84.1	95.3	79.6	79.6	90.3	74.9	74.9	84.9
		SHC	76.4	88.1	99.9	72.8	84.1	95.3	69.0	79.6	90.3	64.9	74.9	84.9	
		62	TC	93.9	93.9	95.2	88.6	88.6	92.6	82.8	82.8	89.7	76.6	76.6	86.5
		SHC	69.4	82.3	95.2	66.8	79.7	92.6	64.1	76.9	89.7	61.0	73.8	86.5	
		67	TC	103.8	103.8	103.8	98.7	98.7	98.7	93.0	93.0	93.0	86.7	86.7	86.7
		SHC	57.8	70.7	83.6	55.6	68.5	81.4	53.1	66.1	79.0	50.5	63.4	76.4	
		72	TC	113.1	113.1	113.1	108.0	108.0	108.0	102.4	102.4	102.4	96.1	96.1	96.1
		SHC	45.2	58.3	71.3	43.2	56.3	69.3	41.1	54.1	67.1	38.7	51.7	64.7	
		76	TC	–	119.9	119.9	–	114.7	114.7	–	109.0	109.0	–	102.7	102.7
		SHC	–	47.9	61.9	–	46.0	60.1	–	44.1	58.1	–	41.9	55.8	
2975 Cfm	EAT (wb)	58	TC	93.6	93.6	106.1	89.3	89.3	101.2	84.6	84.6	96.0	79.6	79.6	90.3
		SHC	81.1	93.6	106.1	77.4	89.3	101.2	73.3	84.6	96.0	69.0	79.6	90.3	
		62	TC	97.5	97.5	104.3	92.0	92.0	101.4	86.1	86.1	98.3	79.8	79.8	94.1
		SHC	74.7	89.5	104.3	72.0	86.7	101.4	69.1	83.7	98.3	65.6	79.8	94.1	
		67	TC	106.7	106.7	106.7	101.5	101.5	101.5	95.7	95.7	95.7	89.2	89.2	89.2
		SHC	61.0	75.8	90.6	58.8	73.6	88.5	56.4	71.3	86.1	53.8	68.7	83.6	
		72	TC	115.8	115.8	115.8	110.6	110.6	110.6	104.9	104.9	104.9	98.4	98.4	98.4
		SHC	46.5	61.3	76.2	44.5	59.4	74.2	42.3	57.2	72.1	40.0	54.8	69.7	
		76	TC	–	122.4	122.4	–	117.0	117.0	–	111.1	111.1	–	104.5	104.5
		SHC	–	49.8	66.1	–	47.8	63.9	–	45.7	61.6	–	43.4	59.0	
3400 Cfm	EAT (wb)	58	TC	98.1	98.1	111.3	93.7	93.7	106.2	88.9	88.9	100.8	83.7	83.7	94.9
		SHC	85.0	98.1	111.3	81.2	93.7	106.2	77.0	88.9	100.8	72.5	83.7	94.9	
		62	TC	100.0	100.0	112.3	94.9	94.9	108.6	89.1	89.1	104.9	83.8	83.8	98.7
		SHC	79.3	95.8	112.3	76.3	92.5	108.6	73.2	89.1	104.9	68.8	83.8	98.7	
		67	TC	109.0	109.0	109.0	103.6	103.6	103.6	97.6	97.6	97.6	91.0	91.0	91.0
		SHC	63.9	80.5	97.2	61.8	78.5	95.2	59.4	76.1	92.9	56.8	73.5	90.3	
		72	TC	117.9	117.9	117.9	112.5	112.5	112.5	106.6	106.6	106.6	100.0	100.0	100.0
		SHC	47.6	64.1	80.6	45.6	62.1	78.7	43.4	60.0	76.6	41.1	57.6	74.2	
		76	TC	–	124.2	124.2	–	118.6	118.6	–	112.5	112.5	–	105.7	105.7
		SHC	–	51.2	69.0	–	49.2	66.7	–	47.0	64.4	–	44.7	61.9	
3825 Cfm	EAT (wb)	58	TC	101.6	101.6	115.1	97.2	97.2	110.1	92.3	92.3	104.6	87.0	87.0	98.6
		SHC	88.0	101.6	115.1	84.2	97.2	110.1	80.0	92.3	104.6	75.4	87.0	98.6	
		62	TC	101.9	101.9	120.0	97.3	97.3	114.6	92.4	92.4	108.9	87.1	87.1	102.6
		SHC	83.7	101.8	120.0	79.9	97.3	114.6	75.9	92.4	108.9	71.6	87.1	102.6	
		67	TC	110.7	110.7	110.7	105.3	105.3	105.3	99.2	99.2	99.3	92.5	92.5	96.7
		SHC	66.7	85.0	103.4	64.6	83.0	101.5	62.2	80.8	99.3	59.6	78.2	96.7	
		72	TC	119.4	119.4	119.4	114.0	114.0	114.0	108.0	108.0	108.0	101.3	101.3	101.3
		SHC	48.5	66.6	84.6	46.6	64.7	82.7	44.4	62.6	80.7	42.1	60.2	78.4	
		76	TC	–	125.5	125.5	–	119.8	119.8	–	113.6	113.6	–	106.7	106.7
		SHC	–	52.4	71.5	–	50.4	69.3	–	48.2	67.0	–	45.9	64.4	
4250 Cfm	EAT (wb)	58	TC	104.4	104.4	118.3	99.9	99.9	113.2	95.0	95.0	107.6	89.5	89.5	101.5
		SHC	90.4	104.4	118.3	86.6	99.9	113.2	82.3	95.0	107.6	77.6	89.5	101.5	
		62	TC	104.4	104.4	123.0	99.9	99.9	117.8	95.0	95.0	112.0	89.6	89.6	105.6
		SHC	85.8	104.4	123.0	82.1	99.9	117.8	78.1	95.0	112.0	73.6	89.6	105.6	
		67	TC	112.1	112.1	112.1	106.6	106.6	107.5	100.4	100.4	105.3	93.6	93.6	102.7
		SHC	69.2	89.2	109.2	67.2	87.3	107.5	64.9	85.1	105.3	62.3	82.5	102.7	
		72	TC	120.7	120.7	120.7	115.1	115.1	115.1	109.0	109.0	109.0	102.2	102.2	102.2
		SHC	49.4	68.9	88.4	47.4	67.0	86.5	45.3	64.9	84.6	42.9	62.6	82.3	
		76	TC	–	126.6	126.6	–	120.8	120.8	–	114.5	114.5	–	107.4	107.4
		SHC	–	53.5	73.9	–	51.5	71.7	–	49.3	69.4	–	46.9	66.8	

LEGEND:

- Do not operate in this region
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

Table 22 – COOLING CAPACITIES

2-STAGE COOLING

8.5 TONS

50TC–D09 (RTPF)				AMBIENT TEMPERATURE											
				85			95			105			115		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85
2550 Cfm	EAT (wb)	58	TC	89.7	89.7	101.6	85.2	85.2	96.5	79.6	79.6	90.1	73.8	73.8	83.6
			SHC	77.8	89.7	101.6	73.9	85.2	96.5	69.0	79.6	90.1	64.0	73.8	83.6
		62	TC	94.3	94.3	97.9	88.7	88.7	95.2	81.3	81.3	91.5	74.3	74.3	86.5
			SHC	71.0	84.4	97.9	68.2	81.7	95.2	64.7	78.1	91.5	60.6	73.6	86.5
		67	TC	105.0	105.0	105.0	99.3	99.3	99.3	92.2	92.2	92.2	84.1	84.1	84.1
			SHC	59.0	72.6	86.1	56.6	70.1	83.7	53.6	67.1	80.7	50.3	63.8	77.3
		72	TC	115.9	115.9	115.9	110.4	110.4	110.4	104.2	104.2	104.2	96.0	96.0	96.0
			SHC	46.4	60.0	73.6	44.3	57.9	71.5	41.9	55.5	69.1	38.8	52.4	65.9
		76	TC	–	123.7	123.7	–	118.3	118.3	–	112.4	112.4	–	105.7	105.7
			SHC	–	49.3	63.3	–	47.3	61.4	–	45.3	59.3	–	42.9	56.7
2975 Cfm	EAT (wb)	58	TC	95.3	95.3	107.9	90.7	90.7	102.7	84.8	84.8	96.1	78.7	78.7	89.1
			SHC	82.6	95.3	107.9	78.6	90.7	102.7	73.5	84.8	96.1	68.2	78.7	89.1
		62	TC	97.9	97.9	107.8	92.1	92.1	104.7	85.4	85.4	99.4	78.8	78.8	92.8
			SHC	76.7	92.2	107.8	73.9	89.3	104.7	69.6	84.5	99.4	64.8	78.8	92.8
		67	TC	108.5	108.5	108.5	102.6	102.6	102.6	95.4	95.4	95.4	86.9	86.9	86.9
			SHC	62.8	78.4	94.1	60.4	76.0	91.7	57.4	73.1	88.8	54.0	69.7	85.3
		72	TC	119.1	119.1	119.1	113.5	113.5	113.5	107.2	107.2	107.2	99.2	99.2	99.2
			SHC	47.9	63.5	79.2	45.8	61.5	77.1	43.5	59.2	74.9	40.6	56.3	72.0
		76	TC	–	126.4	126.4	–	120.8	120.8	–	114.8	114.8	–	108.2	108.2
			SHC	–	51.1	67.4	–	49.2	65.3	–	47.0	63.0	–	44.8	60.7
3400 Cfm	EAT (wb)	58	TC	100.0	100.0	113.3	95.2	95.2	107.9	89.3	89.3	101.1	82.9	82.9	93.9
			SHC	86.7	100.0	113.3	82.6	95.2	107.9	77.4	89.3	101.1	71.8	82.9	93.9
		62	TC	101.1	101.1	115.8	95.7	95.7	111.7	89.4	89.4	105.3	83.0	83.0	97.7
			SHC	81.5	98.7	115.8	78.2	94.9	111.7	73.5	89.4	105.3	68.2	83.0	97.7
		67	TC	111.1	111.1	111.1	105.1	105.1	105.1	97.8	97.8	97.8	89.1	89.1	93.0
			SHC	66.2	83.9	101.6	63.9	81.6	99.3	61.0	78.7	96.5	57.5	75.3	93.0
		72	TC	121.3	121.3	121.3	115.6	115.6	115.6	109.4	109.4	109.4	101.5	101.5	101.5
			SHC	49.2	66.7	84.3	47.1	64.7	82.3	44.9	62.5	80.2	42.1	59.9	77.7
		76	TC	–	128.3	128.3	–	122.6	122.6	–	116.3	116.3	–	109.7	109.7
			SHC	–	52.7	70.7	–	50.7	68.6	–	48.6	66.4	–	46.4	64.2
3825 Cfm	EAT (wb)	58	TC	104.0	104.0	117.8	99.1	99.1	112.3	93.2	93.2	105.5	86.5	86.5	97.9
			SHC	90.2	104.0	117.8	86.0	99.1	112.3	80.8	93.2	105.5	75.0	86.5	97.9
		62	TC	104.2	104.2	122.7	99.3	99.3	116.9	93.3	93.3	109.8	86.6	86.6	101.9
			SHC	85.7	104.2	122.7	81.7	99.3	116.9	76.7	93.3	109.8	71.2	86.6	101.9
		67	TC	113.1	113.1	113.1	107.1	107.1	107.1	99.9	99.9	103.8	91.0	91.0	100.3
			SHC	69.4	89.1	108.8	67.1	86.8	106.5	64.3	84.1	103.8	60.9	80.6	100.3
		72	TC	123.0	123.0	123.0	117.2	117.2	117.2	110.9	110.9	110.9	103.3	103.3	103.3
			SHC	50.3	69.7	89.0	48.3	67.7	87.1	46.1	65.6	85.2	43.5	63.3	83.0
		76	TC	–	129.7	129.7	–	124.0	124.0	–	117.5	117.5	–	110.8	110.8
			SHC	–	54.0	73.7	–	52.1	71.7	–	50.0	69.5	–	47.8	67.4
4250 Cfm	EAT (wb)	58	TC	107.4	107.4	121.7	102.5	102.5	116.1	96.5	96.5	109.3	89.5	89.5	101.4
			SHC	93.1	107.4	121.7	88.9	102.5	116.1	83.7	96.5	109.3	77.6	89.5	101.4
		62	TC	107.5	107.5	126.6	102.6	102.6	120.8	96.6	96.6	113.7	89.6	89.6	105.5
			SHC	88.4	107.5	126.6	84.4	102.6	120.8	79.5	96.6	113.7	73.7	89.6	105.5
		67	TC	114.7	114.7	115.6	108.7	108.7	113.5	101.7	101.7	110.8	92.6	92.6	107.2
			SHC	72.5	94.0	115.6	70.2	91.8	113.5	67.5	89.2	110.8	64.0	85.6	107.2
		72	TC	124.3	124.3	124.3	118.5	118.5	118.5	112.1	112.1	112.1	104.7	104.7	104.7
			SHC	51.3	72.4	93.4	49.3	70.5	91.7	47.2	68.5	89.9	44.7	66.4	88.1
		76	TC	–	130.7	130.7	–	125.0	125.0	–	118.5	118.5	–	111.6	111.6
			SHC	–	55.3	76.5	–	53.5	74.6	–	51.3	72.4	–	49.2	70.3

* See Minimum–Maximum Airflow Ratings in Table 4. Do not operate outside these limits.

LEGEND:

- Do not operate in this region
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

Table 23 – COOLING CAPACITIES

2-STAGE COOLING

8.5 TONS

50TC 09 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – CFM								
		2550/0.04			3400/0.05			4250/0.07		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	119.20	107.44	96.41	126.95	114.98	103.92	131.87	119.81	109.54
	SHC	50.63	63.94	77.40	59.17	76.72	94.21	66.80	88.44	108.22
	kW	5.67	5.57	5.47	5.54	5.63	5.74	5.79	5.68	5.59
85	TC	110.40	99.22	88.76	117.63	106.26	95.77	122.21	110.77	101.07
	SHC	42.39	56.16	70.07	50.42	68.45	86.38	57.71	79.86	99.95
	kW	6.33	6.23	6.14	6.20	6.30	6.40	6.45	6.34	6.25
95	TC	101.37	90.79	80.86	108.07	97.31	87.39	112.29	101.47	92.38
	SHC	33.97	48.22	62.56	41.46	60.01	78.39	48.40	71.09	91.47
	kW	7.08	6.99	6.90	6.96	7.05	7.16	7.20	7.09	7.01
105	TC	92.04	82.06	72.71	98.19	88.05	78.72	102.07	91.86	83.40
	SHC	25.31	40.06	54.88	32.24	51.33	70.17	38.85	62.06	82.67
	kW	7.94	7.85	7.77	7.83	7.91	8.01	8.06	7.95	7.87
115	TC	82.37	73.01	64.24	87.95	78.45	69.73	91.46	81.90	74.09
	SHC	16.38	31.65	46.95	22.71	42.37	61.69	28.94	52.74	73.52
	kW	8.92	8.84	8.77	8.82	8.89	8.98	9.02	8.93	8.86

50TC 09 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator – Cfm								
		2550	3400	4250	2550	3400	4250	2550	3400	4250
80	TC	37.61	33.13	26.77	44.74	41.60	36.46	50.96	48.99	44.93
	SHC	-0.52	-0.63	-0.73	-0.46	-0.57	-0.67	-0.42	-0.53	-0.62
	kW	5.88	5.68	5.44	6.13	5.97	5.76	6.35	6.24	6.06
75	TC	38.71	34.24	27.86	45.84	42.73	37.59	52.05	50.11	46.06
	SHC	0.45	0.34	0.25	0.50	0.40	0.31	0.54	0.44	0.36
	kW	5.68	5.47	5.22	5.94	5.78	5.56	6.18	6.07	5.88
70	TC	39.70	35.25	28.83	46.80	43.70	38.59	52.97	51.04	47.02
	SHC	1.41	1.32	1.23	1.47	1.37	1.29	1.50	1.41	1.34
	kW	5.65	5.42	5.24	5.97	5.79	5.53	6.26	6.13	5.91
60	TC	41.77	37.33	30.76	48.86	45.80	40.71	55.00	53.10	49.12
	SHC	3.34	3.26	3.18	3.40	3.32	3.25	3.43	3.36	3.29
	kW	5.42	5.15	5.17	5.80	5.59	5.30	6.16	6.01	5.75
50	TC	43.83	39.27	32.61	50.92	47.89	42.70	57.04	55.16	51.22
	SHC	5.27	5.21	5.14	5.32	5.27	5.21	5.36	5.31	5.25
	kW	5.18	5.15	5.17	5.62	5.39	5.05	6.04	5.87	5.59
40	TC	45.75	41.13	34.50	53.08	50.00	44.64	59.24	57.40	53.44
	SHC	7.20	7.15	6.95	7.26	7.21	7.16	7.29	7.25	7.21
	kW	4.79	4.98	4.80	5.25	5.01	5.23	5.68	5.51	5.21

LEGEND

- Edb – Entering Dry–Bulb
- Ewb – Entering Wet–Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry–Bulb
- lwb – Leaving Wet–Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

$$t_{lwb} = \text{Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (} h_{lwb} \text{)}$$

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$
 Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 24 – COOLING CAPACITIES

1-STAGE COOLING

10 TONS

50TC–A12 (RTPF)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
3000 Cfm	EAT (wb)	58	TC	106.3	106.3	120.5	101.7	101.7	115.2	96.6	96.6	109.4	91.0	91.0	103.1
			SHC	92.2	106.3	120.5	88.2	101.7	115.2	83.8	96.6	109.4	78.9	91.0	103.1
		62	TC	112.5	112.5	115.2	106.5	106.5	112.3	99.9	99.9	109.0	92.7	92.7	105.2
			SHC	83.8	99.5	115.2	81.0	96.6	112.3	77.8	93.4	109.0	74.2	89.7	105.2
		67	TC	123.5	123.5	123.5	117.8	117.8	117.8	111.3	111.3	111.3	104.0	104.0	104.0
			SHC	69.2	85.0	100.7	66.8	82.5	98.3	64.1	79.8	95.5	61.0	76.8	92.5
		72	TC	134.3	134.3	134.3	128.5	128.5	128.5	122.0	122.0	122.0	114.7	114.7	114.7
			SHC	53.8	69.6	85.5	51.6	67.4	83.2	49.1	64.9	80.7	46.3	62.1	77.9
		76	TC	–	142.4	142.4	–	136.3	136.3	–	129.5	129.5	–	121.8	121.8
			SHC	–	56.8	73.3	–	54.7	71.2	–	52.3	68.8	–	49.7	66.2
3500 Cfm	EAT (wb)	58	TC	112.9	112.9	127.8	108.0	108.0	122.3	102.7	102.7	116.3	96.8	96.8	109.7
			SHC	97.9	112.9	127.8	93.6	108.0	122.3	89.0	102.7	116.3	83.9	96.8	109.7
		62	TC	116.3	116.3	126.2	110.5	110.5	123.3	103.8	103.8	119.5	97.1	97.1	114.3
			SHC	90.2	108.2	126.2	87.4	105.3	123.3	84.0	101.8	119.5	79.8	97.1	114.3
		67	TC	126.9	126.9	126.9	120.9	120.9	120.9	114.3	114.3	114.3	106.8	106.8	106.8
			SHC	73.2	91.3	109.4	70.8	88.9	107.1	68.1	86.2	104.4	65.0	83.2	101.3
		72	TC	137.5	137.5	137.5	131.4	131.4	131.4	124.7	124.7	124.7	117.2	117.2	117.2
			SHC	55.3	73.4	91.5	53.1	71.1	89.2	50.6	68.7	86.7	47.8	65.9	83.9
		76	TC	–	145.1	145.1	–	138.8	138.8	–	131.7	131.7	–	123.6	123.6
			SHC	–	59.0	78.2	–	56.7	75.8	–	54.3	73.1	–	51.5	70.0
4000 Cfm	EAT (wb)	58	TC	117.8	117.8	133.5	113.0	113.0	128.0	107.5	107.5	121.8	101.5	101.5	115.0
			SHC	102.2	117.8	133.5	98.0	113.0	128.0	93.3	107.5	121.8	88.0	101.5	115.0
		62	TC	119.1	119.1	136.0	113.5	113.5	132.5	107.7	107.7	126.7	101.6	101.6	119.6
			SHC	95.8	115.9	136.0	92.8	112.6	132.5	88.6	107.7	126.7	83.6	101.6	119.6
		67	TC	129.4	129.4	129.4	123.3	123.3	123.3	116.5	116.5	116.5	108.9	108.9	109.8
			SHC	76.9	97.3	117.7	74.5	95.0	115.4	71.8	92.3	112.8	68.8	89.3	109.8
		72	TC	139.7	139.7	139.7	133.5	133.5	133.5	126.6	126.6	126.6	118.8	118.8	118.8
			SHC	56.7	76.8	97.0	54.4	74.6	94.7	51.9	72.1	92.3	49.1	69.3	89.5
		76	TC	–	147.0	147.0	–	140.5	140.5	–	133.2	133.2	–	124.9	124.9
			SHC	–	60.6	81.7	–	58.4	79.3	–	55.8	76.5	–	53.0	73.5
4500 Cfm	EAT (wb)	58	TC	121.7	121.7	137.9	116.8	116.8	132.3	111.2	111.2	126.0	105.0	105.0	118.9
			SHC	105.6	121.7	137.9	101.3	116.8	132.3	96.4	111.2	126.0	91.0	105.0	118.9
		62	TC	121.8	121.8	143.4	116.9	116.9	137.6	111.3	111.3	131.0	105.1	105.1	123.7
			SHC	100.2	121.8	143.4	96.1	116.9	137.6	91.6	111.3	131.0	86.5	105.1	123.7
		67	TC	131.3	131.3	131.3	125.1	125.1	125.1	118.2	118.2	120.8	110.5	110.5	117.7
			SHC	80.3	102.9	125.5	78.0	100.7	123.3	75.3	98.0	120.8	72.3	95.0	117.7
		72	TC	141.5	141.5	141.5	135.1	135.1	135.1	128.0	128.0	128.0	120.1	120.1	120.1
			SHC	57.9	80.0	102.1	55.6	77.7	99.9	53.1	75.2	97.4	50.3	72.4	94.6
		76	TC	–	148.3	148.3	–	141.8	141.8	–	134.3	134.3	–	125.8	125.8
			SHC	–	62.1	84.9	–	59.8	82.5	–	57.3	79.7	–	54.4	76.6
5000 Cfm	EAT (wb)	58	TC	125.0	125.0	141.6	120.0	120.0	135.9	114.3	114.3	129.5	107.9	107.9	122.3
			SHC	108.4	125.0	141.6	104.0	120.0	135.9	99.1	114.3	129.5	93.6	107.9	122.3
		62	TC	125.1	125.1	147.2	120.1	120.1	141.4	114.4	114.4	134.7	108.0	108.0	127.2
			SHC	102.9	125.1	147.2	98.8	120.1	141.4	94.1	114.4	134.7	88.9	108.0	127.2
		67	TC	132.8	132.8	133.0	126.5	126.5	130.8	119.6	119.6	128.2	111.8	111.8	125.1
			SHC	83.6	108.3	133.0	81.2	106.0	130.8	78.6	103.4	128.2	75.6	100.3	125.1
		72	TC	142.8	142.8	142.8	136.3	136.3	136.3	129.1	129.1	129.1	121.1	121.1	121.1
			SHC	59.0	82.9	106.9	56.7	80.7	104.7	54.1	78.2	102.2	51.3	75.4	99.4
		76	TC	–	149.4	149.4	–	142.8	142.8	–	135.1	135.1	–	126.5	126.5
			SHC	–	63.4	87.9	–	61.2	85.5	–	58.6	82.7	–	55.6	79.4

LEGEND:

- Do not operate in this region
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

Table 25 – COOLING CAPACITIES

2-STAGE COOLING

10 TONS

50TC–D12 (RTPF & Novation)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
3000 Cfm	EAT (wb)	58	TC	107.6	107.6	121.9	102.5	102.5	116.2	96.8	96.8	109.7	90.5	90.5	102.6
			SHC	93.2	107.6	121.9	88.8	102.5	116.2	83.9	96.8	109.7	78.4	90.5	102.6
		62	TC	113.6	113.6	116.5	107.1	107.1	113.4	99.7	99.7	109.8	91.8	91.8	104.9
			SHC	84.6	100.6	116.5	81.5	97.4	113.4	78.0	93.9	109.8	73.7	89.3	104.9
		67	TC	124.4	124.4	124.4	118.4	118.4	118.4	111.5	111.5	111.5	103.3	103.3	103.3
			SHC	69.7	85.7	101.7	67.1	83.2	99.2	64.3	80.3	96.3	60.8	76.8	92.8
		72	TC	135.8	135.8	135.8	129.7	129.7	129.7	122.8	122.8	122.8	115	115	115
			SHC	54.3	70.4	86.6	52.0	68.1	84.2	49.3	65.4	81.6	46.4	62.5	78.6
		76	TC	–	145.3	145.3	–	139	139	–	131.9	131.9	–	124.1	124.1
			SHC	–	57.8	74.3	–	55.6	72.1	–	53.1	69.6	–	50.4	66.9
3500 Cfm	EAT (wb)	58	TC	114.2	114.2	129.4	108.9	108.9	123.4	102.9	102.9	116.6	96.3	96.3	109.1
			SHC	98.9	114.2	129.4	94.3	108.9	123.4	89.1	102.9	116.6	83.4	96.3	109.1
		62	TC	117.2	117.2	127.9	111.0	111.0	124.7	104.0	104.0	119.5	96.5	96.5	113.7
			SHC	91.1	109.5	127.9	88.1	106.4	124.7	83.9	101.7	119.5	79.3	96.5	113.7
		67	TC	127.8	127.8	127.8	121.7	121.7	121.7	114.5	114.5	114.5	106.6	106.6	106.6
			SHC	73.8	92.3	110.8	71.3	89.8	108.3	68.4	87.0	105.5	65.2	83.8	102.3
		72	TC	139.4	139.4	139.4	133.0	133.0	133	125.8	125.8	125.8	117.9	117.9	117.9
			SHC	56.0	74.6	93.1	53.7	72.2	90.8	51.0	69.6	88.2	48.1	66.7	85.4
		76	TC	–	148.8	148.8	–	142.2	142.2	–	134.9	134.9	–	126.8	126.8
			SHC	–	60.2	79.5	–	58.0	77.1	–	55.4	74.5	–	52.7	71.6
4000 Cfm	EAT (wb)	58	TC	119.0	119.0	134.9	114.0	114.0	129.2	108.0	108.0	122.4	101.1	101.1	114.6
			SHC	103.1	119.0	134.9	98.7	114.0	129.2	93.6	108.0	122.4	87.6	101.1	114.6
		62	TC	120.3	120.3	137.1	114.7	114.7	132.8	108.2	108.2	127.5	101.3	101.3	119.3
			SHC	96.5	116.8	137.1	93.0	112.9	132.8	88.9	108.2	127.5	83.2	101.3	119.3
		67	TC	130.5	130.5	130.5	124.1	124.1	124.1	116.8	116.8	116.8	108.7	108.7	111.1
			SHC	77.7	98.6	119.5	75.2	96.2	117.2	72.3	93.3	114.4	69.1	90.1	111.1
		72	TC	142.1	142.1	142.1	135.5	135.5	135.5	128.2	128.2	128.2	120.0	120.0	120.0
			SHC	57.6	78.4	99.3	55.2	76.1	97.1	52.5	73.6	94.6	49.7	70.7	91.8
		76	TC	–	151.4	151.4	–	144.7	144.7	–	137.1	137.1	–	–	–
			SHC	–	62.3	83.8	–	60.0	81.4	–	57.5	78.8	–	–	–
4500 Cfm	EAT (wb)	58	TC	123.0	123.0	139.5	117.8	117.8	133.6	111.9	111.9	126.9	105.3	105.3	119.3
			SHC	106.6	123.0	139.5	102.1	117.8	133.6	97.0	111.9	126.9	91.2	105.3	119.3
		62	TC	123.4	123.4	144.4	117.9	117.9	139.0	112.0	112.0	132.0	105.4	105.4	124.2
			SHC	100.9	122.7	144.4	96.9	117.9	139	92.1	112.0	132	86.6	105.4	124.2
		67	TC	132.6	132.6	132.6	126.0	126	126.0	118.7	118.7	122.9	110.4	110.4	119.6
			SHC	81.4	104.6	127.9	78.9	102.3	125.7	76.1	99.5	122.9	72.9	96.2	119.6
		72	TC	144.2	144.2	144.2	137.4	137.4	137.4	129.9	129.9	129.9	121.6	121.6	121.6
			SHC	59.0	82.1	105.2	56.6	79.8	103.1	54.0	77.3	100.7	51.1	74.5	98
		76	TC	–	153.4	153.4	–	146.6	146.6	–	138.9	138.9	–	–	–
			SHC	–	64.1	87.8	–	61.9	85.6	–	59.4	83	–	–	–
5000 Cfm	EAT (wb)	58	TC	126.5	126.5	143.3	121.2	121.2	137.4	115.1	115.1	130.5	108.4	108.4	122.8
			SHC	109.6	126.5	143.3	105.0	121.2	137.4	99.8	115.1	130.5	93.9	108.4	122.8
		62	TC	126.5	126.5	149.1	121.3	121.3	142.9	115.2	115.2	135.8	108.5	108.5	127.8
			SHC	104.0	126.5	149.1	99.7	121.3	142.9	94.7	115.2	135.8	89.1	108.5	127.8
		67	TC	134.2	134.2	135.9	127.5	127.5	133.8	120.1	120.1	131.0	111.9	111.9	127.6
			SHC	84.9	110.4	135.9	82.4	108.1	133.8	79.6	105.3	131	76.4	102.0	127.6
		72	TC	145.8	145.8	145.8	139.0	139.0	139.0	131.3	131.3	131.3	122.9	122.9	122.9
			SHC	60.3	85.6	110.8	57.9	83.4	108.9	55.3	81.0	106.6	52.5	78.2	104
		76	TC	–	155.1	155.1	–	148.2	148.2	–	–	–	–	–	–
			SHC	–	65.9	91.5	–	63.7	89.5	–	–	–	–	–	–

* See Minimum–Maximum Airflow Ratings in Table 4. Do not operate outside these limits.

LEGEND:

- Do not operate in this region
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

50TC 12 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – CFM								
		3000/0.04			4000/0.06			5000/0.07		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	142.85	129.44	116.93	152.09	138.44	125.76	157.99	144.23	132.06
	SHC	58.38	74.88	91.58	67.96	89.45	111.02	76.63	102.94	127.93
	kW	7.19	6.97	6.79	6.92	7.12	7.35	7.45	7.22	7.02
85	TC	132.33	119.68	107.86	140.92	128.03	116.10	146.41	133.41	121.98
	SHC	48.44	65.56	82.83	57.37	79.50	101.68	65.65	92.58	118.12
	kW	7.98	7.77	7.58	7.72	7.92	8.14	8.25	8.01	7.82
95	TC	121.41	109.52	98.43	129.35	117.22	106.04	134.43	122.20	111.50
	SHC	38.19	55.92	73.78	46.47	69.22	92.01	54.34	81.92	107.96
	kW	8.87	8.66	8.48	8.61	8.80	9.03	9.14	8.90	8.71
105	TC	110.04	98.92	88.56	117.27	105.94	95.53	121.88	110.46	100.54
	SHC	27.59	45.94	64.39	35.16	58.57	81.98	42.56	70.82	97.40
	kW	9.86	9.66	9.48	9.61	9.79	10.02	10.12	9.89	9.70
115	TC	98.09	87.74	78.13	104.62	94.08	84.45	108.76	98.13	89.01
	SHC	16.52	35.47	54.53	23.37	47.44	71.46	30.32	59.25	86.31
	kW	10.95	10.76	10.60	10.72	10.89	11.10	11.19	10.98	10.81

50TC 12 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator – Cfm								
		3000	4000	5000	3000	4000	5000	3000	4000	5000
80	TC	44.78	39.41	31.89	53.22	49.44	43.38	60.56	58.12	53.32
	SHC	-0.44	-0.57	-0.69	-0.37	-0.51	-0.61	-0.33	-0.46	-0.56
	kW	6.96	6.77	6.52	7.26	7.13	6.91	7.54	7.45	7.27
75	TC	45.84	40.46	32.86	54.28	50.51	44.45	61.61	59.19	54.40
	SHC	0.53	0.40	0.29	0.60	0.47	0.37	0.64	0.52	0.42
	kW	6.77	6.56	6.29	7.11	6.95	6.72	7.41	7.31	7.12
70	TC	46.91	41.48	33.50	55.36	51.59	45.50	62.69	60.28	55.49
	SHC	1.51	1.38	1.27	1.57	1.45	1.35	1.61	1.50	1.40
	kW	6.54	6.32	6.02	6.90	6.74	6.49	7.23	7.13	6.92
60	TC	48.88	43.42	35.76	57.29	53.56	47.48	64.56	62.16	57.42
	SHC	3.44	3.34	3.24	3.51	3.40	3.31	3.55	3.45	3.37
	kW	6.45	6.16	6.70	6.93	6.72	6.39	7.38	7.24	6.96
50	TC	50.83	45.28	37.67	59.22	55.52	49.43	66.05	64.03	59.34
	SHC	5.38	5.29	5.20	5.45	5.36	5.28	5.48	5.40	5.33
	kW	6.46	6.01	6.34	6.98	6.71	6.29	8.15	7.38	7.02
40	TC	52.82	47.29	39.50	61.14	57.48	51.39	68.23	65.88	61.25
	SHC	7.32	7.24	7.20	7.38	7.31	7.24	7.43	7.36	7.29
	kW	6.29	6.09	6.12	7.05	6.72	6.29	7.78	7.55	7.10

LEGEND

- Edb – Entering Dry–Bulb
- Ewb – Entering Wet–Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry–Bulb
- lwb – Leaving Wet–Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 27 – COOLING CAPACITIES

2-STAGE COOLING

12.5 TONS

50TC-D14 (RTPF & Novation)			AMBIENT TEMPERATURE												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
3600 Cfm	EAT (wb)	58	TC	127.6	127.6	142.9	121.7	121.7	137.6	115.0	115.0	130	108.3	108.3	122.6
			SHC	110.3	126.6	142.9	105.8	121.7	137.6	99.9	115.0	130	94.1	108.3	122.6
		62	TC	136.1	136.1	136.1	131.1	131.1	131.1	123.8	123.8	124.5	114.9	114.9	120.3
			SHC	96.6	112.8	129.0	94.7	111.2	127.7	91.4	108.0	124.5	87.3	103.8	120.3
		67	TC	146.2	146.2	146.2	142.0	142.0	142.0	136.2	136.2	136.2	128.8	128.8	128.8
			SHC	78.5	94.4	110.3	76.9	93.1	109.2	74.7	91.0	107.3	71.7	88.1	104.6
		72	TC	155.9	155.9	155.9	152.4	152.4	152.4	147.2	147.2	147.2	140.1	140.1	140.1
			SHC	60.1	76.6	93.2	58.7	75.2	91.7	56.8	73.3	89.7	54.2	70.6	87.0
		76	TC	-	163.0	163	-	160.0	160	-	155.1	155.1	-	148.2	148.2
			SHC	-	62.0	81.8	-	61.1	80.9	-	59.5	79.3	-	57.0	76.3
4200 Cfm	EAT (wb)	58	TC	132.2	132.2	149.5	128.2	128.2	144.9	121.9	121.9	137.8	115.0	115.0	130.1
			SHC	115.0	132.2	149.5	111.5	128.2	144.9	106.0	121.9	137.8	99.9	115.0	130.1
		62	TC	139.6	139.6	139.6	134.7	134.7	138	128.0	128.0	135.6	119.1	119.1	131.2
			SHC	102.5	120.8	139	100.8	119.4	138	98.1	116.8	135.6	93.9	112.6	131.2
		67	TC	149.5	149.5	149.5	145.4	145.4	145.4	139.6	139.6	139.6	132.1	132.1	132.1
			SHC	81.8	99.6	117.4	80.6	98.7	116.8	78.5	96.9	115.2	75.7	94.3	112.8
		72	TC	159.0	159.0	159.0	155.5	155.5	155.5	150.3	150.3	150.3	143.1	143.1	143.1
			SHC	61.4	79.6	97.8	60.2	78.5	96.8	58.3	76.7	95	55.8	74.2	92.5
		76	TC	-	165.7	165.7	-	162.8	162.8	-	157.8	157.8	-	150.8	150.8
			SHC	-	64.6	87.7	-	63.5	86.3	-	61.5	83.3	-	58.9	79.9
4800 Cfm	EAT (wb)	58	TC	136.7	136.7	154.5	133.0	133.0	150.3	127.7	127.7	144.3	120.6	120.6	136.4
			SHC	118.9	136.7	154.5	115.7	133.0	150.3	111.0	127.7	144.3	104.9	120.6	136.4
		62	TC	142.2	142.2	147.8	137.4	137.4	147.1	131.0	131.0	144.7	122.8	122.8	140.3
			SHC	107.7	127.8	147.8	106.2	126.7	147.1	103.6	124.2	144.7	99.3	119.8	140.3
		67	TC	152.1	152.1	152.1	148.0	148	148	142.2	142.2	142.2	134.6	134.6	134.6
			SHC	84.8	104.3	123.7	83.8	103.8	123.7	82.0	102.3	122.6	79.4	99.9	120.4
		72	TC	161.3	161.3	161.3	157.8	157.8	157.8	152.5	152.5	152.5	145.4	145.4	145.4
			SHC	62.6	82.2	101.9	61.4	81.4	101.3	59.7	79.7	99.8	57.2	77.3	97.5
		76	TC	-	167.7	167.7	-	164.9	164.9	-	159.9	159.9	-	152.8	152.8
			SHC	-	66.4	91.4	-	65	89.2	-	63.1	86.4	-	60.5	83.1
5400 Cfm	EAT (wb)	58	TC	140.5	140.5	158.8	136.9	136.9	154.7	131.8	131.8	149	125.2	125.2	141.6
			SHC	122.2	140.5	158.8	119	136.9	154.7	114.7	131.8	149	108.9	125.2	141.6
		62	TC	144.3	144.3	155.7	139.6	139.6	155	133.5	133.5	152.4	125.8	125.8	147.8
			SHC	112.2	133.9	155.7	110.9	132.9	155	108.1	130.2	152.4	103.9	125.8	147.8
		67	TC	154.2	154.2	154.2	150.0	150.0	150.0	144.2	144.2	144.2	136.7	136.7	136.7
			SHC	87.6	108.6	129.6	86.8	108.5	130.1	85.2	107.3	129.4	82.8	105.1	127.4
		72	TC	163.1	163.1	163.1	159.7	159.7	159.7	154.3	154.3	154.3	147.1	147.1	147.1
			SHC	63.6	84.6	105.6	62.5	83.9	105.4	60.8	82.5	104.2	58.4	80.2	102
		76	TC	-	169.3	169.3	-	166.5	166.5	-	161.5	161.5	-	154.2	154.2
			SHC	-	67.6	93.7	-	66.4	91.7	-	64.5	89.2	-	61.9	86.1
6000 Cfm	EAT (wb)	58	TC	143.6	143.6	162.3	140.1	140.1	158.3	135.1	135.1	152.7	128.7	128.7	145.5
			SHC	124.9	143.6	162.3	121.8	140.1	158.3	117.5	135.1	152.7	111.9	128.7	145.5
		62	TC	146.1	146.1	162.4	141.7	141.7	161.5	135.6	135.6	159.2	128.8	128.8	151.2
			SHC	116.1	139.3	162.4	114.7	138.1	161.5	112.1	135.6	159.2	106.4	128.8	151.2
		67	TC	155.8	155.8	155.8	151.6	151.6	151.6	145.9	145.9	145.9	138.3	138.3	138.3
			SHC	90.1	112.6	135	89.6	112.8	136	88.3	112.0	135.8	85.9	110.0	134.1
		72	TC	164.5	164.5	164.5	161.2	161.2	161.2	155.8	155.8	155.8	148.5	148.5	148.5
			SHC	64.5	86.7	108.9	63.5	86.3	109.1	61.9	85.1	108.2	59.6	82.9	106.3
		76	TC	-	170.6	170.6	-	167.8	167.8	-	162.8	162.8	-	155.5	155.5
			SHC	-	68.7	95.8	-	67.5	94.1	-	65.7	91.8	-	63.3	88.8

* See Minimum-Maximum Airflow Ratings in Table 4. Do not operate outside these limits.

LEGEND:

- Do not operate in this region
- Cfm - Cubic feet per minute (supply air)
- EAT(db) - Entering air temperature (dry bulb)
- EAT(wb) - Entering air temperature (wet bulb)
- SHC - Sensible heat capacity
- TC - Total capacity

50TC 14 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN SUBCOOLING MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – CFM								
		3750/0.02			5000/0.06			6250/0.05		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	183.66	166.86	151.43	194.90	177.83	162.05	201.97	184.84	170.53
	SHC	79.39	100.52	121.91	91.70	119.42	147.05	102.94	137.00	166.71
	kW	9.82	9.63	9.46	9.58	9.76	9.96	10.04	9.84	9.67
85	TC	172.71	156.78	142.09	183.32	167.13	152.17	189.98	173.73	160.25
	SHC	69.03	90.92	112.95	80.69	109.17	137.51	91.49	126.33	156.65
	kW	10.82	10.63	10.45	10.57	10.76	10.96	11.04	10.84	10.67
95	TC	161.37	146.24	132.38	171.36	156.04	141.86	177.62	162.22	149.50
	SHC	58.44	81.04	103.77	69.42	98.67	127.71	79.83	115.45	146.15
	kW	11.92	11.73	11.56	11.68	11.86	12.05	12.14	11.93	11.77
105	TC	149.57	135.32	122.21	158.89	144.45	131.10	164.74	150.27	138.35
	SHC	47.57	70.92	94.32	57.85	87.91	117.61	67.79	104.26	135.30
	kW	13.12	12.94	12.77	12.89	13.06	13.24	13.32	13.13	12.97
115	TC	137.22	123.88	111.55	145.85	132.33	119.84	151.27	137.71	126.67
	SHC	36.31	60.47	84.57	45.87	76.77	107.19	55.34	92.66	123.98
	kW	14.41	14.25	14.10	14.20	14.35	14.53	14.59	14.42	14.28

50TC 14 COOLING CAPACITIES, RTPF UNIT WITH HUMIDI-MIZER SYSTEM IN HOT GAS REHEAT MODE										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator – Cfm								
		3750	5000	6250	3750	5000	6250	3750	5000	6250
80	TC	52.42	45.88	36.99	62.64	58.07	51.07	71.56	68.64	63.23
	SHC	-0.39	-0.54	-0.67	-0.31	-0.46	-0.58	-0.26	-0.40	-0.52
	kW	9.65	9.39	9.07	9.97	9.77	9.50	10.25	10.11	9.89
75	TC	53.45	46.63	36.10	63.77	59.11	51.87	72.76	69.80	64.31
	SHC	0.59	0.44	0.30	0.67	0.52	0.40	0.72	0.58	0.47
	kW	9.09	8.83	8.49	9.39	9.20	8.94	9.67	9.53	9.32
70	TC	54.33	46.91	37.58	64.77	60.01	52.30	73.80	70.80	65.24
	SHC	1.56	1.41	1.29	1.64	1.50	1.38	1.70	1.56	1.45
	kW	8.81	8.53	8.62	9.15	8.94	8.65	9.46	9.31	9.08
60	TC	55.47	49.48	40.48	66.62	62.07	54.88	75.68	72.76	67.28
	SHC	3.50	3.38	3.27	3.59	3.47	3.36	3.65	3.52	3.42
	kW	8.36	8.84	8.98	9.88	9.56	9.10	9.83	9.64	9.31
50	TC	58.33	51.72	42.81	68.72	63.93	55.84	77.74	74.77	69.24
	SHC	5.47	5.35	5.24	5.54	5.43	5.32	5.60	5.49	5.39
	kW	8.98	9.25	9.43	9.33	8.97	8.73	9.55	9.33	9.70
40	TC	60.33	53.69	46.89	70.67	65.93	49.83	79.46	76.62	71.24
	SHC	7.42	7.31	7.22	7.49	7.39	7.23	7.55	7.45	7.37
	kW	9.16	9.88	9.06	9.50	9.05	9.47	10.31	10.00	9.48

LEGEND

- Edb – Entering Dry–Bulb
- Ewb – Entering Wet–Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry–Bulb
- lwb – Leaving Wet–Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

$$t_{lwb} = \text{Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil } (h_{lwb})$$

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$
 Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 29 – COOLING CAPACITIES

2-STAGE COOLING

15 TONS

50TC–D16 (RTPF)			Ambient Temperature												
			85			95			105			115			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	
4500 Cfm	EAT (wb)	58	THC	156.6	156.6	175.2	149.4	149.4	169.1	141.6	141.6	160.2	133.3	133.3	150.9
			SHC	134.7	154.9	175.2	129.8	149.4	169.1	123.0	141.6	160.2	115.7	133.3	150.9
		62	THC	166.7	166.7	166.9	158.0	158.0	162.6	147.6	147.6	157.2	136.8	136.8	150.3
			SHC	122.8	144.9	166.9	118.6	140.6	162.6	113.5	135.3	157.2	107.4	128.8	150.3
		67	THC	184.1	184.1	184.1	175.6	175.6	175.6	165.6	165.6	165.6	154.5	154.5	154.5
			SHC	101.6	123.7	145.7	98.1	120.2	142.3	94.0	116.1	138.2	89.4	111.5	133.6
		72	THC	200.3	200.3	200.3	192.0	192.0	192.0	182.9	182.9	182.9	172.2	172.2	172.2
			SHC	78.7	101.1	123.5	75.5	97.9	120.2	72.1	94.4	116.7	68.2	90.5	112.7
		76	THC	-	211.4	211.4	-	203.1	203.1	-	193.8	193.8	-	183.9	183.9
			SHC	-	82.2	107.0	-	79.3	103.8	-	76.0	100.2	-	72.6	96.5
5250 Cfm	EAT (wb)	58	THC	165.2	165.2	186.9	158.2	158.2	179.0	150.0	150.0	169.7	141.3	141.3	160.0
			SHC	143.5	165.2	186.9	137.4	158.2	179.0	130.2	150.0	169.7	122.7	141.3	160.0
		62	THC	172.3	172.3	181.7	163.4	163.4	176.9	153.1	153.1	169.3	143.4	143.4	161.4
			SHC	131.6	156.6	181.7	127.1	152.0	176.9	120.5	144.9	169.3	114.1	137.8	161.4
		67	THC	189.5	189.5	189.5	180.9	180.9	180.9	170.7	170.7	170.7	159.1	159.1	159.1
			SHC	107.2	132.4	157.5	103.8	129.0	154.1	99.9	125.1	150.4	95.3	120.6	145.8
		72	THC	205.0	205.0	205.0	196.5	196.5	196.5	187.1	187.1	187.1	176.4	176.4	176.4
			SHC	80.9	106.1	131.3	77.7	102.9	128.1	74.4	99.5	124.7	70.6	95.8	121.0
		76	THC	-	215.4	215.4	-	206.8	206.8	-	197.1	197.1	-	186.9	186.9
			SHC	-	85.0	113.0	-	82.0	109.8	-	78.8	106.4	-	75.4	102.8
6000 Cfm	EAT (wb)	58	THC	172.7	172.7	195.4	165.5	165.5	187.3	157.1	157.1	177.8	148.1	148.1	167.7
			SHC	150.0	172.7	195.4	143.8	165.5	187.3	136.4	157.1	177.8	128.6	148.1	167.7
		62	THC	176.6	176.6	195.7	168.1	168.1	187.6	158.9	158.9	180.2	148.9	148.9	172.1
			SHC	139.6	167.7	195.7	133.2	160.4	187.6	127.1	153.7	180.2	120.7	146.4	172.1
		67	THC	193.6	193.6	193.6	184.8	184.8	184.8	174.7	174.7	174.7	162.7	162.7	162.7
			SHC	112.3	140.3	168.3	108.9	137.0	165.2	105.2	133.5	161.7	100.7	129.0	157.3
		72	THC	208.4	208.4	208.4	199.6	199.6	199.6	190.2	190.2	190.2	179.5	179.5	179.5
			SHC	82.7	110.5	138.3	79.6	107.3	135.1	76.2	104.0	131.8	72.6	100.6	128.5
		76	THC	-	218.2	218.2	-	209.5	209.5	-	199.5	199.5	-	189.0	189.0
			SHC	-	87.5	118.6	-	84.5	115.2	-	81.1	111.3	-	77.5	107.3
6750 Cfm	EAT (wb)	58	THC	178.8	178.8	202.4	171.6	171.6	194.2	163.1	163.1	184.6	153.8	153.8	174.1
			SHC	155.3	178.8	202.4	149.0	171.6	194.2	141.6	163.1	184.6	133.5	153.8	174.1
		62	THC	181.0	181.0	203.6	173.0	173.0	197.5	163.8	163.8	190.1	153.9	153.9	181.1
			SHC	144.1	173.9	203.6	139.1	168.3	197.5	133.3	161.7	190.1	126.7	153.9	181.1
		67	THC	196.8	196.8	196.8	187.9	187.9	187.9	177.7	177.7	177.7	165.5	165.5	167.9
			SHC	117.0	147.7	178.4	113.7	144.5	175.4	110.1	141.1	172.2	105.6	136.8	167.9
		72	THC	211.0	211.0	211.0	202.2	202.2	202.2	192.5	192.5	192.5	181.8	181.8	181.8
			SHC	84.3	114.5	144.7	81.2	111.5	141.7	77.9	108.1	138.4	74.4	104.9	135.4
		76	THC	-	220.2	220.2	-	211.5	211.5	-	201.3	201.3	-	190.6	190.6
			SHC	-	89.5	122.8	-	86.4	119.4	-	83.0	115.4	-	79.4	111.5
7500 Cfm	EAT (wb)	58	THC	183.9	183.9	208.2	176.6	176.6	199.8	168.2	168.2	190.3	158.6	158.6	179.5
			SHC	159.7	183.9	208.2	153.3	176.6	199.8	146.0	168.2	190.3	137.7	158.6	179.5
		62	THC	185.1	185.1	212.5	177.1	177.1	206.2	168.3	168.3	197.9	158.7	158.7	186.7
			SHC	149.5	181.0	212.5	144.5	175.4	206.2	138.7	168.3	197.9	130.8	158.7	186.7
		67	THC	199.3	199.3	199.3	190.3	190.3	190.3	180.0	180.0	181.7	167.8	167.8	177.8
			SHC	121.3	154.6	187.9	118.1	151.6	185.1	114.4	148.1	181.7	110.1	144.0	177.8
		72	THC	213.0	213.0	213.0	204.1	204.1	204.1	194.2	194.2	194.2	183.5	183.5	183.5
			SHC	85.8	118.2	150.5	82.7	115.2	147.7	79.4	111.9	144.4	76.0	108.8	141.6
		76	THC	-	221.9	221.9	-	213.0	213.0	-	202.7	202.7	-	191.8	191.8
			SHC	-	91.2	126.5	-	88.2	123.1	-	84.7	119.2	-	81.2	115.3

* See Minimum–Maximum Airflow Ratings in Table 4. Do not operate outside these limits.

LEGEND:

- Do not operate in this region
- Cfm - Cubic feet per minute (supply air)
- EAT(db) - Entering air temperature (dry bulb)
- EAT(wb) - Entering air temperature (wet bulb)
- SHC - Sensible heat capacity
- TC - Total capacity

50TC*E16 Cooling Capacities, Subcooling Mode										
TEMP (F) AIR ENT CONDENSER (Edb)		AIR ENTERING EVAPORATOR – CFM								
		4500/0.02			6000/0.06			7500/0.05		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	204.4	186.3	168.2	218.4	199.6	180.9	229.6	210.4	191.2
	SHC	98.9	118.1	137.2	114.8	133.7	152.6	127.6	146.2	164.9
	kW	11.57	11.22	10.77	11.78	11.45	11.00	12.06	11.64	11.35
85	TC	189.2	171.7	154.1	203.0	184.8	166.7	214.1	195.5	176.9
	SHC	79.5	103.4	127.3	96.5	120.2	144.0	110.2	133.7	157.3
	kW	12.59	12.24	11.81	12.81	12.50	12.03	13.05	12.66	12.47
95	TC	174.0	157.0	140.0	187.6	170.1	152.5	198.6	180.6	162.7
	SHC	60.0	88.7	117.5	78.2	106.8	135.3	92.9	121.3	149.7
	kW	13.68	13.35	12.86	13.91	13.57	13.05	14.15	13.75	13.47
105	TC	158.8	142.3	125.8	172.2	155.3	138.3	183.1	165.7	148.4
	SHC	40.5	74.1	107.7	59.9	93.3	126.7	75.5	108.8	142.0
	kW	14.67	14.41	13.88	14.90	14.55	14.10	15.15	14.73	14.53
115	TC	143.6	127.6	111.7	156.8	140.5	124.1	167.6	150.9	134.2
	SHC	21.0	59.4	97.8	41.6	79.9	118.1	58.1	96.3	134.2
	kW	15.77	15.38	14.88	15.88	15.65	15.10	16.12	15.84	15.54

50TC*E 16 COOLING CAPACITIES, HOT GAS REHEAT MODE										
TEMP (F) AIR ENT CONDENSER Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator – Cfm								
		4500	6000	7500	4500	6000	7500	4500	6000	7500
80	TC	83.75	84.85	88.95	86.65	91.90	92.90	87.90	91.75	96.30
	SHC	37.50	42.80	55.10	30.90	40.40	44.50	24.80	29.30	34.10
	kW	10.50	11.49	11.60	10.56	10.65	11.70	11.60	11.72	11.77
75	TC	85.00	86.00	90.50	88.05	93.60	94.65	89.20	93.45	97.85
	SHC	40.00	45.00	57.30	33.20	42.30	46.90	26.90	31.50	36.30
	kW	10.16	11.15	11.25	10.21	10.31	11.33	11.26	11.35	11.42
70	TC	86.15	87.35	91.50	89.20	94.30	96.10	90.40	94.10	98.95
	SHC	42.10	47.50	59.80	35.50	45.30	49.50	29.50	33.90	38.70
	kW	9.84	10.83	10.94	10.02	10.13	11.03	10.95	11.05	11.12
60	TC	88.90	90.10	94.25	92.00	97.10	98.20	93.20	96.90	101.75
	SHC	46.80	52.30	64.60	40.20	50.10	54.10	34.10	38.60	43.40
	kW	9.37	10.36	10.44	9.42	9.52	10.55	10.45	10.57	10.64
50	TC	91.70	92.80	97.00	94.80	99.90	101.00	96.10	99.70	104.20
	SHC	51.50	57.10	69.40	44.80	54.80	58.90	38.70	43.20	49.00
	kW	9.12	10.09	10.16	9.17	9.28	10.26	10.17	10.26	10.32
40	TC	94.45	95.60	99.80	97.45	102.55	103.70	98.65	102.35	107.00
	SHC	56.30	61.40	73.70	49.70	59.20	63.30	43.60	48.10	52.90
	kW	9.05	10.02	10.10	9.10	9.21	10.18	10.11	10.20	10.26

LEGEND

- Edb** – Entering Dry– Bulb
- Ewb** – Entering Wet– Bulb
- kW** – Compressor Motor Power Input
- ldb** – Leaving Dry– Bulb
- lwb** – Leaving Wet– Bulb
- SHC** – Sensible Heat Capacity (1000 Btuh) Gross
- TC** – Total Capacity (1000 Btuh) Gross

Table 31 – STATIC PRESSURE ADDERS (IN. WG) (FACTORY OPTIONS AND/OR ACCESSORIES)

Electric Heaters

3–6 TONS										
CFM	600	900	1200	1400	1600	1800	2000	2200	2400	2600
1 Electric Heater Module	0.03	0.05	0.07	0.09	0.09	0.10	0.11	0.11	0.12	0.13
2 Electric Heater Modules	0.13	0.15	0.16	0.16	0.16	0.17	0.17	0.17	0.18	0.18

7.5 – 12.5 TONS																
CFM	2250	2500	2750	3000	3250	3500	3750	4000	4250	4500	4750	5000	5250	5500	5750	6000
1 Electric Heater Module	0.03	0.04	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.14	0.15	0.16	0.18
2 Electric Heater Modules	0.04	0.05	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.15	0.16	0.17	0.19	0.20

15 TON													
CFM	2813	3125	3438	3750	4063	4375	4688	5000	5313	5625	5938	6250	
Vertical - 1 Electric Heater Module	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.04	
Vertical - 2 Electric Heater Modules	0.02	0.03	0.03	0.03	0.04	0.04	0.05	0.05	0.06	0.06	0.07	0.08	
Horizontal - 1 Electric Heater Module	0.03	0.03	0.04	0.04	0.05	0.05	0.06	0.06	0.07	0.07	0.08	0.09	
Horizontal - 2 Electric Heater Modules	0.02	0.03	0.03	0.04	0.04	0.04	0.05	0.05	0.06	0.06	0.07	0.08	

Humidi-MiZer®

3–6 TONS									
CFM	1000	1250	1500	1750	2000	2250	2500	2750	3000
3 Tons*	0.04	0.052	0.07	–	–	–	–	–	–
4 Tons*	–	0.106	0.138	0.172	0.21	–	–	–	–
5 Tons*	–	–	0.138	0.172	0.21	0.252	0.30	–	–
6 Tons	–	–	–	0.112	0.125	0.161	0.19	0.22	0.25

* Last order date for 48TC 04–06 units with Humidi-MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.

7.5–12.5 TONS																
CFM	2250	2500	2750	3000	3250	3500	3750	4000	4250	4500	4750	5000	5250	5500	5750	6000
7.5 Tons	0.12	0.14	0.16	0.19	0.21	0.23	0.26	–	–	–	–	–	–	–	–	–
8.5 Tons	–	0.11	0.12	0.13	0.15	0.17	0.18	0.20	0.22	–	–	–	–	–	–	–
10 Tons	–	–	–	0.13	0.15	0.17	0.18	0.20	0.22	0.24	0.26	0.28	–	–	–	–
12.5 Tons	–	–	–	–	–	0.17	0.18	0.20	0.22	0.24	0.26	0.28	0.31	0.33	0.36	0.39

15 TONS															
CFM	4000	4250	4500	4750	5000	5250	5500	5750	6000	6250	6500	6750	7000	7250	
15 Tons	0.06	0.07	0.07	0.08	0.08	0.09	0.10	0.10	0.11	0.12	0.12	0.13	0.14	0.15	

ECONOMIZER, BAROMETRIC RELIEF AND PE PERFORMANCE

Vertical Application

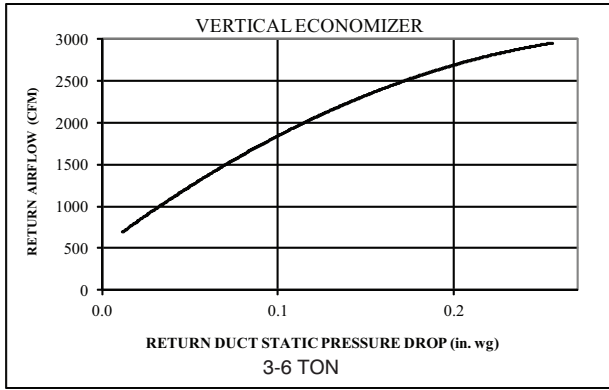


Fig. 16 - Return Air Pressure Drop

C11238

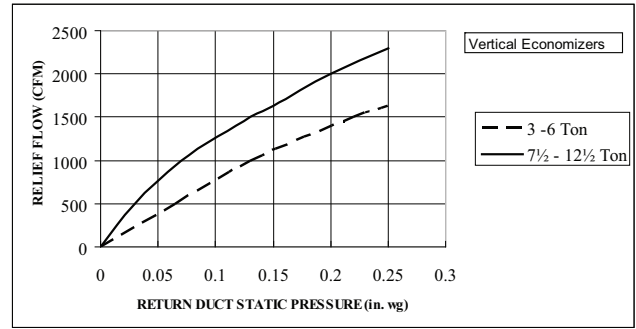


Fig. 19 - Barometric Relief Flow Capacity

C08073

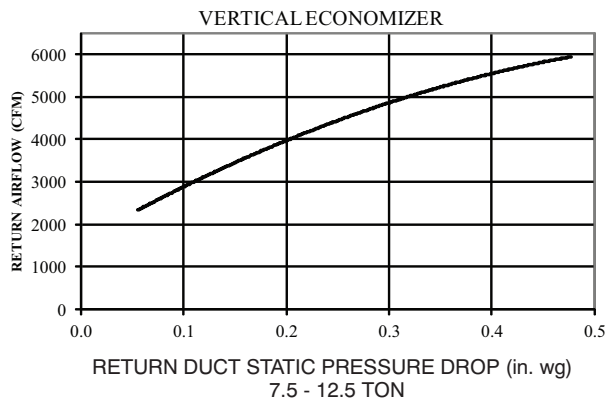


Fig. 17 - Return Air Pressure Drop

C11240

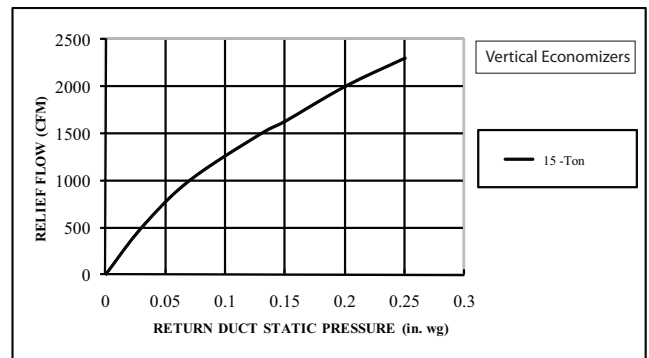


Fig. 20 - Barometric Relief Flow-Vertical 15 Ton

C101122

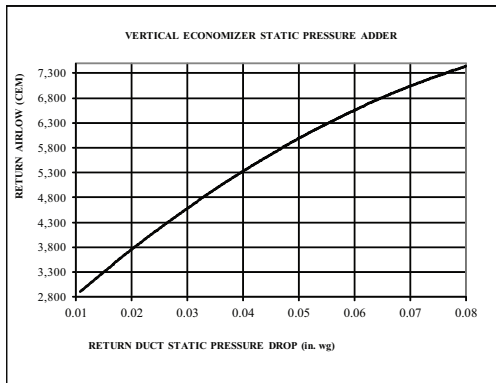


Fig. 18 - Return Air Pressure Drop-Vertical 15 Tons

C11257

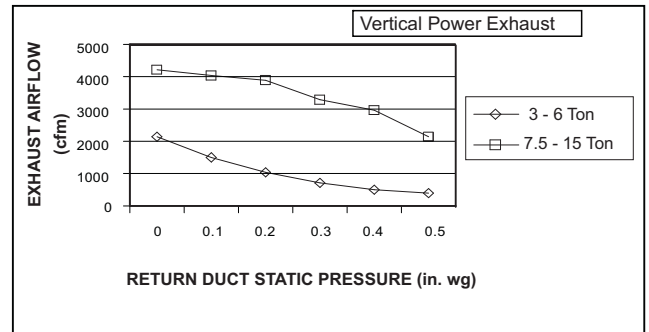


Fig. 21 - Vertical Power Exhaust Performance

C11248

ECONOMIZER, BAROMETRIC RELIEF AND PE PERFORMANCE (cont.)

Horizontal Application

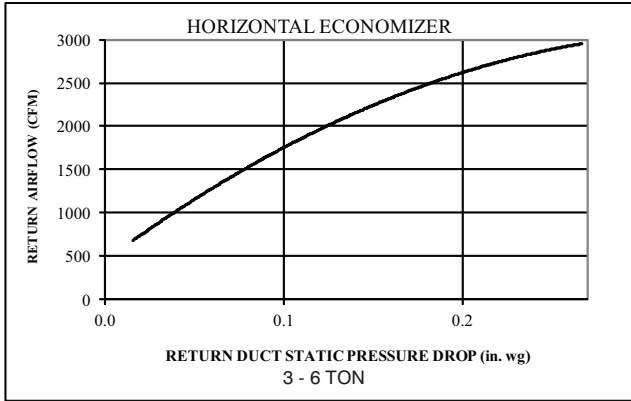


Fig. 22 - Return Air Pressure Drop

C11239

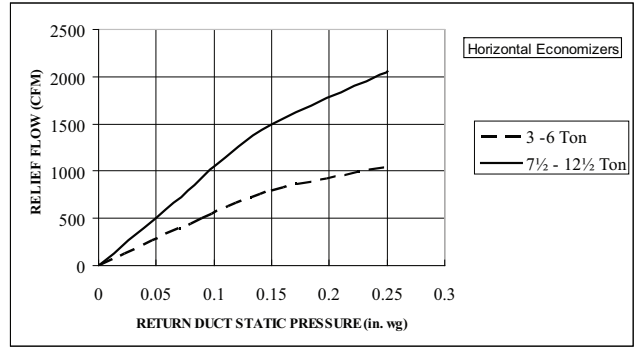


Fig. 25 - Barometric Relief Flow Capacity

C08070

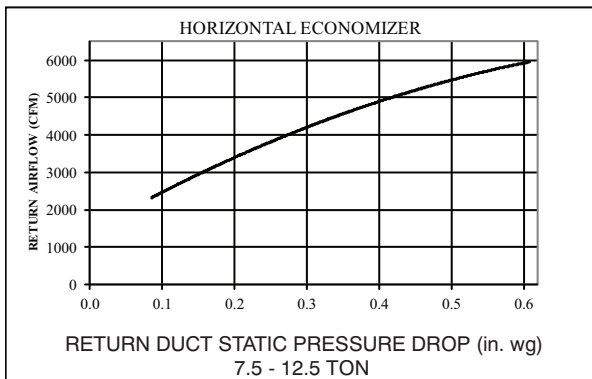


Fig. 23 - Return Air Pressure Drop

C11241

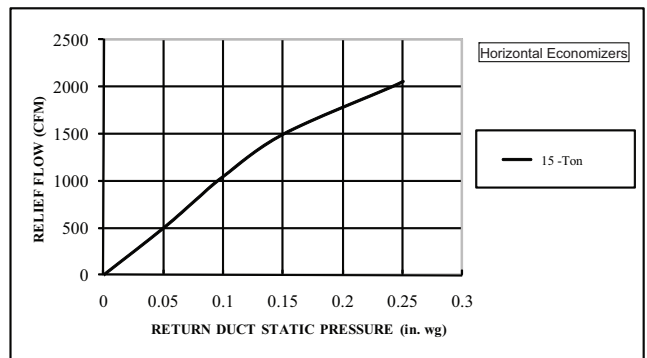


Fig. 26 - Barometric Relief Flow-Horizontal 15 Ton

C101120

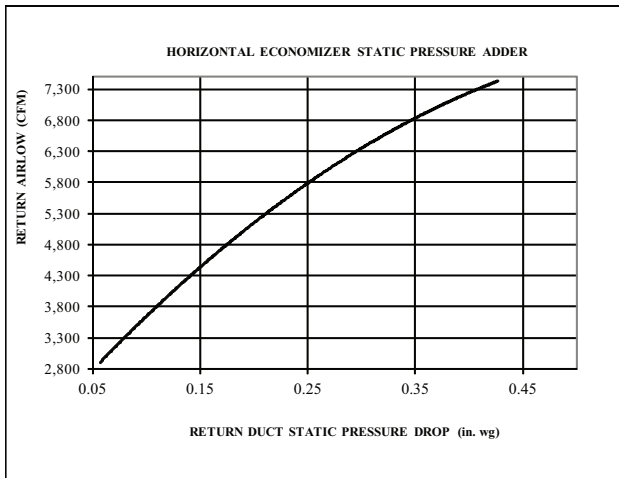


Fig. 24 - Return Air Pressure Drop-Horizontal 15 Ton

C11258

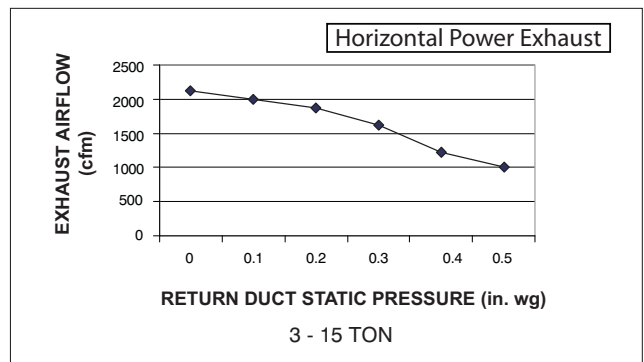


Fig. 27 - Horizontal Power Exhaust Performance

C08012

GENERAL FAN PERFORMANCE NOTES

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils. Factory options and accessories may add static pressure losses. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
4. The Fan Performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, Carrier recommended the lower horsepower option.
5. For information on the electrical properties of Carrier motors, please see the Electrical information section of this book.
6. For more information on the performance limits of Carrier motors, see the application data section of this book.
7. The EPACT (Energy Policy Act of 1992) regulates energy requirements for specific types of indoor fan motors. Motors regulated by EPACT include any general purpose, T-frame (three-digit, 143 and larger), single-speed, foot mounted, polyphase, squirrel cage induction motors of NEMA (National Electrical Manufacturers Association) design A and B, manufactured for use in the United States. Ranging from 1 to 200 Hp, these continuous-duty motors operate on 230 and 460 volt, 60 Hz power. If a motor does not fit into these specifications, the motor does not have to be replaced by an EPACT compliant energy-efficient motor. Variable-speed motors are exempt from EPACT compliance requirements. Therefore, the indoor fan motors for Carrier 50TC-* 04-16 units are exempt from these requirements.

FAN PERFORMANCE (DIRECT DRIVE)

Table 32 – 50TC-04 Vertical Unit - Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	900	0.83	0.36
	975	0.70	0.35
	1050	0.58	0.33
	1125	0.47	0.31
	1200	0.37	0.30
	1275	0.27	0.28
	1350	0.17	0.27
	1425	0.08	0.26
1500	–	–	
2	900	1.09	0.46
	975	1.00	0.46
	1050	0.89	0.46
	1125	0.77	0.45
	1200	0.64	0.43
	1275	0.52	0.41
	1350	0.39	0.39
	1425	0.28	0.37
1500	0.18	0.35	
3	900	1.15	0.49
	975	1.10	0.52
	1050	1.05	0.54
	1125	1.01	0.56
	1200	0.95	0.59
	1275	0.90	0.61
	1350	0.84	0.63
	1425	0.78	0.65
1500	0.71	0.66	
4	900	1.15	0.50
	975	1.10	0.52
	1050	1.05	0.54
	1125	1.00	0.56
	1200	0.96	0.58
	1275	0.91	0.61
	1350	0.86	0.63
	1425	0.82	0.66
1500	0.77	0.68	
5	900	1.16	0.50
	975	1.11	0.52
	1050	1.06	0.54
	1125	1.01	0.57
	1200	0.97	0.59
	1275	0.92	0.62
	1350	0.87	0.64
	1425	0.82	0.67
1500	0.77	0.69	

Table 33 – 50TC-04 Horizontal Unit - Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	900	0.90	0.36
	975	0.78	0.35
	1050	0.67	0.33
	1125	0.57	0.31
	1200	0.48	0.30
	1275	0.39	0.28
	1350	0.31	0.27
	1425	0.22	0.26
1500	0.13	0.24	
2	900	1.17	0.46
	975	1.08	0.46
	1050	0.98	0.46
	1125	0.87	0.45
	1200	0.75	0.43
	1275	0.64	0.41
	1350	0.53	0.39
	1425	0.42	0.37
1500	0.34	0.35	
3	900	1.22	0.49
	975	1.18	0.52
	1050	1.14	0.54
	1125	1.11	0.56
	1200	1.06	0.59
	1275	1.02	0.61
	1350	0.98	0.63
	1425	0.93	0.65
1500	0.87	0.66	
4	900	1.22	0.50
	975	1.18	0.52
	1050	1.14	0.54
	1125	1.10	0.56
	1200	1.07	0.58
	1275	1.03	0.61
	1350	1.00	0.63
	1425	0.96	0.66
1500	0.92	0.68	
5	900	1.23	0.50
	975	1.19	0.52
	1050	1.15	0.54
	1125	1.11	0.57
	1200	1.08	0.59
	1275	1.04	0.62
	1350	1.00	0.64
	1425	0.97	0.67
1500	0.93	0.69	

FAN PERFORMANCE (DIRECT DRIVE) (cont.)

Table 34 – 50TC-05 Vertical Unit - Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1200	0.36	0.30
	1300	0.23	0.28
	1400	0.10	0.26
	1500	–	–
	1600	–	–
	1700	–	–
	1800	–	–
	1900	–	–
2	1200	0.64	0.43
	1300	0.47	0.40
	1400	0.31	0.37
	1500	0.18	0.35
	1600	0.09	0.34
	1700	0.07	0.36
	1800	0.14	0.41
	1900	0.34	0.52
3	1200	0.95	0.59
	1300	0.88	0.62
	1400	0.80	0.64
	1500	0.71	0.66
	1600	0.61	0.67
	1700	0.49	0.67
	1800	0.34	0.64
	1900	0.17	0.59
4	1200	0.95	0.58
	1300	0.89	0.62
	1400	0.83	0.65
	1500	0.76	0.68
	1600	0.69	0.72
	1700	0.61	0.74
	1800	–	–
	1900	–	–
5	1200	0.96	0.59
	1300	0.90	0.62
	1400	0.83	0.66
	1500	0.77	0.69
	1600	0.71	0.73
	1700	–	–
	1800	–	–
	1900	–	–
2000	–	–	

Table 35 – 50TC-05 Horizontal Unit - Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1200	0.47	0.30
	1300	0.36	0.28
	1400	0.25	0.26
	1500	0.12	0.24
	1600	–	–
	1700	–	–
	1800	–	–
	1900	–	–
2	1200	0.75	0.43
	1300	0.60	0.40
	1400	0.45	0.37
	1500	0.34	0.35
	1600	0.27	0.34
	1700	0.26	0.36
	1800	0.36	0.41
	1900	0.57	0.52
3	1200	1.06	0.59
	1300	1.00	0.62
	1400	0.94	0.64
	1500	0.87	0.66
	1600	0.78	0.67
	1700	0.68	0.67
	1800	0.56	0.64
	1900	0.41	0.59
4	1200	1.06	0.58
	1300	1.01	0.62
	1400	0.97	0.65
	1500	0.92	0.68
	1600	0.87	0.72
	1700	0.80	0.74
	1800	–	–
	1900	–	–
5	1200	1.07	0.59
	1300	1.02	0.62
	1400	0.98	0.66
	1500	0.93	0.69
	1600	0.88	0.73
	1700	–	–
	1800	–	–
	1900	–	–
2000	–	–	

FAN PERFORMANCE (DIRECT DRIVE) (cont.)

Table 36 – 50TC-06 Vertical Unit - Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1500	0.72	0.74
	1625	0.53	0.71
	1750	0.34	0.68
	1875	0.20	0.66
	2000	0.14	0.69
	2125	0.18	0.77
	2250	0.39	0.94
	2375	-	-
2500	-	-	
2	1500	0.87	0.82
	1625	0.68	0.80
	1750	0.49	0.77
	1875	0.29	0.74
	2000	0.10	0.70
	2125	-	-
	2250	-	-
	2375	-	-
2500	-	-	
3	1500	0.89	0.84
	1625	0.72	0.83
	1750	0.54	0.81
	1875	0.33	0.77
	2000	0.12	0.72
	2125	-	-
	2250	-	-
	2375	-	-
2500	-	-	
4	1500	1.00	0.92
	1625	0.88	0.95
	1750	0.75	0.98
	1875	0.60	0.99
	2000	0.42	0.97
	2125	0.19	0.92
	2250	-	-
	2375	-	-
2500	-	-	
5	1500	1.03	0.94
	1625	0.93	0.98
	1750	-	-
	1875	-	-
	2000	-	-
	2125	-	-
	2250	-	-
	2375	-	-
2500	-	-	

Table 37 – 50TC-06 Horizontal Unit - Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1500	0.88	0.74
	1625	0.71	0.71
	1750	0.55	0.68
	1875	0.43	0.66
	2000	0.39	0.69
	2125	0.47	0.77
	2250	0.70	0.94
	2375	-	-
2500	-	-	
2	1500	1.02	0.82
	1625	0.86	0.80
	1750	0.69	0.77
	1875	0.52	0.74
	2000	0.36	0.70
	2125	0.23	0.67
	2250	0.15	0.66
	2375	0.16	0.68
2500	0.28	0.75	
3	1500	1.05	0.84
	1625	0.90	0.83
	1750	0.74	0.81
	1875	0.56	0.77
	2000	0.37	0.72
	2125	0.18	0.67
	2250	-	-
	2375	-	-
2500	-	-	
4	1500	1.16	0.92
	1625	1.06	0.95
	1750	0.96	0.98
	1875	0.83	0.99
	2000	0.67	0.97
	2125	0.48	0.92
	2250	0.23	0.83
	2375	-	-
2500	-	-	
5	1500	1.19	0.94
	1625	1.11	0.98
	1750	-	-
	1875	-	-
	2000	-	-
	2125	-	-
	2250	-	-
	2375	-	-
2500	-	-	

FAN PERFORMANCE

Table 38 – 50TC**04

1 PHASE

3 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	566	0.14	690	0.23	791	0.32	879	0.42	957	0.52	1029	0.63	1095	0.75	1157	0.86	1216	0.99	1272	1.11
975	590	0.17	711	0.26	811	0.36	897	0.46	975	0.57	1046	0.68	1112	0.80	1174	0.92	1232	1.05	1287	1.18
1050	615	0.19	733	0.29	831	0.39	916	0.50	993	0.62	1064	0.73	1129	0.86	1190	0.98	1248	1.11	-	-
1125	640	0.22	755	0.33	851	0.43	936	0.55	1012	0.67	1082	0.79	1147	0.92	1208	1.05	1265	1.18	-	-
1200	666	0.25	778	0.36	873	0.48	956	0.60	1031	0.72	1100	0.85	1165	0.98	1225	1.12	-	-	-	-
1275	692	0.29	802	0.41	894	0.53	976	0.65	1051	0.78	1119	0.91	1183	1.05	1243	1.19	-	-	-	-
1350	719	0.33	825	0.45	916	0.58	997	0.71	1071	0.84	1139	0.98	1202	1.12	-	-	-	-	-	-
1425	746	0.37	850	0.50	939	0.63	1019	0.77	1091	0.91	1159	1.05	1221	1.20	-	-	-	-	-	-
1500	774	0.42	875	0.55	962	0.69	1041	0.83	1112	0.98	1179	1.13	-	-	-	-	-	-	-	-

STD Static – 560 – 854 RPM, 1.2 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

NOTE: Production of single phase units has been discontinued per DOE regulations. Single phase 50TC models are only available until current inventories are exhausted.

MED Static – 770 – 1175 RPM, 1.2 Max BHP

Table 39 – 50TC**04

1 PHASE

3 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	554	0.14	681	0.22	783	0.32	870	0.42	947	0.53	1017	0.64	1082	0.76	1143	0.88	1200	1.01	1254	1.14
975	575	0.16	701	0.25	801	0.35	888	0.45	965	0.57	1035	0.68	1100	0.81	1160	0.93	1217	1.07	1271	1.20
1050	597	0.18	721	0.28	821	0.38	906	0.49	983	0.61	1053	0.73	1117	0.86	1177	0.99	1234	1.13	-	-
1125	620	0.21	741	0.31	840	0.42	925	0.54	1001	0.66	1071	0.78	1135	0.92	1195	1.05	1251	1.19	-	-
1200	643	0.23	762	0.35	860	0.46	944	0.58	1020	0.71	1089	0.84	1153	0.98	1212	1.12	-	-	-	-
1275	666	0.27	784	0.38	880	0.50	964	0.63	1039	0.76	1107	0.90	1171	1.04	1230	1.19	-	-	-	-
1350	690	0.30	805	0.42	900	0.55	983	0.68	1058	0.82	1126	0.96	1189	1.11	-	-	-	-	-	-
1425	714	0.34	827	0.47	921	0.60	1003	0.74	1077	0.88	1145	1.03	1208	1.18	-	-	-	-	-	-
1500	738	0.38	849	0.52	942	0.66	1024	0.80	1097	0.95	1164	1.10	-	-	-	-	-	-	-	-

STD Static (560 – 854 rpm) 1.2 Max BHP

Bold Face = Field Supplied Drive Required

For more information, see General Fan Performance Notes on page 59.

NOTE: Production of single phase units has been discontinued per DOE regulations. Single phase 50TC models are only available until current inventories are exhausted.

MED Static – 770 – 1175 RPM, 1.2 Max BHP

FAN PERFORMANCE (cont.)

Table 40 – 50TC04**

3 PHASE

3 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	566	0.14	690	0.23	791	0.32	879	0.42	957	0.52	1029	0.63	1095	0.75	1157	0.86	1216	0.99	1272	1.11
975	590	0.17	711	0.26	811	0.36	897	0.46	975	0.57	1046	0.68	1112	0.80	1174	0.92	1232	1.05	1287	1.18
1050	615	0.19	733	0.29	831	0.39	916	0.50	993	0.62	1064	0.73	1129	0.86	1190	0.98	1248	1.11	1304	1.25
1125	640	0.22	755	0.33	851	0.43	936	0.55	1012	0.67	1082	0.79	1147	0.92	1208	1.05	1265	1.18	1320	1.32
1200	666	0.25	778	0.36	873	0.48	956	0.60	1031	0.72	1100	0.85	1165	0.98	1225	1.12	1282	1.26	1337	1.40
1275	692	0.29	802	0.41	894	0.53	976	0.65	1051	0.78	1119	0.91	1183	1.05	1243	1.19	1300	1.34	1354	1.49
1350	719	0.33	825	0.45	916	0.58	997	0.71	1071	0.84	1139	0.98	1202	1.12	1262	1.27	1318	1.42	1372	1.57
1425	746	0.37	850	0.50	939	0.63	1019	0.77	1091	0.91	1159	1.05	1221	1.20	1280	1.35	1336	1.51	1390	1.66
1500	774	0.42	875	0.55	962	0.69	1041	0.83	1112	0.98	1179	1.13	1241	1.28	1300	1.44	1355	1.60	1408	1.76

STD Static – 560 – 854 RPM, 1.7 Max BHP

MED Static – 770 – 1175 RPM, 1.7 Max BHP

HIGH Static – 1035 – 1466 RPM, 2.4 Max BHP

For more information, see General Fan Performance Notes on page 59.

Table 41 – 50TC04**

3 PHASE

3 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	554	0.14	681	0.22	783	0.32	870	0.42	947	0.53	1017	0.64	1082	0.76	1143	0.88	1200	1.01	1254	1.14
975	575	0.16	701	0.25	801	0.35	888	0.45	965	0.57	1035	0.68	1100	0.81	1160	0.93	1217	1.07	1271	1.20
1050	597	0.18	721	0.28	821	0.38	906	0.49	983	0.61	1053	0.73	1117	0.86	1177	0.99	1234	1.13	1288	1.27
1125	620	0.21	741	0.31	840	0.42	925	0.54	1001	0.66	1071	0.78	1135	0.92	1195	1.05	1251	1.19	1305	1.34
1200	643	0.23	762	0.35	860	0.46	944	0.58	1020	0.71	1089	0.84	1153	0.98	1212	1.12	1269	1.26	1322	1.41
1275	666	0.27	784	0.38	880	0.50	964	0.63	1039	0.76	1107	0.90	1171	1.04	1230	1.19	1286	1.33	1340	1.49
1350	690	0.30	805	0.42	900	0.55	983	0.68	1058	0.82	1126	0.96	1189	1.11	1249	1.26	1304	1.41	1357	1.57
1425	714	0.34	827	0.47	921	0.60	1003	0.74	1077	0.88	1145	1.03	1208	1.18	1267	1.33	1323	1.49	1375	1.66
1500	738	0.38	849	0.52	942	0.66	1024	0.80	1097	0.95	1164	1.10	1227	1.25	1285	1.41	1341	1.58	1394	1.75

STD Static – 560 – 854 RPM, 1.7 Max BHP

MED Static – 770 – 1175 RPM, 1.7 Max BHP

HIGH Static – 1035 – 1466 RPM, 2.4 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

4 TON VERTICAL SUPPLY

I PHASE

Table 42 – 50TC**05

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	666	0.25	778	0.36	873	0.48	956	0.60	1031	0.72	1100	0.85	1165	0.98	1225	1.12	-	-	-	-
1300	701	0.30	809	0.42	902	0.54	983	0.67	1057	0.80	1126	0.94	1189	1.07	-	-	-	-	-	-
1400	737	0.36	842	0.48	932	0.61	1012	0.75	1085	0.89	1152	1.03	1215	1.17	-	-	-	-	-	-
1500	774	0.42	875	0.55	962	0.69	1041	0.83	1112	0.98	1179	1.13	-	-	-	-	-	-	-	-
1600	811	0.49	909	0.63	994	0.78	1071	0.93	1141	1.08	-	-	-	-	-	-	-	-	-	-
1700	849	0.57	943	0.72	1026	0.87	1101	1.03	1170	1.19	-	-	-	-	-	-	-	-	-	-
1800	887	0.65	978	0.81	1059	0.98	1133	1.14	-	-	-	-	-	-	-	-	-	-	-	-
1900	926	0.75	1014	0.92	1092	1.09	1164	1.26	-	-	-	-	-	-	-	-	-	-	-	-
2000	965	0.86	1050	1.03	1127	1.21	-	-	-	-	-	-	-	-	-	-	-	-	-	-

STD Static – 560 – 854 RPM, 1.2 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

NOTE: Production of single phase units has been discontinued per DOE regulations. Single phase 50TC models are only available until current inventories are exhausted.

MED Static – 770 – 1175 RPM, 1.2 Max BHP

Table 43 – 50TC**05

4 TON HORIZONTAL SUPPLY

I PHASE

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	643	0.23	762	0.35	860	0.46	944	0.58	1020	0.71	1089	0.84	1153	0.98	1212	1.12	-	-	-	-
1300	674	0.28	791	0.40	887	0.52	970	0.65	1045	0.78	1114	0.92	1177	1.06	-	-	-	-	-	-
1400	706	0.33	820	0.45	914	0.59	997	0.72	1071	0.86	1139	1.01	1202	1.15	-	-	-	-	-	-
1500	738	0.38	849	0.52	942	0.66	1024	0.80	1097	0.95	1164	1.10	-	-	-	-	-	-	-	-
1600	771	0.44	879	0.59	971	0.74	1051	0.89	1124	1.04	1190	1.20	-	-	-	-	-	-	-	-
1700	804	0.51	910	0.66	1000	0.82	1079	0.98	1151	1.14	-	-	-	-	-	-	-	-	-	-
1800	837	0.59	941	0.75	1029	0.91	1107	1.08	-	-	-	-	-	-	-	-	-	-	-	-
1900	871	0.67	972	0.84	1059	1.02	1136	1.19	-	-	-	-	-	-	-	-	-	-	-	-
2000	906	0.76	1004	0.94	1089	1.12	-	-	-	-	-	-	-	-	-	-	-	-	-	-

STD Static – 560 – 854 RPM, 1.2 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

NOTE: Production of single phase units has been discontinued per DOE regulations. Single phase 50TC models are only available until current inventories are exhausted.

MED Static – 770 – 1175 RPM, 1.2 Max BHP

FAN PERFORMANCE (cont.)

Table 44 – 50TC05**

3 PHASE

4 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	666	0.25	778	0.36	873	0.48	956	0.60	1031	0.72	1100	0.85	1165	0.98	1225	1.12	1282	1.26	1337	1.40
1300	701	0.30	809	0.42	902	0.54	983	0.67	1057	0.80	1126	0.94	1189	1.07	1249	1.22	1306	1.36	1360	1.51
1400	737	0.36	842	0.48	932	0.61	1012	0.75	1085	0.89	1152	1.03	1215	1.17	1274	1.32	1330	1.48	1384	1.63
1500	774	0.42	875	0.55	962	0.69	1041	0.83	1112	0.98	1179	1.13	1241	1.28	1300	1.44	1355	1.60	1408	1.76
1600	811	0.49	909	0.63	994	0.78	1071	0.93	1141	1.08	1206	1.24	1268	1.40	1326	1.56	1381	1.73	1433	1.90
1700	849	0.57	943	0.72	1026	0.87	1101	1.03	1170	1.19	1235	1.36	1295	1.52	1352	1.69	1407	1.87	1459	2.04
1800	887	0.65	978	0.81	1059	0.98	1133	1.14	1200	1.31	1264	1.48	1323	1.66	1380	1.84	1434	2.02	1485	2.20
1900	926	0.75	1014	0.92	1092	1.09	1164	1.26	1231	1.44	1293	1.62	1352	1.80	1408	1.99	1461	2.17	1512	2.37
2000	965	0.86	1050	1.03	1127	1.21	1197	1.39	1262	1.58	1324	1.77	1381	1.96	1436	2.15	1489	2.34	–	–

STD Static – 560 – 854 RPM, 1.7 Max BHP

MED Static – 770 – 1175 RPM, 1.7 Max BHP

HIGH Static – 1035 – 1466 RPM, 2.4 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

Table 45 – 50TC05**

3 PHASE

4 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	643	0.23	762	0.35	860	0.46	944	0.58	1020	0.71	1089	0.84	1153	0.98	1212	1.12	1269	1.26	1322	1.41
1300	674	0.28	791	0.40	887	0.52	970	0.65	1045	0.78	1114	0.92	1177	1.06	1236	1.21	1292	1.36	1346	1.52
1400	706	0.33	820	0.45	914	0.59	997	0.72	1071	0.86	1139	1.01	1202	1.15	1261	1.31	1316	1.47	1369	1.63
1500	738	0.38	849	0.52	942	0.66	1024	0.80	1097	0.95	1164	1.10	1227	1.25	1285	1.41	1341	1.58	1394	1.75
1600	771	0.44	879	0.59	971	0.74	1051	0.89	1124	1.04	1190	1.20	1252	1.36	1311	1.53	1366	1.70	1418	1.87
1700	804	0.51	910	0.66	1000	0.82	1079	0.98	1151	1.14	1217	1.31	1278	1.48	1336	1.65	1391	1.83	1443	2.01
1800	837	0.59	941	0.75	1029	0.91	1107	1.08	1178	1.25	1244	1.42	1305	1.60	1362	1.78	1416	1.97	1468	2.15
1900	871	0.67	972	0.84	1059	1.02	1136	1.19	1206	1.37	1271	1.55	1331	1.73	1388	1.92	1442	2.11	1494	2.31
2000	906	0.76	1004	0.94	1089	1.12	1165	1.31	1234	1.49	1298	1.68	1358	1.87	1415	2.07	1468	2.27	–	–

STD Static – 560 – 854 RPM, 1.7 Max BHP

MED Static – 770 – 1175 RPM, 1.7 Max BHP

HIGH Static – 1035 – 1466 RPM, 2.4 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 46 – 50TC06**

1 PHASE

5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	790	0.40	897	0.53	991	0.68	1075	0.83	1152	1.00	1224	1.18	1291	1.36	-	-	-	-	-	-
1625	837	0.48	940	0.62	1030	0.77	1112	0.94	1187	1.11	1257	1.30	1323	1.49	-	-	-	-	-	-
1750	885	0.58	983	0.73	1070	0.89	1150	1.06	1223	1.24	1292	1.43	-	-	-	-	-	-	-	-
1875	934	0.69	1027	0.85	1112	1.01	1189	1.19	1260	1.38	-	-	-	-	-	-	-	-	-	-
2000	983	0.81	1073	0.98	1154	1.16	1229	1.34	-	-	-	-	-	-	-	-	-	-	-	-
2125	1033	0.95	1119	1.13	1198	1.31	1270	1.50	-	-	-	-	-	-	-	-	-	-	-	-
2250	1084	1.11	1166	1.29	1242	1.49	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2375	1134	1.28	1214	1.48	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2500	1185	1.48	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

STD Static – 770 – 1175 RPM, 1.2 Max BHP

MED Static – 1035 – 1466 RPM, 1.5 Max BHP

For more information, see General Fan Performance Notes on page 59.

NOTE: Production of single phase units has been discontinued per DOE regulations. Single phase 50TC models are only available until current inventories are exhausted.

Table 47 – 50TC06**

1 PHASE

5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	724	0.33	837	0.45	937	0.59	1028	0.74	1111	0.91	1188	1.09	1261	1.29	1330	1.49	-	-	-	-
1625	765	0.40	873	0.53	969	0.67	1056	0.83	1137	1.00	1213	1.18	1284	1.38	-	-	-	-	-	-
1750	806	0.48	909	0.61	1002	0.76	1087	0.92	1165	1.10	1239	1.28	1309	1.49	-	-	-	-	-	-
1875	849	0.57	947	0.71	1036	0.86	1118	1.03	1195	1.21	1267	1.40	-	-	-	-	-	-	-	-
2000	892	0.67	986	0.82	1072	0.98	1151	1.15	1226	1.33	-	-	-	-	-	-	-	-	-	-
2125	935	0.79	1025	0.94	1108	1.11	1185	1.29	1258	1.47	-	-	-	-	-	-	-	-	-	-
2250	980	0.92	1066	1.08	1146	1.25	1220	1.43	-	-	-	-	-	-	-	-	-	-	-	-
2375	1024	1.06	1107	1.23	1184	1.41	-	-	-	-	-	-	-	-	-	-	-	-	-	-
2500	1069	1.22	1149	1.39	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

STD Static – 770 – 1175 RPM, 1.2 Max BHP

MED Static – 1035 – 1466 RPM, 1.5 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

NOTE: Production of single phase units has been discontinued per DOE regulations. Single phase 50TC models are only available until current inventories are exhausted.

FAN PERFORMANCE (cont.)

Table 48 – 50TC06**

3 PHASE

5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	790	0.40	897	0.53	991	0.68	1075	0.83	1152	1.00	1224	1.18	1291	1.36	1354	1.56	1414	1.77	1472	1.98
1625	837	0.48	940	0.62	1030	0.77	1112	0.94	1187	1.11	1257	1.30	1323	1.49	1385	1.69	1445	1.90	1501	2.12
1750	885	0.58	983	0.73	1070	0.89	1150	1.06	1223	1.24	1292	1.43	1356	1.63	1418	1.83	1476	2.05	1532	2.27
1875	934	0.69	1027	0.85	1112	1.01	1189	1.19	1260	1.38	1327	1.57	1391	1.78	1451	1.99	1509	2.21	1564	2.44
2000	983	0.81	1073	0.98	1154	1.16	1229	1.34	1299	1.53	1364	1.74	1427	1.95	1486	2.17	1542	2.39	1596	2.63
2125	1033	0.95	1119	1.13	1198	1.31	1270	1.50	1338	1.71	1402	1.92	1463	2.13	1521	2.36	1577	2.59	1630	2.83
2250	1084	1.11	1166	1.29	1242	1.49	1312	1.69	1379	1.89	1441	2.11	1501	2.34	1558	2.57	1612	2.81	-	-
2375	1134	1.28	1214	1.48	1287	1.68	1355	1.89	1420	2.10	1481	2.33	1539	2.56	1595	2.80	-	-	-	-
2500	1185	1.48	1262	1.68	1333	1.89	1399	2.10	1462	2.33	1522	2.56	1579	2.80	-	-	-	-	-	-

STD Static – 819 – 1251 RPM, 1.7 Max BHP

MED Static – 1035 – 1466 RPM, 1.7 Max BHP

HIGH Static – 1250 – 1687 RPM, 2.9 Max BHP

For more information, see General Fan Performance Notes on page 59.

Table 49 – 50TC06**

3 PHASE

5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	724	0.33	837	0.45	937	0.59	1028	0.74	1111	0.91	1188	1.09	1261	1.29	1330	1.49	1395	1.71	1457	1.95
1625	765	0.40	873	0.53	969	0.67	1056	0.83	1137	1.00	1213	1.18	1284	1.38	1352	1.59	1416	1.81	1478	2.04
1750	806	0.48	909	0.61	1002	0.76	1087	0.92	1165	1.10	1239	1.28	1309	1.49	1375	1.70	1439	1.92	1499	2.16
1875	849	0.57	947	0.71	1036	0.86	1118	1.03	1195	1.21	1267	1.40	1335	1.60	1400	1.82	1462	2.04	1522	2.28
2000	892	0.67	986	0.82	1072	0.98	1151	1.15	1226	1.33	1296	1.53	1363	1.74	1427	1.95	1488	2.18	1546	2.42
2125	935	0.79	1025	0.94	1108	1.11	1185	1.29	1258	1.47	1326	1.67	1392	1.88	1454	2.11	1514	2.34	1571	2.58
2250	980	0.92	1066	1.08	1146	1.25	1220	1.43	1291	1.63	1358	1.83	1421	2.05	1483	2.27	1541	2.51	1598	2.75
2375	1024	1.06	1107	1.23	1184	1.41	1256	1.60	1325	1.79	1390	2.00	1452	2.22	1512	2.45	1570	2.69	-	-
2500	1069	1.22	1149	1.39	1223	1.58	1293	1.77	1360	1.98	1424	2.19	1484	2.42	1543	2.65	1599	2.89	-	-

STD Static – 770 – 1175 RPM, 1.7 Max BHP

MED Static – 1180 – 1500 RPM, 1.7 Max BHP

HIGH Static – 1250 – 1687 RPM, 2.9 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 50 – 50TC**07

3 PHASE

6 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	907	0.63	1006	0.80	1092	0.97	1169	1.14	1239	1.32	1304	1.51	1365	1.69	1422	1.88	1477	2.08	1528	2.28
1950	965	0.77	1060	0.95	1143	1.13	1218	1.32	1287	1.51	1350	1.71	1410	1.91	1467	2.11	1520	2.31	1572	2.52
2100	1024	0.93	1115	1.12	1195	1.32	1268	1.52	1335	1.72	1398	1.93	1457	2.14	1512	2.35	1565	2.57	1616	2.79
2250	1083	1.11	1170	1.32	1248	1.53	1319	1.74	1385	1.96	1446	2.18	1504	2.40	1559	2.62	1611	2.85	1661	3.09
2400	1143	1.32	1227	1.54	1302	1.76	1371	1.99	1435	2.22	1496	2.45	1552	2.68	1606	2.92	1658	3.16	1707	3.40
2550	1203	1.55	1284	1.78	1357	2.02	1424	2.26	1487	2.50	1546	2.75	1601	2.99	1654	3.24	1705	3.50	-	-
2700	1264	1.81	1342	2.06	1412	2.31	1478	2.56	1539	2.82	1597	3.07	1651	3.33	1703	3.59	-	-	-	-
2850	1326	2.09	1400	2.36	1469	2.62	1532	2.89	1592	3.16	1648	3.43	1702	3.70	-	-	-	-	-	-
3000	1387	2.41	1459	2.69	1525	2.97	1587	3.25	1646	3.53	-	-	-	-	-	-	-	-	-	-

STD Static – 1073–1457 RPM, 2.4 Max BHP

MED Static – 1173–1518 RPM, 2.9 Max BHP

HIGH Static – 1474–1788 RPM, 3.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

Table 51 – 50TC**07

3 PHASE

6 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	822	0.51	927	0.66	1018	0.82	1100	0.98	1174	1.15	1244	1.33	1308	1.51	1369	1.70	1427	1.90	1483	2.10
1950	872	0.62	973	0.79	1061	0.95	1140	1.13	1213	1.31	1281	1.49	1345	1.68	1405	1.88	1462	2.09	1517	2.30
2100	923	0.75	1019	0.92	1104	1.10	1182	1.29	1253	1.48	1320	1.67	1382	1.87	1441	2.08	1498	2.29	1552	2.51
2250	974	0.90	1067	1.08	1149	1.27	1224	1.46	1294	1.66	1359	1.87	1420	2.08	1479	2.29	1534	2.51	1587	2.74
2400	1026	1.06	1115	1.26	1195	1.46	1268	1.66	1336	1.87	1400	2.09	1460	2.31	1517	2.53	1572	2.76	1624	2.99
2550	1079	1.25	1164	1.46	1241	1.67	1312	1.88	1379	2.10	1441	2.33	1500	2.55	1557	2.79	1610	3.03	1662	3.27
2700	1132	1.46	1214	1.67	1289	1.90	1358	2.12	1422	2.35	1483	2.59	1541	2.83	1597	3.07	1650	3.32	1701	3.57
2850	1186	1.69	1264	1.92	1336	2.15	1404	2.39	1467	2.63	1527	2.87	1583	3.12	1638	3.37	1690	3.63	-	-
3000	1240	1.94	1315	2.18	1385	2.43	1451	2.68	1512	2.93	1571	3.18	1626	3.44	1680	3.70	-	-	-	-

STD Static – 1073–1457 RPM, 2.4 Max BHP

MED Static – 1173–1518 RPM, 2.9 Max BHP

HIGH Static – 1474–1788 RPM, 3.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 52 – 50TC**08

3 PHASE

7.5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	511	0.53	591	0.73	660	0.95	722	1.19	779	1.44	832	1.71	882	1.99	928	2.29	973	2.59	1015	2.92
2438	540	0.64	616	0.85	683	1.08	743	1.33	799	1.59	851	1.87	899	2.16	945	2.46	989	2.78	1031	3.11
2625	569	0.76	642	0.99	706	1.23	765	1.49	819	1.76	870	2.04	918	2.34	963	2.66	1006	2.98	1048	3.32
2813	599	0.90	669	1.14	731	1.39	788	1.66	841	1.94	890	2.24	937	2.55	982	2.87	1024	3.21	1065	3.55
3000	630	1.06	696	1.31	756	1.58	811	1.86	863	2.15	912	2.46	958	2.78	1001	3.11	1043	3.45	1083	3.80
3188	661	1.23	724	1.50	782	1.78	836	2.07	886	2.38	934	2.69	979	3.02	1022	3.36	1063	3.72	1102	4.08
3375	692	1.43	753	1.71	809	2.00	861	2.31	910	2.62	956	2.95	1000	3.29	1042	3.64	1083	4.00	1122	4.38
3563	723	1.65	782	1.94	836	2.25	887	2.56	934	2.89	980	3.23	1023	3.58	1064	3.94	1104	4.32	1142	4.70
3750	755	1.89	811	2.20	864	2.52	913	2.84	959	3.18	1004	3.54	1046	3.90	1086	4.27	1125	4.65	–	–

STD Static – 489 – 747 RPM, 1.7 Max BHP

MED Static – 733 – 949 RPM, 2.9 Max BHP

HIGH Static – 909 – 1102 RPM, 4.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

Table 53 – 50TC**08

3 PHASE

7.5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	465	0.43	555	0.64	629	0.86	694	1.10	753	1.34	806	1.60	856	1.87	903	2.15	947	2.45	988	2.75
2438	488	0.51	575	0.73	648	0.97	712	1.21	769	1.47	822	1.74	872	2.03	918	2.32	961	2.62	1003	2.93
2625	510	0.60	595	0.84	666	1.09	729	1.34	786	1.62	839	1.90	887	2.19	933	2.49	977	2.81	1018	3.13
2813	533	0.70	616	0.95	686	1.22	748	1.49	804	1.77	856	2.06	904	2.37	949	2.68	992	3.01	1033	3.34
3000	557	0.82	637	1.08	705	1.36	766	1.64	822	1.94	873	2.24	921	2.56	966	2.89	1008	3.22	1049	3.56
3188	581	0.94	659	1.23	726	1.51	785	1.81	840	2.12	891	2.44	938	2.77	982	3.10	1025	3.45	1065	3.81
3375	606	1.08	681	1.38	746	1.68	805	2.00	859	2.32	909	2.65	955	2.99	1000	3.34	1041	3.70	1081	4.06
3563	630	1.24	703	1.55	767	1.87	825	2.20	878	2.53	927	2.88	973	3.23	1017	3.59	1059	3.96	1098	4.34
3750	655	1.41	726	1.74	789	2.07	845	2.41	897	2.76	946	3.12	992	3.48	1035	3.86	1076	4.24	1115	4.63

STD Static – 489 – 747 RPM, 1.7 Max BHP

MED Static – 733 – 949 RPM, 2.9 Max BHP

HIGH Static – 909 – 1102 RPM, 4.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 54 – 50TC09**

3 PHASE

8.5 VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	477	0.43	556	0.57	624	0.71	685	0.85	742	0.99	794	1.14	842	1.29	888	1.44	932	1.59	973	1.75
2763	503	0.52	578	0.67	644	0.82	704	0.97	759	1.13	810	1.28	858	1.44	903	1.60	946	1.77	987	1.93
2975	529	0.62	601	0.79	665	0.95	724	1.11	777	1.28	827	1.44	874	1.61	919	1.78	961	1.95	1001	2.13
3188	556	0.74	625	0.92	687	1.09	744	1.26	796	1.44	845	1.62	891	1.79	935	1.98	977	2.16	1017	2.34
3400	583	0.88	650	1.06	710	1.24	765	1.43	816	1.62	864	1.80	909	1.99	952	2.18	993	2.38	1033	2.57
3613	611	1.03	675	1.22	733	1.42	787	1.61	836	1.81	883	2.01	928	2.21	970	2.41	1010	2.61	1049	2.82
3825	639	1.19	701	1.40	757	1.61	809	1.81	857	2.02	903	2.23	947	2.44	988	2.65	1028	2.87	1066	3.08
4038	668	1.38	727	1.60	781	1.81	832	2.03	879	2.25	924	2.47	967	2.70	1008	2.92	1047	3.14	1084	3.37
4250	696	1.58	753	1.81	806	2.04	855	2.27	901	2.50	945	2.73	987	2.97	1027	3.20	1066	3.43	1103	3.67

STD Static – 518 – 733 RPM, 1.7 Max BHP

MED Static – 690 – 936 RPM, 2.4 Max BHP

HIGH Static – 838 – 1084 RPM, 3.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

Table 55 – 50TC09**

3 PHASE

8.5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	438	0.39	523	0.50	595	0.64	658	0.78	716	0.94	769	1.11	819	1.30	865	1.49	909	1.70	951	1.92
2763	459	0.47	541	0.60	611	0.73	673	0.88	730	1.05	782	1.22	831	1.41	877	1.60	921	1.81	963	2.04
2975	481	0.56	560	0.70	628	0.84	689	1.00	745	1.16	796	1.34	845	1.53	890	1.73	933	1.94	974	2.16
3188	504	0.67	580	0.82	646	0.97	705	1.13	760	1.30	811	1.48	858	1.67	903	1.88	946	2.09	987	2.31
3400	526	0.80	600	0.95	664	1.11	722	1.27	776	1.45	826	1.63	873	1.83	917	2.04	959	2.25	1000	2.48
3613	550	0.94	620	1.10	683	1.26	740	1.43	793	1.62	842	1.81	888	2.01	932	2.22	973	2.44	1013	2.67
3825	573	1.09	641	1.26	702	1.43	758	1.61	810	1.80	858	2.00	903	2.20	946	2.42	988	2.64	1027	2.87
4038	597	1.26	663	1.44	722	1.62	777	1.81	827	2.00	875	2.20	919	2.41	962	2.63	1002	2.86	1041	3.10
4250	621	1.45	685	1.64	743	1.83	796	2.02	845	2.22	892	2.43	936	2.65	978	2.87	1018	3.10	1056	3.34

STD Static – 518 – 733 RPM, 1.7 Max BHP

MED Static – 690 – 936 RPM, 2.4 Max BHP

HIGH Static – 838 – 1084 RPM, 3.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 56 – 50TC12**

3 PHASE

10 VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	556	0.65	623	0.80	684	0.95	738	1.11	789	1.26	836	1.42	881	1.57	923	1.73	963	1.89	1001	2.05
3250	590	0.79	655	0.96	713	1.13	766	1.29	815	1.46	861	1.63	904	1.79	945	1.96	985	2.13	1023	2.30
3500	625	0.96	687	1.14	742	1.32	794	1.50	841	1.68	886	1.86	929	2.04	969	2.22	1008	2.40	1045	2.58
3750	661	1.16	719	1.35	773	1.54	822	1.73	869	1.93	912	2.12	954	2.31	994	2.50	1031	2.70	1068	2.89
4000	697	1.37	753	1.58	804	1.79	852	1.99	897	2.20	940	2.40	980	2.61	1019	2.81	1056	3.02	1092	3.22
4250	733	1.62	787	1.84	836	2.06	883	2.28	926	2.49	968	2.71	1007	2.93	1045	3.15	1081	3.36	1117	3.58
4500	770	1.89	821	2.13	869	2.36	914	2.59	956	2.82	996	3.05	1035	3.28	1072	3.51	1108	3.74	1142	3.97
4750	807	2.20	856	2.45	902	2.69	945	2.94	986	3.18	1026	3.42	1063	3.66	1100	3.91	1135	4.15	1168	4.39
5000	844	2.54	891	2.80	936	3.06	978	3.31	1018	3.57	1056	3.82	1093	4.08	1128	4.34	1162	4.59	-	-

STD Static – 591 – 838 RPM, 2.4 Max BHP

MED Static – 838 – 1084 RPM, 3.7 Max BHP

HIGH Static – 1022 – 1240 RPM, 4.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

Table 57 – 50TC12**

3 PHASE

10 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	523	0.58	592	0.73	657	0.88	718	1.05	775	1.22	830	1.39	883	1.57	934	1.76	982	1.95	1029	2.14
3250	555	0.71	620	0.87	681	1.04	739	1.21	794	1.39	847	1.57	897	1.76	946	1.96	993	2.16	1039	2.36
3500	588	0.86	649	1.03	707	1.21	762	1.39	815	1.58	865	1.77	914	1.97	961	2.18	1007	2.38	1051	2.60
3750	621	1.03	679	1.21	734	1.40	786	1.59	837	1.79	885	1.99	932	2.20	978	2.42	1022	2.64	1065	2.86
4000	655	1.23	709	1.42	761	1.61	812	1.82	860	2.03	907	2.24	952	2.46	996	2.68	1038	2.91	1080	3.14
4250	689	1.45	741	1.65	790	1.86	838	2.07	885	2.29	930	2.51	973	2.74	1015	2.97	1057	3.21	1097	3.45
4500	723	1.69	773	1.90	820	2.12	866	2.35	910	2.57	954	2.81	996	3.05	1037	3.29	1076	3.54	1115	3.79
4750	758	1.96	805	2.19	850	2.42	894	2.65	937	2.89	979	3.13	1019	3.38	1059	3.63	1097	3.89	1135	4.15
5000	793	2.26	838	2.50	881	2.74	923	2.98	965	3.23	1005	3.49	1044	3.74	1082	4.01	1119	4.27	1156	4.55

STD Static – 591 – 838 RPM, 2.4 Max BHP

MED Static – 838 – 1084 RPM, 3.7 Max BHP

HIGH Static – 1022 – 1240 RPM, 4.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 58 – 50TC14**

3 PHASE

12.5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																							
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0					
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP				
3438	616	0.92	679	1.10	735	1.27	786	1.45	835	1.62	880	1.80	922	1.98	963	2.15	1002	2.33	1039	2.51				
3750	661	1.16	719	1.35	773	1.54	822	1.73	869	1.93	912	2.12	954	2.31	994	2.50	1031	2.70	1068	2.89				
4063	706	1.43	761	1.64	812	1.85	860	2.06	904	2.27	947	2.48	987	2.68	1025	2.89	1062	3.10	1098	3.31				
4375	752	1.75	804	1.98	852	2.20	898	2.43	941	2.65	982	2.88	1021	3.10	1058	3.32	1094	3.55	1129	3.77				
4688	798	2.12	847	2.36	894	2.60	937	2.85	979	3.09	1018	3.33	1056	3.57	1093	3.81	1128	4.04	1162	4.29				
5000	844	2.54	891	2.80	936	3.06	978	3.31	1018	3.57	1056	3.82	1093	4.08	1128	4.34	1162	4.59	-	-				
5313	891	3.01	936	3.28	978	3.56	1019	3.83	1057	4.11	1094	4.38	1130	4.65	-	-	-	-	-	-				
5625	938	3.53	981	3.83	1022	4.12	1060	4.41	1097	4.70	-	-	-	-	-	-	-	-	-	-				
5938	986	4.12	1026	4.43	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
6250	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				

STD Static – 652 – 843 RPM, 2.9 Max BHP

MED Static – 838 – 1084 RPM, 3.7 Max BHP

HIGH Static – 1022 – 1240 RPM, 4.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

Table 59 – 50TC14**

3 PHASE

12.5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																							
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0					
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP				
3438	580	0.82	642	0.99	700	1.16	756	1.34	809	1.53	860	1.72	910	1.92	957	2.12	1003	2.32	1048	2.54				
3750	621	1.03	679	1.21	734	1.40	786	1.59	837	1.79	885	1.99	932	2.20	978	2.42	1022	2.64	1065	2.86				
4063	663	1.28	717	1.47	769	1.67	818	1.88	866	2.09	912	2.31	957	2.53	1001	2.75	1043	2.98	1084	3.22				
4375	706	1.56	757	1.77	805	1.98	852	2.20	897	2.43	941	2.66	984	2.89	1026	3.13	1066	3.37	1106	3.62				
4688	749	1.89	797	2.11	843	2.34	887	2.57	930	2.81	972	3.05	1013	3.29	1053	3.54	1092	3.80	1130	4.06				
5000	793	2.26	838	2.50	881	2.74	923	2.98	965	3.23	1005	3.49	1044	3.74	1082	4.01	1119	4.27	1156	4.55				
5313	837	2.69	880	2.93	921	3.19	961	3.44	1000	3.71	1038	3.97	1076	4.24	1113	4.52	-	-	-	-				
5625	882	3.16	922	3.42	961	3.68	999	3.95	1037	4.23	1073	4.51	-	-	-	-	-	-	-	-				
5938	926	3.68	964	3.96	1001	4.23	1038	4.52	-	-	-	-	-	-	-	-	-	-	-	-				
6250	971	4.26	1007	4.55	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				

STD Static – 652 – 843 RPM, 2.9 Max BHP

MED Static – 838 – 1084 RPM, 3.7 Max BHP

HIGH Static – 1022 – 1240 RPM, 4.7 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 60 – 50TC**16

3 PHASE

15 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4500	425	0.76	490	1.02	550	1.30	607	1.61	664	1.96	719	2.34	772	2.76	823	3.20	872	3.67	918	4.16
4875	448	0.92	510	1.20	566	1.49	621	1.81	674	2.15	725	2.54	776	2.95	825	3.40	873	3.87	919	4.37
5250	472	1.10	531	1.40	584	1.70	636	2.03	686	2.38	734	2.76	783	3.18	830	3.63	876	4.10	920	4.60
5625	496	1.30	552	1.62	603	1.94	652	2.28	699	2.64	746	3.03	791	3.44	836	3.89	880	4.36	923	4.86
6000	520	1.52	574	1.86	623	2.20	670	2.55	715	2.92	759	3.32	802	3.74	845	4.18	887	4.66	928	5.16
6375	544	1.77	596	2.13	644	2.49	688	2.86	731	3.24	773	3.64	814	4.07	855	4.52	895	4.99	935	5.49
6750	568	2.05	618	2.43	664	2.81	707	3.19	749	3.59	789	4.00	828	4.43	867	4.89	905	5.36	943	5.87
7125	593	2.35	641	2.75	685	3.16	727	3.56	767	3.97	806	4.39	844	4.84	881	5.29	917	5.78	-	-
7500	617	2.69	664	3.11	707	3.53	747	3.95	786	4.38	823	4.82	860	5.27	895	5.74	-	-	-	-

STD Static – 507 – 676 RPM, 2.9 Max BHP

MED Static – 627 – 851 RPM, 3.7 Max BHP

HIGH Static – 776 – 955 RPM, 6.1 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

Table 61 – 50TC**16

3 PHASE

15 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4500	423	0.77	487	0.99	545	1.22	601	1.47	655	1.73	707	2.02	758	2.33	806	2.66	853	3.01	898	3.37
4875	447	0.94	507	1.18	563	1.42	615	1.67	666	1.95	716	2.24	764	2.55	811	2.89	856	3.24	900	3.61
5250	471	1.13	528	1.38	581	1.64	631	1.91	679	2.19	726	2.49	772	2.81	817	3.14	860	3.50	903	3.87
5625	496	1.35	550	1.62	600	1.89	648	2.17	694	2.46	738	2.77	782	3.09	825	3.43	867	3.79	908	4.17
6000	520	1.59	572	1.88	620	2.17	666	2.46	710	2.76	752	3.08	794	3.41	835	3.76	875	4.12	914	4.50
6375	545	1.86	594	2.17	640	2.47	684	2.78	726	3.10	767	3.42	807	3.76	846	4.12	885	4.49	923	4.87
6750	571	2.17	617	2.48	661	2.81	704	3.13	744	3.46	784	3.80	822	4.15	859	4.51	896	4.89	933	5.28
7125	596	2.50	640	2.83	683	3.17	724	3.52	763	3.86	801	4.22	838	4.58	874	4.95	909	5.33	944	5.73
7500	622	2.87	663	3.22	705	3.58	744	3.93	782	4.30	818	4.66	854	5.04	889	5.42	923	5.81	-	-

STD Static – 507 – 676 RPM, 2.9 Max BHP

MED Static – 627 – 851 RPM, 3.7 Max BHP

HIGH Static – 776 – 955 RPM, 6.1 Max BHP

Bold Face = Field Supplied Drive Required.

For more information, see General Fan Performance Notes on page 59.

FAN PERFORMANCE (cont.)

Table 62 – PULLEY ADJUSTMENT

UNIT	MOTOR/DRIVE COMBO	MOTOR PULLEY TURNS OPEN (RPM)											
		0.0	0.5	1.0	1.5	2.0	2.5	3.0	3.5	4.0	4.5	5.0	
04	1 phase*	Standard Static	854	825	795	766	736	707	678	648	619	589	560
		Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
		High Static	–	–	–	–	–	–	–	–	–	–	–
	3 phase	Standard Static	854	825	795	766	736	707	678	648	619	589	560
		Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
		High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
05	1 phase*	Standard Static	854	825	795	766	736	707	678	648	619	589	560
		Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
		High Static	–	–	–	–	–	–	–	–	–	–	–
	3 phase	Standard Static	854	825	795	766	736	707	678	648	619	589	560
		Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
		High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
06	1 phase*	Standard Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
		Medium Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
		High Static	–	–	–	–	–	–	–	–	–	–	–
	3 phase	Standard Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
		Medium Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
		High Static	1687	1649	1610	1572	1533	1495	1457	1418	1380	1341	1303
07	3 phase	Standard Static	1457	1419	1380	1342	1303	1265	1227	1188	1150	1111	1073
		Medium Static	1518	1484	1449	1415	1380	1346	1311	1277	1242	1208	1173
		High Static	1788	1757	1725	1694	1662	1631	1600	1568	1537	1505	1474
08	3 phase	Standard Static	747	721	695	670	644	618	592	566	541	515	489
		Medium Static	949	927	906	884	863	841	819	798	776	755	733
		High Static	1102	1083	1063	1044	1025	1006	986	967	948	928	909
09	3 phase	Standard Static	733	712	690	669	647	626	604	583	561	540	518
		Medium Static	936	911	887	862	838	813	788	764	739	715	690
		High Static	1084	1059	1035	1010	986	961	936	912	887	863	838
12	3 phase	Standard Static	838	813	789	764	739	715	690	665	640	616	591
		Medium Static	1084	1059	1035	1010	986	961	936	912	887	863	838
		High Static	1240	1218	1196	1175	1153	1131	1109	1087	1066	1044	1022
14	3 phase	Standard Static	843	824	805	786	767	748	728	709	690	671	652
		Medium Static	1084	1059	1035	1010	986	961	936	912	887	863	838
		High Static	1240	1218	1196	1175	1153	1131	1109	1087	1066	1044	1022
16	3 phase	Standard Static	676	659	642	625	608	592	575	558	541	524	507
		Medium Static	851	829	806	784	761	739	717	694	672	649	627
		High Static	955	937	919	901	883	866	848	830	812	794	776

NOTE: Do not adjust pulley further than 5 turns open.

■ – Factory settings

* Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRICAL INFORMATION

Table 63 – 50TC-*04 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 3 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60†	187	253	16.6	79	325	1.5	STD	67%	4.9
					325	1.5	MED	67%	4.9
230-1-60†	187	253	16.6	79	325	1.5	STD	67%	4.9
					325	1.5	MED	67%	4.9
208-3-60	187	253	10.4	73	325	1.5	DD-STD	78%	6.0
					325	1.5	STD	75%	5.2
					325	1.5	MED	75%	5.2
					325	1.5	HIGH	87%	6.9
230-3-60	187	253	10.4	73	325	1.5	DD-STD	78%	6.0
					325	1.5	STD	75%	5.2
					325	1.5	MED	75%	5.2
460-3-60	414	506	5.8	38	325	0.8	HIGH	87%	6.7
					325	0.8	STD	75%	2.6
					325	0.8	MED	75%	2.6
575-3-60	518	633	3.8	37	325	0.6	STD	73%	2.4
					325	0.6	MED	73%	2.4

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

Table 64 – 50TC-*05 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 4 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60†	187	253	21.8	117	325	1.5	STD	67%	4.9
					325	1.5	MED	67%	4.9
230-1-60†	187	253	21.8	117	325	1.5	STD	67%	4.9
					325	1.5	MED	67%	4.9
208-3-60	187	253	13.7	83	325	1.5	DD-STD	78%	6.0
					325	1.5	STD	75%	5.2
					325	1.5	MED	75%	5.2
					325	1.5	HIGH	87%	6.9
230-3-60	187	253	13.7	83	325	1.5	DD-STD	78%	6.0
					325	1.5	STD	75%	5.2
					325	1.5	MED	75%	5.2
460-3-60	414	506	6.2	41	325	0.8	HIGH	87%	6.7
					325	0.8	STD	75%	2.6
					325	0.8	MED	75%	2.6
575-3-60	518	633	4.8	33	325	0.6	STD	73%	2.4
					325	0.6	MED	73%	2.4
					325	0.6	HIGH	78%	2.0

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRICAL INFORMATION cont.

Table 65 – 50TC-*06 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 5 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60 [†]	187	253	26.2	134	325	1.5	STD	67%	4.9
					325	1.5	MED	76%	7.0
230-1-60 [†]	187	253	26.2	134	325	1.5	STD	67%	4.9
					325	1.5	MED	76%	7.0
208-3-60	187	253	15.6	110	325	1.5	DD-STD	78%	7.6
					325	1.5	STD	75%	5.2
					325	1.5	MED	87%	6.9
					325	1.5	HIGH	89%	8.4
230-3-60	187	253	15.6	110	325	1.5	DD-STD	78%	7.6
					325	1.5	STD	75%	5.2
					325	1.5	MED	87%	6.7
					325	1.5	HIGH	89%	8.3
460-3-60	414	506	7.7	52	325	0.8	STD	75%	2.6
					325	0.8	MED	87%	3.4
					325	0.8	HIGH	89%	4.2
575-3-60	518	633	5.8	39	325	0.6	STD	73%	2.4
					325	0.6	MED	78%	2.0
					325	0.6	HIGH	77%	2.8

[†] Single phase voltage models has been discontinued per DOE regulations and will only be available until current inventories are exhausted.

ELECTRICAL INFORMATION cont.

Table 66 – 50TC-*07 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 6 TONS
(Units Produced On or Prior to 02/08/2015)

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	325	1.5	STD	87%	6.9
					325	1.5	MED	89%	8.4
					325	1.5	HIGH	87%	10.6
230-3-60	187	253	19.0	123	325	1.5	STD	87%	6.7
					325	1.5	MED	89%	8.3
					325	1.5	HIGH	87%	10.6
460-3-60	414	506	9.7	62	325	0.8	STD	87%	3.4
					325	0.8	MED	89%	4.2
					325	0.8	HIGH	87%	5.3
575-3-60	518	633	7.4	50	325	0.6	STD	78%	2.0
					325	0.6	MED	77%	2.8
					325	0.6	HIGH	77%	2.8

(Units Produced Between 02/09/2015 and 06/17/2015)

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.6	136	325	1.5	STD	87%	6.9
					325	1.5	MED	89%	8.4
					325	1.5	HIGH	87%	10.6
230-3-60	187	253	19.6	136	325	1.5	STD	87%	6.7
					325	1.5	MED	89%	8.3
					325	1.5	HIGH	87%	10.6
460-3-60	414	506	8.2	66	325	0.8	STD	87%	3.4
					325	0.8	MED	89%	4.2
					325	0.8	HIGH	87%	5.3
575-3-60	518	633	6.6	55	325	0.6	STD	78%	2.0
					325	0.6	MED	77%	2.8
					325	0.6	HIGH	77%	2.8

(Units Produced on or After 06/18/2015)

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.6	136	325	1.5	STD	69%	5.2
					325	1.5	MED	89%	8.4
					325	1.5	HIGH	87%	10.6
230-3-60	187	253	19.6	136	325	1.5	STD	69%	5.2
					325	1.5	MED	89%	8.3
					325	1.5	HIGH	87%	10.6
460-3-60	414	506	8.2	66	325	0.8	STD	69%	2.6
					325	0.8	MED	89%	4.2
					325	0.8	HIGH	87%	5.3
575-3-60	518	633	6.6	55	325	0.6	STD	78%	2.0
					325	0.6	MED	77%	2.8
					325	0.6	HIGH	77%	2.8

ELECTRICAL INFORMATION cont.

Table 67 – 50TC-*08 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 7.5 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		IFM
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	25.0	164	325	1.5	STD	75%	5.2
					325	1.5	MED	89%	8.4
					325	1.5	HIGH	83%	13.6
230-3-60	187	253	25.0	164	325	1.5	STD	75%	5.2
					325	1.5	MED	89%	8.3
					325	1.5	HIGH	83%	12.7
460-3-60	414	506	12.2	100	325	0.8	STD	75%	2.6
					325	0.8	MED	89%	4.2
					325	0.8	HIGH	83%	6.4
575-3-60	518	633	9.0	78	325	0.6	STD	72%	1.6
					325	0.6	MED	77%	2.8
					325	0.6	HIGH	81%	5.6

Table 68 – 50TC-*08 2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 7.5 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	75%	5.2
							325	1.5	MED	89%	8.4
							325	1.5	HIGH	83%	13.6
230-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	75%	5.2
							325	1.5	MED	89%	8.3
							325	1.5	HIGH	83%	12.7
460-3-60	414	506	6.1	41	6.1	41	325	0.8	STD	75%	5.2
							325	0.8	MED	89%	4.2
							325	0.8	HIGH	83%	6.4
575-3-60	518	633	4.2	33	4.2	33	325	0.6	STD	72%	1.6
							325	0.6	MED	77%	2.8
							325	0.6	HIGH	81%	5.6

Table 69 – 50TC-*08 2-STAGE COOLING WITH 2 SPEED INDOOR FAN MOTOR 7.5 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	84%	5.8
							325	1.5	MED	85%	8.6
							325	1.5	HIGH	84%	13.6
230-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	84%	5.6
							325	1.5	MED	85%	7.8
							325	1.5	HIGH	84%	12.7
460-3-60	414	506	6.1	41	6.1	41	325	0.8	STD	79%	2.9
							325	0.8	MED	85%	3.8
							325	0.8	HIGH	84%	6.4
575-3-60	518	633	4.2	33	4.2	33	325	0.6	STD	81%	2.8
							325	0.6	MED	84%	4.5
							325	0.6	HIGH	83%	6.2

ELECTRICAL INFORMATION cont.

Table 70 – 50TC-#09 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 8.5 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	29.5	195	325	1.5	STD	75%	5.2
					325	1.5	MED	87%	6.9
					325	1.5	HIGH	87%	10.6
230-3-60	187	253	29.5	195	325	1.5	STD	75%	5.2
					325	1.5	MED	87%	6.7
					325	1.5	HIGH	87%	10.6
460-3-60	414	506	14.7	95	325	0.8	STD	75%	2.6
					325	0.8	MED	87%	3.4
					325	0.8	HIGH	87%	5.3
575-3-60	518	633	12.2	80	325	0.6	STD	72%	1.6
					325	0.6	MED	78%	2.0
					325	0.6	HIGH	77%	2.8

Table 71 – 50TC-#09 2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 8.5 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	14.5	98	13.7	83	325	1.5	STD	75%	5.2
							325	1.5	MED	87%	6.9
							325	1.5	HIGH	87%	10.6
230-3-60	187	253	14.5	98	13.7	83	325	1.5	STD	75%	5.2
							325	1.5	MED	87%	6.7
							325	1.5	HIGH	87%	10.6
460-3-60	414	506	6.3	55	6.2	41	325	0.8	STD	75%	2.6
							325	0.8	MED	87%	3.4
							325	0.8	HIGH	87%	5.3
575-3-60	518	633	6.0	41	4.8	33	325	0.6	STD	72%	1.6
							325	0.6	MED	78%	2.0
							325	0.6	HIGH	77%	2.8

Table 72 – 50TC-#09 2-STAGE COOLING WITH 2 SPEED INDOOR FAN MOTOR 8.5 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	14.5	98	13.7	83	325	1.5	STD	84%	5.8
							325	1.5	MED	77%	7.1
							325	1.5	HIGH	82%	10.8
230-3-60	187	253	14.5	98	13.7	83	325	1.5	STD	84%	5.6
							325	1.5	MED	77%	6.8
							325	1.5	HIGH	82%	9.8
460-3-60	414	506	6.3	55	6.2	41	325	0.8	STD	79%	2.9
							325	0.8	MED	77%	3.8
							325	0.8	HIGH	82%	4.9
575-3-60	518	633	6.0	41	4.8	33	325	0.6	STD	81%	2.8
							325	0.6	MED	80%	3.5
							325	0.6	HIGH	84%	4.5

ELECTRICAL INFORMATION cont.

Table 73 – 50TC-*12 1-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 10 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP		OFM		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	30.1	225	325	1.5	STD	69%	5.2
					325	1.5	MED	87%	10.6
					325	1.5	HIGH	83%	13.6
230-3-60	187	253	30.1	225	325	1.5	STD	69%	5.2
					325	1.5	MED	87%	10.6
					325	1.5	HIGH	83%	12.7
460-3-60	414	506	16.7	114	325	0.8	STD	69%	2.6
					325	0.8	MED	87%	5.3
					325	0.8	HIGH	83%	6.4
575-3-60	518	633	12.2	80	325	0.6	STD	78%	2.0
					325	0.6	MED	77%	2.8
					325	0.6	HIGH	81%	5.6

Table 74 – 50TC-*12 2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 10 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.6	110	15.9	110	325	1.5	STD	69%	5.2
							325	1.5	MED	87%	10.6
							325	1.5	HIGH	83%	13.6
230-3-60	187	253	15.6	110	15.9	110	325	1.5	STD	69%	5.2
							325	1.5	MED	87%	10.6
							325	1.5	HIGH	83%	12.7
460-3-60	414	506	7.7	52	7.7	52	325	0.8	STD	69%	2.6
							325	0.8	MED	87%	5.3
							325	0.8	HIGH	83%	6.4
575-3-60	518	633	5.8	39	5.7	39	325	0.6	STD	78%	2.0
							325	0.6	MED	77%	2.8
							325	0.6	HIGH	81%	5.6

Table 75 – 50TC-*12 2-STAGE COOLING WITH 2 SPEED INDOOR FAN MOTOR 10 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.6	110	15.9	110	325	1.5	STD	77%	7.1
							325	1.5	MED	82%	10.8
							325	1.5	HIGH	84%	13.6
230-3-60	187	253	15.6	110	15.9	110	325	1.5	STD	77%	6.8
							325	1.5	MED	82%	9.8
							325	1.5	HIGH	84%	12.7
460-3-60	414	506	7.7	52	7.7	52	325	0.8	STD	77%	3.8
							325	0.8	MED	82%	4.9
							325	0.8	HIGH	84%	6.4
575-3-60	518	633	5.8	39	5.7	39	325	0.6	STD	80%	3.5
							325	0.6	MED	84%	4.5
							325	0.6	HIGH	83%	6.2

ELECTRICAL INFORMATION cont.

Table 76 – 50TC-*14 2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 12.5 TONS
(Units Produced on or Prior to 02/15/2015)

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	22.4	149	1070	6.2	STD	89%	8.4
							1070	6.2	MED	87%	10.6
							1070	6.2	HIGH	83%	13.6
230-3-60	187	253	19.0	123	22.4	149	1070	6.2	STD	89%	8.3
							1070	6.2	MED	87%	10.6
							1070	6.2	HIGH	83%	12.7
460-3-60	414	506	9.7	62	10.6	75	1070	3.1	STD	89%	4.2
							1070	3.1	MED	87%	5.3
							1070	3.1	HIGH	83%	6.4
575-3-60	518	633	7.4	50	7.7	54	1070	2.5	STD	77%	2.8
							1070	2.5	MED	77%	2.8
							1070	2.5	HIGH	81%	5.6

(Units Produced On or After 02/15/2015)

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.6	136	22.4	149	1070	6.2	STD	89%	8.4
							1070	6.2	MED	87%	10.6
							1070	6.2	HIGH	83%	13.6
230-3-60	187	253	19.6	136	22.4	149	1070	6.2	STD	89%	8.3
							1070	6.2	MED	87%	10.6
							1070	6.2	HIGH	83%	12.7
460-3-60	414	506	8.2	66	10.6	75	1070	3.1	STD	89%	4.2
							1070	3.1	MED	87%	5.3
							1070	3.1	HIGH	83%	6.4
575-3-60	518	633	6.6	55	7.7	54	1070	2.5	STD	77%	2.8
							1070	2.5	MED	77%	2.8
							1070	2.5	HIGH	81%	5.6

ELECTRICAL INFORMATION cont.

Table 77 – 50TC-*14 2-STAGE COOLING WITH 2 SPEED INDOOR FAN MOTOR

12.5 TONS

(Units Produced On or After 02/16/2015)

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.6	136	22.4	149	1070	6.2	STD	85%	8.6
							1070	6.2	MED	82%	10.8
							1070	6.2	HIGH	84%	13.6
230-3-60	187	253	19.6	136	22.4	149	1070	6.2	STD	85%	7.8
							1070	6.2	MED	82%	9.8
							1070	6.2	HIGH	84%	12.7
460-3-60	414	506	8.2	66	10.6	75	1070	3.1	STD	85%	3.8
							1070	3.1	MED	82%	4.9
							1070	3.1	HIGH	84%	6.4
575-3-60	518	633	6.6	55	7.7	54	1070	2.5	STD	84%	4.5
							1070	2.5	MED	84%	4.5
							1070	2.5	HIGH	83%	6.2

(Units Produced on or Prior to 02/15/2015)

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	22.4	149	1070	6.2	STD	85%	8.6
							1070	6.2	MED	82%	10.8
							1070	6.2	HIGH	84%	13.6
230-3-60	187	253	19.0	123	22.4	149	1070	6.2	STD	85%	7.8
							1070	6.2	MED	82%	9.8
							1070	6.2	HIGH	84%	12.7
460-3-60	414	506	9.7	62	10.6	75	1070	3.1	STD	85%	3.8
							1070	3.1	MED	82%	4.9
							1070	3.1	HIGH	84%	6.4
575-3-60	518	633	7.4	50	7.7	54	1070	2.5	STD	84%	4.5
							1070	2.5	MED	84%	4.5
							1070	2.5	HIGH	83%	6.2

ELECTRICAL INFORMATION cont.

Table 78 – 50TC-*16 2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 15 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	25.0	164	25.0	164	280	1.5	STD	89%	8.4
							280	1.5	MED	87%	10.6
							280	1.5	HIGH	90%	20.4
230-3-60	187	253	25.0	164	25.0	164	280	1.5	STD	89%	8.3
							280	1.5	MED	87%	10.6
							280	1.5	HIGH	90%	20.4
460-3-60	414	506	12.2	100	12.8	100	280	0.8	STD	89%	4.2
							280	0.8	MED	87%	5.3
							280	0.8	HIGH	90%	10.2
575-3-60	518	633	9.8	78	9.6	78	280	0.6	STD	77%	2.8
							280	0.6	MED	77%	2.8
							280	0.6	HIGH	94%	9.0

Table 79 – 50TC-*16 2-STAGE COOLING WITH 2 SPEED INDOOR FAN MOTOR 15 TONS

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	25.0	164	25.0	164	280	1.5	STD	85%	8.6
							280	1.5	MED	82%	10.8
							280	1.5	HIGH	90%	20.4
230-3-60	187	253	25.0	164	25.0	164	280	1.5	STD	85%	7.8
							280	1.5	MED	82%	9.8
							280	1.5	HIGH	90%	20.4
460-3-60	414	506	12.2	100	12.8	100	280	0.8	STD	85%	3.8
							280	0.8	MED	82%	4.9
							280	0.8	HIGH	90%	10.2
575-3-60	518	633	9.8	78	9.6	78	280	0.6	STD	84%	4.5
							280	0.6	MED	84%	4.5
							280	0.6	HIGH	94%	9

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 80 – 50TC-#04

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-1-60†	STD	101A00	4.4	3.3/4.0	-	-	-	-
		102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		104B00	10.5	7.9/9.6	040	040	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
	MED	101A00	4.4	3.3/4.0	-	-	-	-
		102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		104B00	10.5	7.9/9.6	040	040	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
208/ 230-3-60	DD-STD	101A00	4.4	3.3/4.0	-	-	-	-
		102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
	STD	101A00	4.4	3.3/4.0	-	-	-	-
		102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
	MED	101A00	4.4	3.3/4.0	-	-	-	-
		102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
	HIGH	101A00	4.4	3.3/4.0	-	-	-	-
		102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
460-3-60	STD	106A00	6.0	5.5	-	-	-	-
		107A00	8.8	8.1	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
	MED	106A00	6.0	5.5	-	-	-	-
		107A00	8.8	8.1	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		106A00	6.0	5.5	-	-	-	-
	HIGH	107A00	8.8	8.1	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		106A00	6.0	5.5	-	-	-	-
		107A00	8.8	8.1	-	-	-	-

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 81 – 50TC-#04

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-1-60†	STD	101A00	4.4	3.3/4.0	037	037	-	-
		102A00	6.5	4.9/6.0	037	037	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		104B00	10.5	7.9/9.6	040	040	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
	MED	101A00	4.4	3.3/4.0	037	037	-	-
		102A00	6.5	4.9/6.0	037	037	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		104B00	10.5	7.9/9.6	040	040	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
208/ 230-3-60	DD-STD	101A00	4.4	3.3/4.0	037	037	037	037
		102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
	STD	101A00	4.4	3.3/4.0	037	037	037	037
		102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
	MED	101A00	4.4	3.3/4.0	037	037	037	037
		102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
	HIGH	101A00	4.4	3.3/4.0	037	037	037	037
		102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
460-3-60	STD	106A00	6.0	5.5	-	-	-	-
		107A00	8.8	8.1	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
	MED	106A00	6.0	5.5	-	-	-	-
		107A00	8.8	8.1	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
	HIGH	106A00	6.0	5.5	-	-	-	-
		107A00	8.8	8.1	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 82 – 50TC-#05

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-1-60†	STD	101A00	4.4	3.3/4.0	-	-	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
		103B00,103B00	17.4	13.1/16.0	040	040	-	-
		104B00,104B00	21.0	15.8/19.3	040	040	-	-
	MED	101A00	4.4	3.3/4.0	-	-	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
		103B00,103B00	17.4	13.1/16.0	040	040	-	-
		104B00,104B00	21.0	15.8/19.3	040	040	-	-
208/ 230-3-60	DD-STD	102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
	STD	102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
	MED	102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
	HIGH	102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
460-3-60	STD	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
	MED	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
	HIGH	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 83 – 50TC-#05

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-1-60†	STD	101A00	4.4	3.3/4.0	037	037	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
		103B00,103B00	17.4	13.1/16.0	040	040	-	-
		104B00,104B00	21.0	15.8/19.3	040	040	-	-
	MED	101A00	4.4	3.3/4.0	037	037	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
		103B00,103B00	17.4	13.1/16.0	040	040	-	-
		104B00,104B00	21.0	15.8/19.3	040	040	-	-
208/ 230-3-60	DD-STD	102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
	STD	102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
	MED	102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
	HIGH	102A00	6.5	4.9/6.0	037	037	037	037
		103B00	8.7	6.5/8.0	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
460-3-60	STD	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
	MED	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
	HIGH	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 84 – 50TC-*06

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-1-60†	STD	102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
		103B00,103B00	17.4	13.1/16.0	040	040	-	-
		104B00,104B00	21.0	15.8/19.3	040	040	-	-
	MED	102A00	6.5	4.9/6.0	-	-	-	-
		103B00	8.7	6.5/8.0	037	037	-	-
		102A00,102A00	13.0	9.8/11.9	040	040	-	-
		103B00,103B00	17.4	13.1/16.0	040	040	-	-
		104B00,104B00	21.0	15.8/19.3	040	040	-	-
208/ 230-3-60	DD-STD	102A00	6.5	4.9/6.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	STD	102A00	6.5	4.9/6.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	MED	102A00	6.5	4.9/6.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	HIGH	102A00	6.5	4.9/6.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	037
		105A00	16.0	12.0/14.7	037	038	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
460-3-60	STD	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	MED	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	HIGH	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 85 – 50TC-*06

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V–PH–Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230–1–60†	STD	102A00	6.5	4.9/6.0	037	037	–	–
		103B00	8.7	6.5/8.0	037	037	–	–
		102A00,102A00	13.0	9.8/11.9	040	040	–	–
		103B00,103B00	17.4	13.1/16.0	040	040	–	–
		104B00,104B00	21.0	15.8/19.3	040	040	–	–
	MED	102A00	6.5	4.9/6.0	037	037	–	–
		103B00	8.7	6.5/8.0	037	037	–	–
		102A00,102A00	13.0	9.8/11.9	040	040	–	–
		103B00,103B00	17.4	13.1/16.0	040	040	–	–
		104B00,104B00	21.0	15.8/19.3	040	040	–	–
208/ 230–3–60	DD–STD	102A00	6.5	4.9/6.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	STD	102A00	6.5	4.9/6.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	MED	102A00	6.5	4.9/6.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	HIGH	102A00	6.5	4.9/6.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	038	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
460–3–60	STD	106A00	6.0	5.5	–	–	–	–
		108A00	11.5	10.6	–	–	–	–
		109A00	14.0	12.9	–	–	–	–
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	MED	106A00	6.0	5.5	–	–	–	–
		108A00	11.5	10.6	–	–	–	–
		109A00	14.0	12.9	–	–	–	–
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	HIGH	106A00	6.0	5.5	–	–	–	–
		108A00	11.5	10.6	–	–	–	–
		109A00	14.0	12.9	–	–	–	–
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

† Single phase voltage models have been discontinued per DOE regulations and are only available until current inventories are exhausted.

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 86 – 50TC-*07

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwr fr/unit)	NO P.E.	w/P.E. (pwr fr/unit)
208/ 230-3-60	STD	102A00	6.5	4.9/6.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	-
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	MED	102A00	6.5	4.9/6.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	-	037
		105A00	16.0	12.0/14.7	037	038	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	HIGH	102A00	6.5	4.9/6.0	-	-	-	-
		104B00	10.5	7.9/9.6	-	-	037	037
		105A00	16.0	12.0/14.7	038	038	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
460-3-60	STD	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	MED	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	HIGH	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 87 – 50TC-*07

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	102A00	6.5	4.9/6.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	037	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	MED	102A00	6.5	4.9/6.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	037	038	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
	HIGH	102A00	6.5	4.9/6.0	037	037	037	037
		104B00	10.5	7.9/9.6	037	037	037	037
		105A00	16.0	12.0/14.7	038	038	038	038
		104B00,104B00	21.0	15.8/19.3	038	038	038	038
		104B00,105A00	26.5	19.9/24.3	038	038	038	038
460-3-60	STD	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	MED	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037
	HIGH	106A00	6.0	5.5	-	-	-	-
		108A00	11.5	10.6	-	-	-	-
		109A00	14.0	12.9	-	-	-	-
		108A00,108A00	23.0	21.1	037	037	037	037
		108A00,109A00	25.5	23.4	037	037	037	037

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 88 – 50TC-#08

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	042	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	MED	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	043	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	HIGH	117A00	10.4	7.8/9.6	042	042	042	043
		110A00	16.0	12.0/14.7	043	043	043	043
111A00		24.8	18.6/22.8	043	043	043	043	
112A00		32.0	24.0/29.4	043	043	043	043	
112A00,117A00		42.4	31.8/38.9	045	045	045	045	
460-3-60	STD	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	MED	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	HIGH	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
114A00		27.8	25.5	042	042	042	042	
115A00		33.0	30.3	042	042	044	044	
114A00,116A00		41.7	38.3	044	044	044	044	
575-3-60	STD	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	MED	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	HIGH	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	044	044	044

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 89 – 50TC-#08

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	042	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	MED	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	043	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	HIGH	117A00	10.4	7.8/9.6	042	042	042	043
		110A00	16.0	12.0/14.7	043	043	043	043
111A00		24.8	18.6/22.8	043	043	043	043	
112A00		32.0	24.0/29.4	043	043	043	043	
112A00,117A00		42.4	31.8/38.9	045	045	045	045	
460-3-60	STD	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	MED	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	HIGH	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
114A00		27.8	25.5	042	042	042	042	
115A00		33.0	30.3	042	042	044	044	
114A00,116A00		41.7	38.3	044	044	044	044	
575-3-60	STD	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	MED	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	HIGH	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	044	044	044

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 90 – 50TC-#08

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	042	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	MED	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	043	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	HIGH	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	043	043	043	043
111A00		24.8	18.6/22.8	043	043	043	043	
112A00		32.0	24.0/29.4	043	043	043	043	
112A00,117A00		42.4	31.8/38.9	045	045	045	045	
460-3-60	STD	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	MED	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	HIGH	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
114A00		27.8	25.5	042	042	042	042	
115A00		33.0	30.3	042	042	044	044	
114A00,116A00		41.7	38.3	044	044	044	044	
575-3-60	STD	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	MED	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	HIGH	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	044	044	044

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 91 – 50TC-*08

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	042	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	MED	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	043	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	HIGH	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	043	043	043	043
111A00		24.8	18.6/22.8	043	043	043	043	
112A00		32.0	24.0/29.4	043	043	043	043	
112A00,117A00		42.4	31.8/38.9	045	045	045	045	
460-3-60	STD	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	MED	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	HIGH	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
114A00		27.8	25.5	042	042	042	042	
115A00		33.0	30.3	042	042	044	044	
114A00,116A00		41.7	38.3	044	044	044	044	
575-3-60	STD	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	MED	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	HIGH	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	044	044	044

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 92 – 50TC-*08

2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	042	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	MED	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	042	043	043	043
		111A00	24.8	18.6/22.8	043	043	043	043
		112A00	32.0	24.0/29.4	043	043	043	043
		112A00,117A00	42.4	31.8/38.9	045	045	045	045
	HIGH	117A00	10.4	7.8/9.6	042	042	042	042
		110A00	16.0	12.0/14.7	043	043	043	043
111A00		24.8	18.6/22.8	043	043	043	043	
112A00		32.0	24.0/29.4	043	043	043	043	
112A00,117A00		42.4	31.8/38.9	045	045	045	045	
460-3-60	STD	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	MED	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
		114A00	27.8	25.5	042	042	042	042
		115A00	33.0	30.3	042	042	042	042
		114A00,116A00	41.7	38.3	044	044	044	044
	HIGH	116A00	13.9	12.8	042	042	042	042
		113A00	16.5	15.2	042	042	042	042
114A00		27.8	25.5	042	042	042	042	
115A00		33.0	30.3	042	042	044	044	
114A00,116A00		41.7	38.3	044	044	044	044	
575-3-60	STD	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	042	042	044
	MED	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	044	042	044
	HIGH	118A00	17.0	17.0	042	042	042	042
		119A00	34.0	34.0	042	044	044	044

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 93 – 50TC-#09

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 203-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	047	047	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	047	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 94 – 50TC-#09

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 203-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	047	047	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	047	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
111A00		24.8	18.6/22.8	049	049	049	049	
112A00		32.0	24.0/29.4	049	049	049	049	
112A00,117A00		42.4	31.8/38.9	051	051	051	051	
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
114A00		27.8	25.5	047	047	047	047	
115A00		33.0	30.3	047	047	047	050	
114A00,116A00		41.7	38.3	050	050	050	050	
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 95 – 50TC-#09

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 203-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	047	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	049	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 96 – 50TC-#09

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 203-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	047	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	049	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 97 – 50TC-#09

2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 203-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	047	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	049	049	049	049
		111A00	24.8	18.6/22.8	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		114A00	27.8	25.5	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 98 – 50TC-*12

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	047	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 99 – 50TC-*12

1-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	047	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 100 – 50TC-*12

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	047	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 101 – 50TC-*12

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	047	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 102 – 50TC-*12

2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	047	047	047	047
		110A00	16.0	12.0/14.7	047	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	047	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 103 – 50TC-*14

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 104 – 50TC-#14

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	047	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 105 – 50TC-*14

2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	049	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
460-3-60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575-3-60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 106 – 50TC-#16

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V–PH–Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230–3–60	STD	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
		288A00,294A00	43.5	32.7/40.0	051	051	051	051
		291A00,294A00	50.0	37.6/45.9	051	051	051	051
		294A00,294A00	67.0	50.3/61.5	053	053	053	053
	MED	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
		288A00,294A00	43.5	32.7/40.0	051	051	051	051
		291A00,294A00	50.0	37.6/45.9	051	051	051	051
		294A00,294A00	67.0	50.3/61.5	053	053	053	053
	HIGH	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
288A00,294A00		43.5	32.7/40.0	051	051	051	051	
291A00,294A00		50.0	37.6/45.9	051	051	051	051	
294A00,294A00		67.0	50.3/61.5	053	053	053	053	
460–3–60	STD	292A00	16.5	15.2	–	–	–	–
		295A00	33.5	30.8	047	047	047	050
		289A00,295A00	43.5	40.0	050	050	050	050
		292A00,295A00	50.0	45.9	050	050	050	050
		295A00,295A00	67.0	61.5	050	050	050	050
	MED	292A00	16.5	15.2	–	–	–	–
		295A00	33.5	30.8	047	047	047	050
		289A00,295A00	43.5	40.0	050	050	050	050
		292A00,295A00	50.0	45.9	050	050	050	050
		295A00,295A00	67.0	61.5	050	050	050	050
	HIGH	292A00	16.5	15.2	–	–	–	–
		295A00	33.5	30.8	050	050	050	050
289A00,295A00		43.5	40.0	050	050	050	050	
292A00,295A00		50.0	45.9	050	050	050	050	
295A00,295A00		67.0	61.5	050	050	050	050	
575–3–60	STD	293A00	16.5	15.2	–	–	–	–
		296A00	33.5	30.8	047	047	047	047
		290A00,296A00	43.5	40.0	047	050	047	050
		293A00,296A00	50.0	45.9	047	047	047	047
		296A00,296A00	67.0	61.5	050	050	050	050
	MED	293A00	16.5	15.2	–	–	–	–
		296A00	33.5	30.8	047	047	047	047
		290A00,296A00	43.5	40.0	047	050	047	050
		293A00,296A00	50.0	45.9	047	047	047	047
		296A00,296A00	67.0	61.5	050	050	050	050
	HIGH	293A00	16.5	15.2	–	–	–	–
		296A00	33.5	30.8	047	047	047	047
290A00,296A00		43.5	40.0	050	050	050	050	
293A00,296A00		50.0	45.9	050	050	050	050	
296A00,296A00		67.0	61.5	050	050	050	050	

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 107 – 50TC-#16

2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR WITH FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V–PH–Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230–3–60	STD	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
		288A00,294A00	43.5	32.7/40.0	051	051	051	051
		291A00,294A00	50.0	37.6/45.9	051	051	051	051
		294A00,294A00	67.0	50.3/61.5	053	053	053	053
	MED	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
		288A00,294A00	43.5	32.7/40.0	051	051	051	051
		291A00,294A00	50.0	37.6/45.9	051	051	051	051
		294A00,294A00	67.0	50.3/61.5	053	053	053	053
	HIGH	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
288A00,294A00		43.5	32.7/40.0	051	051	051	051	
291A00,294A00		50.0	37.6/45.9	051	051	051	051	
294A00,294A00		67.0	50.3/61.5	053	053	053	053	
460–3–60	STD	292A00	16.5	15.2	–	–	–	–
		295A00	33.5	30.8	047	047	047	050
		289A00,295A00	43.5	40.0	050	050	050	050
		292A00,295A00	50.0	45.9	050	050	050	050
		295A00,295A00	67.0	61.5	050	050	050	050
	MED	292A00	16.5	15.2	–	–	–	–
		295A00	33.5	30.8	047	047	047	050
		289A00,295A00	43.5	40.0	050	050	050	050
		292A00,295A00	50.0	45.9	050	050	050	050
		295A00,295A00	67.0	61.5	050	050	050	050
	HIGH	292A00	16.5	15.2	–	–	–	–
		295A00	33.5	30.8	050	050	050	050
289A00,295A00		43.5	40.0	050	050	050	050	
292A00,295A00		50.0	45.9	050	050	050	050	
295A00,295A00		67.0	61.5	050	050	050	050	
575–3–60	STD	293A00	16.5	15.2	–	–	–	–
		296A00	33.5	30.8	047	047	047	047
		290A00,296A00	43.5	40.0	047	050	047	050
		293A00,296A00	50.0	45.9	047	047	047	047
		296A00,296A00	67.0	61.5	050	050	050	050
	MED	293A00	16.5	15.2	–	–	–	–
		296A00	33.5	30.8	047	047	047	047
		290A00,296A00	43.5	40.0	047	050	047	050
		293A00,296A00	50.0	45.9	047	047	047	047
		296A00,296A00	67.0	61.5	050	050	050	050
	HIGH	293A00	16.5	15.2	–	–	–	–
		296A00	33.5	30.8	047	047	047	047
290A00,296A00		43.5	40.0	050	050	050	050	
293A00,296A00		50.0	45.9	050	050	050	050	
296A00,296A00		67.0	61.5	050	050	050	050	

LEGEND:

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenience outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- PWRD – Powered convenience outlet
- UNPWRD – Unpowered convenience outlet

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 108 – 50TC-#16

2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR WITHOUT FACTORY INSTALLED NON-FUSED DISCONNECT

NOM. V-PH-Hz.	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXXX			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)	NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230-3-60	STD	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
		288A00,294A00	43.5	32.7/40.0	051	051	051	051
		291A00,294A00	50.0	37.6/45.9	051	051	051	051
		294A00,294A00	67.0	50.3/61.5	053	053	053	053
	MED	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
		288A00,294A00	43.5	32.7/40.0	051	051	051	051
		291A00,294A00	50.0	37.6/45.9	051	051	051	051
		294A00,294A00	67.0	50.3/61.5	053	053	053	053
	HIGH	291A00	16.5	12.4/15.2	049	049	049	049
		294A00	33.5	25.2/30.8	049	049	049	049
288A00,294A00		43.5	32.7/40.0	051	051	051	051	
291A00,294A00		50.0	37.6/45.9	051	051	051	051	
294A00,294A00		67.0	50.3/61.5	053	053	053	053	
460-3-60	STD	292A00	16.5	15.2	-	-	-	-
		295A00	33.5	30.8	047	047	047	050
		289A00,295A00	43.5	40.0	050	050	050	050
		292A00,295A00	50.0	45.9	050	050	050	050
		295A00,295A00	67.0	61.5	050	050	050	050
	MED	292A00	16.5	15.2	-	-	-	-
		295A00	33.5	30.8	047	047	047	050
		289A00,295A00	43.5	40.0	050	050	050	050
		292A00,295A00	50.0	45.9	050	050	050	050
		295A00,295A00	67.0	61.5	050	050	050	050
	HIGH	292A00	16.5	15.2	-	-	-	-
		295A00	33.5	30.8	050	050	050	050
289A00,295A00		43.5	40.0	050	050	050	050	
292A00,295A00		50.0	45.9	050	050	050	050	
295A00,295A00		67.0	61.5	050	050	050	050	
575-3-60	STD	293A00	16.5	15.2	-	-	-	-
		296A00	33.5	30.8	047	047	047	047
		290A00,296A00	43.5	40.0	047	050	047	050
		293A00,296A00	50.0	45.9	047	047	047	050
		296A00,296A00	67.0	61.5	050	050	050	050
	MED	293A00	16.5	15.2	-	-	-	-
		296A00	33.5	30.8	047	047	047	047
		290A00,296A00	43.5	40.0	047	050	047	050
		293A00,296A00	50.0	45.9	047	047	047	050
		296A00,296A00	67.0	61.5	050	050	050	050
	HIGH	293A00	16.5	15.2	-	-	-	-
		296A00	33.5	30.8	047	047	047	047
290A00,296A00		43.5	40.0	050	050	050	050	
293A00,296A00		50.0	45.9	050	050	050	050	
296A00,296A00		67.0	61.5	050	050	050	050	

LEGEND:

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- PWRD - Powered convenience outlet
- UNPWRD - Unpowered convenience outlet

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	NO M, V-PH-HZ	ELEC. HTR			NO C.O. or UNPWR C.O.						w/ PWRD C.O.											
		IFM TYPE	CRHEATER**A00	Nom (kW)	FLA	NO PE.			w/ PE. (pwrdr fr/unit)			NO PE.			w/ PWRD C.O.							
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	DISC. SIZE					
FLA	FLA	FLA	FLA	LRA	FLA	FLA	LRA	FLA	FLA	LRA	FLA	FLA	LRA	FLA	FLA	LRA						
50TC**05	460-3-60	STD	NONE	-	-	12	15	11	52	13	15	12	53	14	15	14	54	15	20	15	55	
			106A	6.0	7.2	13	15	11	52	14	15	12	53	15	15	14	54	17	20	15	55	
			108A	11.5	13.8	21	25	19	52	22	25	20	53	24	25	21	54	25	25	23	26	55
			109A	14.0	16.8	25	25	22	52	26	30	23	53	27	30	25	54	29	30	26	26	55
50TC**05	460-3-60	MED	108A+108A	23.0	27.7	38	40	35	52	40	40	36	53	41	45	37	54	42	45	39	55	
			NONE	-	-	12	15	11	52	13	15	12	53	14	15	14	54	15	20	15	55	
			106A	6.0	7.2	13	15	11	52	14	15	12	53	15	15	14	54	17	20	15	55	
			108A	11.5	13.8	21	25	19	52	22	25	20	53	24	25	21	54	25	25	23	26	55
50TC**05	460-3-60	HIGH	109A	14.0	16.8	25	25	22	52	26	30	23	53	27	30	25	54	29	30	26	26	55
			108A+108A	23.0	27.7	38	40	35	52	40	40	36	53	41	45	37	54	42	45	39	55	
			NONE	-	-	12	15	11	58	13	15	12	59	14	15	14	60	15	20	15	61	
			106A	6.0	7.2	13	15	11	58	14	15	12	59	15	15	14	60	17	20	15	61	
575-3-60	575-3-60	STD	108A	11.5	13.8	21	25	19	58	22	25	20	59	24	25	21	60	25	25	23	26	61
			109A	14.0	16.8	25	25	22	58	26	30	23	59	27	30	25	60	29	30	26	26	61
			108A+108A	23.0	27.7	38	40	35	58	40	40	36	59	41	45	37	60	42	45	39	39	61
			NONE	-	-	9	15	9	42	11	15	11	44	11	15	11	44	13	15	13	13	46
575-3-60	575-3-60	MED	NONE	-	-	9	15	9	42	11	15	11	44	11	15	11	44	13	15	13	46	
			HIGH	-	-	9	15	9	46	11	15	11	48	11	15	10	48	13	15	13	50	

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	NO M, V-PH-HZ	ELEC. HTR			NO C.O. or UNPWR C.O.						w/ PWRD C.O.										
		IFRM TYPE	CRHEATER**A00	Nom (kW)	FLA	NO PE.			w/ PE. (pwrdr fr/unit)			NO PE.			w/ PWRD C.O.						
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA				
50TC**06	460-3-60	STD	NONE	-	-	13	20	14	14	20	14	64	16	20	15	65	17	20	16	66	
			106A	6.0	7.2	13	20	14	14	20	14	64	16	20	15	65	17	20	16	66	
			108A	11.5	13.8	19	25	20	64	24	25	21	65	25	25	21	65	25	25	23	66
			109A	14.0	16.8	22	30	23	64	27	30	25	65	29	30	25	65	29	30	26	66
			108A+108A	23.0	27.7	35	40	36	64	41	45	37	65	42	45	37	65	42	45	39	66
			108A+109A	25.5	30.7	38	45	39	64	45	45	41	65	46	50	41	65	46	50	42	66
			NONE	-	-	14	20	15	83	16	20	16	84	17	20	16	84	17	20	17	85
			106A	6.0	7.2	14	20	15	83	16	20	16	84	17	20	16	84	18	20	17	85
			108A	11.5	13.8	20	25	21	83	25	25	22	84	26	30	22	84	26	30	23	85
			109A	14.0	16.8	23	30	24	83	28	30	26	84	30	30	26	84	30	30	27	85
575-3-60	460-3-60	HIGH	108A+108A	23.0	27.7	36	40	36	41	45	37	83	42	45	38	84	43	45	39	85	
			108A+109A	25.5	30.7	39	45	40	83	44	45	40	84	46	50	42	84	47	50	43	85
			NONE	-	-	14	20	15	83	16	20	16	84	17	20	16	84	17	20	17	85
			106A	6.0	7.2	14	20	15	83	16	20	16	84	17	20	16	84	18	20	17	85
			108A	11.5	13.8	20	25	21	83	25	25	22	84	26	30	22	84	26	30	23	85
			109A	14.0	16.8	23	30	24	83	28	30	26	84	30	30	26	84	30	30	27	85
			108A+108A	23.0	27.7	36	40	36	83	41	45	37	83	42	45	38	84	43	45	39	85
			108A+109A	25.5	30.7	39	45	40	83	44	45	40	84	46	50	42	84	47	50	43	85
			STD	-	-	10	15	12	50	11	15	12	50	12	15	12	50	14	20	14	52
			MED	-	-	10	15	12	54	12	15	12	54	12	15	12	54	14	15	14	56
HIGH	-	-	11	15	13	65	13	15	13	65	13	15	13	65	15	20	15	67			

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.) — (Units Produced On or Prior to 02/08/2015)

UNIT	NO M. V-Ph-HZ	ELEC. HTR			NO C.O. or UNPWR C.O.										w/ PWRD C.O.									
		CRHEATER***A00	Nom (kW)	FLA	NO RE.			w/ RE. (pwrd fr/unit)			NO PE.				w/ P.E. (pwrd fr/unit)									
					MCA	MAX FUSE or BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or BRKR	DISC. SIZE FLA LRA								
50TC**07		NONE	—	—	33/32	50/50	32/31	184	34/34	50/50	34/33	186	37/37	50/50	37/37	189	39/39	50/50	39/39	50/50	39/39	191/191		
		102A	4.9/16.5	13.6/15.6	33/32	50/50	32/31	184/184	35/35	50/50	34/33	186/186	37/37	50/50	37/37	189/189	39/39	50/50	39/39	50/50	39/39	191/191		
		104B	7.9/10.5	21.9/25.3	36/40	50/50	33/37	184/184	39/43	50/50	35/39	186/186	42/46	50/50	39/42	189/189	45/49	50/50	41/45	50/50	41/45	191/191		
		105A	12.0/16.0	33.4/38.5	51/57	60/60	46/52	184/184	53/59	60/60	49/54	186/186	57/63	60/70	52/58	189/189	59/65	60/70	54/60	60/70	54/60	191/191		
		104B+104B	15.8/21.0	43.8/50.5	64/72	70/80	58/66	184/184	66/74	70/80	60/68	186/186	70/78	70/80	64/71	189/189	72/80	80/80	66/73	80/80	66/73	191/191		
		104B+105A	19.9/26.5	55.2/63.8	78/89	80/90	71/81	184/184	80/91	90/100	74/83	186/186	84/95	90/100	77/87	189/189	86/97	90/100	79/89	90/100	79/89	191/191		
		NONE	—	—	34/34	50/50	33/33	199	36/36	50/50	35/35	201	39/39	50/50	39/39	204	41/41	50/50	41/41	50/50	41/41	206		
		102A	4.9/16.5	13.6/15.6	34/34	50/50	33/33	199/199	36/36	50/50	35/35	201/201	39/39	50/50	39/39	204/204	41/41	50/50	41/41	50/50	41/41	206/206		
		104B	7.9/10.5	21.9/25.3	38/42	50/50	35/39	199/199	41/45	50/50	37/41	201/201	44/48	50/50	40/44	204/204	47/51	50/60	43/46	50/60	43/46	206/206		
		105A	12.0/16.0	33.4/38.5	53/59	60/60	48/54	199/199	55/61	60/70	50/56	201/201	59/65	60/70	54/59	204/204	61/67	70/70	56/62	70/70	56/62	206/206		
104B+104B	15.8/21.0	43.8/50.5	68/77	70/80	60/68	199/199	68/76	70/80	62/70	201/201	72/80	80/80	66/73	204/204	74/82	80/90	68/75	80/90	68/75	206/206				
104B+105A	19.9/26.5	55.2/63.8	83/93	90/100	73/83	199/199	82/93	90/100	75/85	201/201	86/97	90/100	79/88	204/204	88/99	90/100	81/91	90/100	81/91	206/206				
460-3-60		NONE	—	—	36	50	36	213	38	50	38	215	41	50	41	218	43	60	43	60	43	220		
		106A	6.0	7.2	36/36	50/50	36/36	213/213	38/38	50/50	38/38	215/215	41/41	50/50	41/41	218/218	43/43	60/60	43/43	60/60	43/43	220/220		
		108A	11.5	13.8	41/45	60/70	37/41	213/213	43/48	50/50	40/43	215/215	47/51	50/60	43/47	218/218	49/54	60/60	45/49	60/60	45/49	220/220		
		109A	14.0	16.8	55/62	60/70	51/56	213/213	58/64	60/70	53/59	215/215	61/68	70/70	56/62	218/218	64/70	70/70	58/64	70/70	58/64	220/220		
		108A+108A	23.0	27.7	68/77	70/80	63/70	213/213	71/79	80/80	65/72	215/215	74/83	80/90	68/76	218/218	77/85	80/90	70/78	80/90	70/78	220/220		
		108A+109A	25.5	30.7	83/93	90/100	76/86	213/213	85/96	90/100	78/88	215/215	89/99	90/100	81/91	218/218	91/102	100/110	83/93	100/110	83/93	220/220		
		NONE	—	—	17	25	16	92	18	25	17	93	19	25	19	94	20	25	20	25	20	25	95	
		106A	6.0	7.2	17	25	16	92	18	25	17	93	19	25	19	94	20	25	20	25	20	25	95	
		108A	11.5	13.8	22	30	20	92	23	30	21	93	25	30	22	94	26	30	23	30	23	30	95	
		109A	14.0	16.8	26	30	23	92	27	30	24	93	28	30	26	94	30	30	27	30	27	30	95	
108A+108A	23.0	27.7	39	40	36	92	41	45	37	93	42	45	38	94	43	45	39	45	39	45	95			
108A+109A	25.5	30.7	43	45	40	92	44	45	40	93	46	50	42	94	47	50	43	45	43	50	95			
575-3-60		NONE	—	—	18	25	18	100	19	25	18	101	20	25	19	102	21	30	21	30	21	103		
		106A	6.0	7.2	18	25	17	100	19	25	18	101	20	25	19	102	21	30	21	30	21	103		
		108A	11.5	13.8	23	30	21	100	24	25	22	101	26	30	23	102	27	30	24	30	24	103		
		109A	14.0	16.8	27	30	24	100	28	30	25	101	29	30	27	102	31	35	28	30	28	103		
		108A+108A	23.0	27.7	40	40	37	100	42	45	38	101	43	45	39	102	44	45	40	45	40	103		
		108A+109A	25.5	30.7	44	45	40	100	45	45	41	101	47	50	43	102	48	50	44	45	44	103		
		NONE	—	—	19	25	18	107	20	25	19	108	21	30	21	109	22	30	22	30	22	110		
		106A	6.0	7.2	19	25	18	107	20	25	19	108	21	30	21	109	22	30	22	30	22	110		
		108A	11.5	13.8	24	25	22	107	26	30	23	108	27	30	24	109	28	30	26	30	26	110		
		109A	14.0	16.8	28	30	25	107	29	30	27	108	31	35	28	109	32	35	29	30	29	110		
108A+108A	23.0	27.7	42	45	38	107	44	45	39	108	44	45	40	109	46	50	42	45	42	110				
108A+109A	25.5	30.7	45	50	41	107	47	50	43	108	48	50	44	109	49	50	45	45	45	110				
STD		—	—	12	15	12	63	14	20	14	65	14	20	13	65	16	20	16	20	16	67			
MED		—	—	13	20	12	74	15	20	15	76	15	20	14	76	17	20	17	20	17	78			
HIGH		—	—	13	20	12	74	15	20	15	76	15	20	14	76	17	20	17	20	17	78			

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.) — (Units Produced Between 02/09/2015 and 05/17/2015)

UNIT	NO M. V-Ph-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.						NO P.E.						w/ PWRD C.O.						
			CRHEATER***A00	Nom (kW)	FLA	NO RE.		NO C.O. or UNPWR C.O.		NO P.E.		w/ PWRD C.O.		NO RE.		NO C.O. or UNPWR C.O.		NO P.E.		w/ PWRD C.O.				
						MAX FUSE or BRKR	MCA	DISC. SIZE	MCA	MAX FUSE or BRKR	MCA	DISC. SIZE	MCA	MAX FUSE or BRKR	MCA	DISC. SIZE	MCA	MAX FUSE or BRKR	MCA	DISC. SIZE	MCA	MAX FUSE or BRKR	MCA	DISC. SIZE
FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA	FLA			
50TC**07	208/230-3-60	STD	NONE	-	-	33/33	50/50	32/32	197	35/35	50/50	34/34	199	38/38	40/40	38/37	202	40/40	50/50	40/40	50/50	40/40	204	
			102A	4.9/16.5	13.6/15.6	33/33	50/50	32/32	197/197	35/35	50/50	34/34	199/199	38/38	40/40	38/37	202/202	40/40	50/50	40/40	50/50	40/40	204/204	
			104B	7.9/10.5	21.9/25.3	36/40	60/60	33/37	197/197	39/43	50/50	35/39	199/199	42/46	50/50	38/42	202/202	45/49	60/70	50/50	41/45	60/70	204/204	
			105A	12.0/16.0	33.4/38.5	51/57	80/80	46/52	197/197	53/59	60/60	49/54	199/199	57/63	60/70	52/58	202/202	59/65	90/100	60/70	54/60	90/100	204/204	
			104B+104B	15.8/21.0	43.8/50.5	64/72	70/80	58/66	197/197	66/74	70/80	60/68	199/199	70/78	70/80	64/71	202/202	72/80	80/80	66/73	80/80	66/73	204/204	
			104B+105A	19.9/26.5	55.2/63.8	78/89	80/90	71/81	197/197	80/91	90/100	74/83	199/199	84/95	90/100	77/87	202/202	86/97	90/100	80/80	90/100	79/89	204/204	
			NONE	-	-	35/35	50/50	34/34	212	37/37	50/50	36/36	214	40/40	38/39	50/50	39/39	217	42/41	60/60	42/42	60/60	42/42	219
			102A	4.9/16.5	13.6/15.6	35/35	50/50	34/34	212/212	37/37	50/50	36/36	214/214	40/40	38/39	50/50	39/39	217/217	42/41	60/60	42/42	60/60	42/42	219/219
			104B	7.9/10.5	21.9/25.3	38/42	60/60	35/39	212/212	41/45	50/50	37/41	214/214	44/48	50/50	40/44	217/217	47/51	60/60	43/46	60/60	43/46	219/219	
			105A	12.0/16.0	33.4/38.5	53/59	80/80	48/54	212/212	55/61	60/70	50/56	214/214	59/65	60/70	54/59	217/217	61/67	70/70	56/62	70/70	56/62	219/219	
			104B+104B	15.8/21.0	43.8/50.5	66/74	70/80	60/68	212/212	68/76	70/80	62/70	214/214	72/80	80/80	66/73	217/217	74/82	80/80	68/75	80/80	68/75	219/219	
			104B+105A	19.9/26.5	55.2/63.8	80/91	90/100	73/83	212/212	82/93	90/100	75/85	214/214	86/97	90/100	79/88	217/217	88/99	90/100	81/91	90/100	81/91	219/219	
460-3-60	MED	NONE	-	-	15	20	14	96	16	20	15	97	17	17	17	98	18	25	18	25	18	99		
		106A	6.0	7.2	15	20	14	96	16	20	15	97	17	17	17	98	18	25	18	25	18	99		
		108A	11.5	13.8	22	25	20	96	23	25	21	97	25	25	22	98	26	30	23	30	23	99		
		109A	14.0	16.8	26	30	23	96	27	30	24	97	28	30	26	98	30	30	27	30	27	99		
		108A+108A	23.0	27.7	39	40	36	96	41	45	37	97	42	45	38	98	43	45	39	45	39	99		
		108A+109A	25.5	30.7	43	45	39	96	44	45	40	97	46	50	42	98	47	50	43	45	40	99		
		NONE	-	-	16	20	15	104	17	20	16	105	19	20	18	106	19	25	18	25	19	107		
		106A	6.0	7.2	16	20	15	104	17	20	16	105	19	20	18	106	19	25	18	25	19	107		
		108A	11.5	13.8	23	25	21	104	24	25	22	105	26	30	23	106	27	30	24	30	24	107		
		109A	14.0	16.8	27	30	24	104	28	30	25	105	29	30	25	106	31	35	28	30	28	107		
		108A+108A	23.0	27.7	40	40	37	104	42	45	38	105	43	45	39	106	44	45	38	40	35	107		
		108A+109A	25.5	30.7	44	45	40	104	45	45	41	105	47	50	43	106	48	50	44	45	40	107		
575-3-60	STD	NONE	-	-	11	15	11	68	13	15	13	70	13	13	13	70	15	20	15	20	15	72		
		106A	6.0	7.2	11	15	11	68	13	15	13	70	13	13	13	70	15	20	15	20	15	72		
		108A	11.5	13.8	24	25	22	111	26	30	23	112	27	30	24	113	28	30	26	30	26	83		
		109A	14.0	16.8	28	30	25	111	29	30	27	112	31	35	28	113	32	35	29	30	29	83		
		108A+108A	23.0	27.7	42	45	38	111	43	45	39	112	44	45	40	113	46	50	42	45	42	83		
		108A+109A	25.5	30.7	45	50	41	111	47	50	43	112	48	50	44	113	49	50	45	45	45	83		

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.) — (Units Produced On or After 05/18/2015)

UNIT	IFM-TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.						w/ PWRD C.O.										
		ORHEATER**A00	Nom (kW)	FLA	NO PE.			w/ P.E. (pwrd fr/unit)			NO PE.			w/ P.E. (pwrd fr/unit)							
					MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA					
50TC**07	STD	NONE	-	-	32	50	30	170	32	50	36	36/36	175	38	50	38	50	38/38	177/177		
		102A	4.9/6.5	13.6/15.6	32/32	50/50	30/30	170/170	32/32	50/50	36/36	36/36	175/175	38/38	50/50	38/38	50/50	38/38	177/177		
		104B	7.9/10.5	21.9/25.3	34/39	50/50	31/35	170/170	33/37	50/50	40/45	40/45	175/175	43/47	50/50	50/50	50/50	39/43	177/177		
		105A	12.0/16.0	33.4/38.5	48/55	50/60	44/50	170/170	47/52	60/60	55/61	55/61	175/175	57/63	60/70	60/70	52/58	60/70	52/58	177/177	
		104B+104B	15.8/21.0	43.8/50.5	62/70	70/70	56/64	170/170	59/66	70/80	68/76	68/76	175/175	70/78	80/90	70/80	64/72	70/80	64/72	177/177	
		104B+105A	19.9/26.5	55.2/63.8	76/87	80/90	69/79	170/170	72/82	80/90	82/93	82/93	175/175	84/95	90/100	90/100	77/87	90/100	77/87	177/177	
		102A	4.9/6.5	13.6/15.6	35/35	50/50	34/34	212	36/36	50/50	40/40	40/40	214	39/39	42/41	50/50	42/42	60/60	42/42	219	
		104B	7.9/10.5	21.9/25.3	38/42	50/50	34/34	212/212	36/36	50/50	44/48	44/48	214/214	40/44	47/51	60/60	42/42	60/60	42/42	219/219	
		105A	12.0/16.0	33.4/38.5	53/59	60/60	48/54	212/212	50/56	60/70	59/65	59/65	214/214	54/59	61/67	60/70	70/70	56/62	60/70	56/62	219/219
		104B+104B	15.8/21.0	43.8/50.5	66/74	70/80	60/68	212/212	68/76	70/80	72/80	72/80	214/214	66/73	74/82	80/90	68/75	80/90	68/75	219/219	
104B+105A	19.9/26.5	55.2/63.8	80/91	80/100	73/83	212/212	82/93	90/100	86/97	86/97	214/214	79/88	88/99	90/100	81/91	90/100	81/91	219/219			
460-3-60	STD	NONE	-	-	14	20	13	83	15	20	14	84	16	17	20	17	25	17	86		
		106A	6.0	7.2	14	20	13	83	15	20	14	84	16	18	20	18	25	17	86		
		108A	11.5	13.8	21	25	19	83	22	25	24	84	24	25	25	25	25	23	86		
		109A	14.0	16.8	25	25	22	83	26	30	23	84	27	25	29	30	26	26	86		
		108A+108A	23.0	27.7	38	40	35	83	40	45	36	84	41	45	42	45	39	39	86		
		108A+109A	25.5	30.7	42	45	38	83	43	45	39	84	45	45	46	50	42	45	86		
		106A	6.0	7.2	16	20	15	104	17	20	18	105	18	19	20	19	25	19	107		
		108A	11.5	13.8	23	25	21	104	24	25	22	105	26	23	27	30	24	24	107		
		109A	14.0	16.8	27	30	24	104	28	30	25	105	29	27	31	35	28	28	107		
		108A+108A	23.0	27.7	40	45	37	104	42	45	38	105	44	39	44	45	40	40	107		
108A+109A	25.5	30.7	44	45	40	104	45	45	41	105	47	43	48	50	44	44	107				
575-3-60	STD	NONE	-	-	11	15	11	68	13	15	13	70	13	15	20	15	20	15	72		
		106A	6.0	7.2	17	20	16	111	18	20	16	112	19	20	19	25	20	20	72		
		108A	11.5	13.8	24	25	22	111	26	30	23	112	27	28	30	26	26	83			
		109A	14.0	16.8	28	30	25	111	29	30	27	112	31	32	35	29	29	83			
		108A+108A	23.0	27.7	42	45	38	111	43	45	39	112	44	46	50	42	42	83			
		108A+109A	25.5	30.7	45	50	41	111	47	50	43	112	48	49	50	45	45	83			
		106A	6.0	7.2	17	20	16	111	18	20	18	112	19	20	19	25	20	20	72		
		108A	11.5	13.8	24	25	22	111	26	30	23	112	27	28	30	26	26	83			
		109A	14.0	16.8	28	30	25	111	29	30	27	112	31	32	35	29	29	83			
		108A+108A	23.0	27.7	42	45	38	111	43	45	39	112	44	46	50	42	42	83			
108A+109A	25.5	30.7	45	50	41	111	47	50	43	112	48	49	50	45	45	83					

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	IFM-TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.						w/ PWRD C.O.							
		CRHEATER***A00	Nom (kW)	FLA	NO PE.			w/ P.E. (pwrd fr/unit)			NO PE.			w/ P.E. (pwrd fr/unit)				
					MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR
507C*A08	NO M. V-PH-HZ	NONE	-	-	38	191	44	60	43	195	45	60	44	196	49	60	48	200
		117A	7.8/10.4	21.7/25.0	38/38	191/191	44/44	60/60	43/43	195/195	45/45	60/60	44/44	196/196	49/49	60/60	48/48	200/200
		110A	12.0/16.0	33.4/38.5	49/55	191/191	53/60	60/60	49/55	195/195	55/61	60/70	50/56	196/196	59/66	60/70	54/60	200/200
		111A	18.6/24.8	51.7/59.7	72/82	191/191	76/86	80/90	70/79	195/195	78/88	80/90	71/80	196/196	82/92	90/100	75/85	200/200
		112A	24.0/32.0	66.7/77.0	90/103	191/191	95/108	100/110	87/99	195/195	96/109	100/110	88/100	196/196	101/114	110/125	93/104	200/200
		112A+117A	31.8/42.4	88.4/102.0	117/134	108/123	122/139	125/150	112/128	195/195	123/140	125/150	113/129	196/196	128/145	150/150	118/133	200/200
	208/230-3-60	NONE	-	-	42/42	244	47/47	60/60	46/46	248	48/48	60/60	47/47	249	52/52	60/60	52/52	253
		117A	7.8/10.4	21.7/25.0	42/42	244/244	47/47	60/60	46/46	248/248	48/48	60/60	47/47	249/249	52/53	60/60	52/52	253/253
		110A	12.0/16.0	33.4/38.5	59/59	244/244	57/64	60/70	52/58	248/248	59/65	60/70	54/59	249/249	63/70	70/70	58/64	253/253
		111A	18.6/24.8	51.7/59.7	76/85	244/244	80/90	80/90	73/83	248/248	82/91	90/100	75/84	249/249	86/96	90/100	79/88	253/253
		112A	24.0/32.0	66.7/77.0	94/107	244/244	99/112	100/125	91/102	248/248	100/113	100/125	92/104	249/249	105/118	110/125	96/108	253/253
		112A+117A	31.8/42.4	88.4/102.0	121/138	244/244	126/143	150/150	116/131	248/248	127/144	150/150	117/132	249/249	132/149	150/150	121/137	253/253
460-3-60	NONE	-	-	48/47	260	52/51	60/60	52/51	264	53/52	60/60	53/52	265	57/56	80/80	58/57	269	
	117A	7.8/10.4	21.7/25.0	48/47	260/260	52/52	60/60	52/51	264/264	53/54	60/60	53/52	265/265	57/58	80/80	58/57	269/269	
	110A	12.0/16.0	33.4/38.5	59/64	260/260	64/69	70/70	58/63	264/264	65/70	70/70	60/64	265/265	70/75	80/80	64/69	269/269	
	111A	18.6/24.8	51.7/59.7	82/91	260/260	87/96	90/100	79/88	264/264	88/97	90/100	81/89	265/265	93/102	100/110	85/93	269/269	
	112A	24.0/32.0	66.7/77.0	101/113	260/260	106/117	110/125	97/108	264/264	107/119	110/125	98/109	265/265	112/123	125/125	102/113	269/269	
	112A+117A	31.8/42.4	88.4/102.0	128/144	260/260	133/149	150/150	122/136	264/264	134/150	150/150	123/137	265/265	139/155	150/175	127/142	269/269	
	575-3-60	NONE	-	-	19	113	22	30	21	115	22	30	21	115	24	30	23	117
		116A	13.9	16.7	22	113	27	30	24	115	27	30	25	115	30	30	27	117
		113A	16.5	19.8	26	113	31	35	28	115	31	35	28	115	33	35	30	117
		114A	27.8	33.4	41	113	48	50	43	115	48	50	44	115	50	60	46	117
		115A	33.0	39.7	49	113	56	60	51	115	56	60	51	115	58	60	53	117
		114A+116A	41.7	50.2	61	113	69	70	63	115	69	70	63	115	71	80	65	117
507C*A08	NONE	-	-	21	140	23	30	23	142	24	30	23	142	26	30	25	144	
	116A	13.9	16.7	27	140	29	30	26	142	29	30	27	142	32	35	29	144	
	113A	16.5	19.8	30	140	33	35	30	142	33	35	30	142	35	40	32	144	
	114A	27.8	33.4	47	140	50	50	45	142	50	50	46	142	52	60	48	144	
	115A	33.0	39.7	55	140	58	60	53	142	58	60	53	142	60	60	55	144	
	114A+116A	41.7	50.2	68	140	71	80	65	142	71	80	65	142	73	80	67	144	
	575-3-60	NONE	-	-	14	89	18	25	18	93	16	20	16	91	20	25	20	95
		118A	17.0	20.4	25	89	33	35	30	93	30	30	27	91	35	35	32	95
		119A	34.0	40.9	49	89	58	60	53	93	56	60	51	91	60	70	55	95
		NONE	-	-	15	104	20	25	19	108	17	25	17	106	21	25	21	110
		118A	17.0	20.4	27	104	34	35	31	108	32	35	30	106	36	40	33	110
		119A	34.0	40.9	50	104	60	60	55	108	57	60	52	106	62	70	57	110
575-3-60	NONE	-	-	18	118	22	30	23	122	20	25	20	120	24	30	24	124	
	118A	17.0	20.4	30	118	38	40	34	122	35	35	32	120	40	40	36	124	
	119A	34.0	40.9	53	118	63	60	58	122	61	70	55	120	65	70	60	124	

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	NO M, V-Ph-HZ	ELEC. HTR			NO C.O. or UNPWR C.O.						w/ PWFRD C.O.										
		CRHEATER***A00	Nom (kW)	FLA	NO PE.			w/ P.E. (pwrd fr/unit)			NO PE.			w/ P.E. (pwrd fr/unit)							
					MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	
STD	NONE	7.8/10.4	21.7/25.0	—	39	50	41	193	43	50	45	197	44	50	46	198	48	60	51	202	
		117A	7.8/10.4	21.7/25.0	39/39	41/41	193/193	43/43	50/50	45/45	197/197	44/44	50/50	46/46	198/198	48/48	60/60	51/51	202/202		
		110A	12.0/16.0	33.4/38.5	49/55	50/60	193/193	53/60	60/60	49/55	60/60	197/197	55/61	60/70	50/56	198/198	59/66	60/70	54/60	202/202	
		111A	18.6/24.8	51.7/59.7	72/82	80/90	193/193	76/86	80/90	70/79	80/90	197/197	78/88	80/90	71/80	198/198	82/92	90/100	75/85	202/202	
		112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	193/193	95/108	100/110	87/99	197/197	98/109	100/110	88/100	198/198	101/114	110/125	93/104	202/202	
		112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	122/139	125/150	112/128	125/150	197/197	123/140	125/150	113/129	198/198	128/145	150/150	118/133	202/202	
		117A	7.8/10.4	21.7/25.0	42/42	50/50	44/44	246	46/46	50/50	49/49	250	47/47	60/60	50/50	251	51/51	60/60	54/54	255	
		110A	12.0/16.0	33.4/38.5	42/42	50/50	44/44	246/246	46/47	50/50	49/49	250/250	47/48	60/60	50/50	251/251	51/53	60/60	54/54	255/255	
		111A	18.6/24.8	51.7/59.7	76/85	80/90	69/78	248/246	80/90	80/90	73/83	250/250	82/91	90/100	75/84	251/251	86/96	90/100	79/88	255/255	
		112A	24.0/32.0	66.7/77.0	94/107	100/110	86/98	249/246	99/112	100/125	91/102	250/250	100/113	100/125	92/104	251/251	105/118	110/125	96/108	255/255	
		112A+117A	31.8/42.4	88.4/102.0	121/138	125/150	111/127	248/246	128/143	150/150	116/131	250/250	127/144	150/150	117/132	251/251	132/149	150/150	121/137	255/255	
HIGH	NONE	7.8/10.4	21.7/25.0	—	48/47	60/50	50/49	262	51/51	60/60	55/54	266	52/52	60/60	56/55	267	56/55	60/60	59/59	271	
		117A	7.8/10.4	21.7/25.0	48/48	60/50	50/49	262/262	51/52	60/60	55/54	266/266	52/54	60/60	56/55	267/267	56/58	60/60	60/59	271/271	
		110A	12.0/16.0	33.4/38.5	59/64	60/70	54/59	262/262	64/69	70/70	58/63	266/266	65/70	70/70	60/64	267/267	70/75	70/70	64/69	271/271	
		111A	18.6/24.8	51.7/59.7	82/91	90/100	75/83	262/262	87/96	90/100	79/88	266/266	88/97	90/100	81/89	267/267	93/102	85/93	85/93	271/271	
		112A	24.0/32.0	66.7/77.0	101/113	110/125	92/103	262/262	106/117	110/125	97/108	266/266	107/119	110/125	98/109	267/267	112/123	125/125	102/113	271/271	
		112A+117A	31.8/42.4	88.4/102.0	128/144	150/150	117/132	262/262	133/149	150/150	122/136	266/266	134/150	150/150	123/137	267/267	139/155	150/175	127/142	271/271	
		116A	13.9	16.7	18	20	19	95	20	25	21	97	21	25	21	97	22	25	23	27	99
		113A	16.5	19.8	25	25	22	95	27	30	24	97	27	30	25	97	30	30	27	30	99
		114A	27.8	33.4	45	50	41	95	48	50	43	97	48	50	44	97	50	60	46	50	99
		115A	33.0	39.7	53	60	49	95	56	60	51	97	56	60	51	97	58	60	53	60	99
		114A+116A	41.7	50.2	66	70	61	95	69	70	63	97	69	70	63	97	71	80	65	65	99
MED	NONE	13.9	16.7	—	20	25	21	122	22	25	23	124	22	25	23	124	24	30	25	126	
		116A	13.9	16.7	27	30	24	122	29	30	26	124	29	30	27	124	32	35	29	126	
		113A	16.5	19.8	30	30	28	122	33	35	30	124	33	35	30	124	35	40	32	126	
		114A	27.8	33.4	47	50	43	122	50	50	45	124	50	50	46	124	52	60	48	126	
		115A	33.0	39.7	55	60	50	122	58	60	53	124	58	60	53	124	60	60	55	126	
		114A+116A	41.7	50.2	68	70	63	122	71	80	65	124	71	80	65	124	73	80	67	126	
		116A	13.9	16.7	22	25	20	130	24	30	25	132	24	30	26	132	26	30	28	134	
		113A	16.5	19.8	29	30	27	130	32	35	29	132	32	35	29	132	34	35	31	134	
		114A	27.8	33.4	33	35	30	130	35	35	32	132	36	40	33	132	38	40	35	134	
		115A	33.0	39.7	50	50	46	130	52	60	48	132	53	60	48	132	55	60	50	134	
		114A+116A	41.7	50.2	71	80	65	130	73	80	67	132	74	80	68	132	76	80	70	134	
STD	NONE	17.0	20.4	—	13	15	13	77	17	20	17	81	14	15	15	79	18	20	19	83	
		118A	17.0	20.4	28	30	25	77	33	35	30	81	30	30	27	79	35	35	32	83	
		119A	34.0	40.9	54	60	49	77	58	60	53	81	56	60	51	79	60	70	55	83	
MED	NONE	17.0	20.4	—	14	15	14	92	18	20	19	96	16	20	16	94	19	25	21	98	
		118A	17.0	20.4	29	30	27	92	34	35	31	96	32	35	29	94	36	40	33	98	
		119A	34.0	40.9	55	60	50	92	60	60	55	96	57	60	52	94	62	70	57	98	
HIGH	NONE	17.0	20.4	—	17	20	17	106	21	25	22	110	19	20	19	108	23	25	24	112	
		118A	17.0	20.4	33	35	30	106	38	40	34	110	35	35	32	108	40	40	36	112	
		119A	34.0	40.9	59	60	53	106	63	70	58	110	61	70	55	108	65	70	60	112	

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	NO M. V.-Ph-HZ	ELEC. HTR			NO C.O. or UNPWR C.O.						NO PE.						w/ PWRD C.O.						
		IFM-TYPE	CRHEATER***A00	Nom (kW)	FLA	NO PE.		w/ P.E. (pwrd fr/unit)		NO PE.		w/ PWRD C.O.		NO PE.		w/ PWRD C.O.		NO PE.		w/ PWRD C.O.			
						MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR
507C*A09	208/230-3-60	STD	NONE	-	-	46	60	49	48	226	50	60	49	227	54	80	53	231	54	80	53	231	
			117A	7.8/10.4	21.7/25.0	46/46	60/60	43/43	222/222	48/48	226/226	50/50	60/60	49/49	227/227	54/54	80/80	53/53	231/231	54/54	80/80	53/53	231/231
			110A	12.0/16.0	33.4/38.5	49/55	60/60	44/50	222/222	49/55	226/226	55/61	60/70	50/56	227/227	59/66	80/100	54/60	231/231	59/66	80/100	54/60	231/231
			111A	18.6/24.8	51.7/59.7	72/82	80/90	65/75	222/222	70/79	226/226	78/88	80/90	71/80	227/227	82/92	90/100	75/85	231/231	82/92	90/100	75/85	231/231
			112A	24.0/32.0	66.7/77.0	90/103	100/110	83/95	222/222	87/99	226/226	96/109	100/110	88/100	227/227	101/114	110/125	93/104	231/231	101/114	110/125	93/104	231/231
			112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	222/222	112/128	226/226	123/140	125/150	113/129	227/227	128/145	150/150	118/133	231/231	128/145	150/150	118/133	231/231
	460-3-60	MED	NONE	-	-	51	60	55	54	293	56	80	55	294	60	80	59	298	60	80	59	298	
			117A	7.8/10.4	21.7/25.0	51/51	60/60	45/45	260/260	50/49	264/264	52/52	60/60	51/51	265	56/56	80/80	55/55	269/269	56/56	80/80	55/55	269/269
			110A	12.0/16.0	33.4/38.5	51/57	60/60	46/52	260/260	51/56	264/264	57/63	60/80	52/58	265/265	62/68	80/80	56/62	269/269	62/68	80/80	56/62	269/269
			111A	18.6/24.8	51.7/59.7	74/83	80/90	67/76	260/260	72/81	264/264	80/89	80/90	73/82	265/265	84/94	90/100	77/86	269/269	84/94	90/100	77/86	269/269
			112A	24.0/32.0	66.7/77.0	92/105	100/110	85/96	260/260	89/101	264/264	98/111	100/125	90/102	265/265	103/116	110/125	95/106	269/269	103/116	110/125	95/106	269/269
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	260/260	114/129	264/264	126/142	150/150	115/131	265/265	130/147	150/150	119/135	269/269	130/147	150/150	119/135	269/269
575-3-60	STD	NONE	-	-	23	30	25	108	108	23	30	25	108	23	30	25	108	23	30	25	108		
		116A	13.9	16.7	25	30	22	108	27	110	25	30	24	110	27	30	25	110	27	30	25	110	
		113A	16.5	19.8	28	30	26	108	31	110	31	35	28	110	33	40	30	112	33	40	30	112	
		114A	27.8	33.4	45	50	41	108	48	110	48	50	44	110	50	60	46	112	50	60	46	112	
		115A	33.0	39.7	53	60	49	108	56	110	56	60	51	110	58	60	53	112	58	60	53	112	
		114A+116A	41.7	50.2	66	70	61	108	69	110	66	70	63	110	66	70	65	112	66	70	65	112	
	460-3-60	MED	NONE	-	-	24	30	23	127	127	26	30	25	129	26	30	25	129	26	30	25	129	
			116A	13.9	16.7	26	30	23	127	28	129	28	30	25	129	28	30	25	129	28	30	25	129
			113A	16.5	19.8	29	30	27	127	32	129	32	40	29	129	34	40	31	131	34	40	31	131
			114A	27.8	33.4	46	50	42	127	49	129	49	50	45	129	51	60	47	129	51	60	47	129
			115A	33.0	39.7	54	60	50	127	57	129	57	60	52	129	59	60	54	131	59	60	54	131
			114A+116A	41.7	50.2	67	70	62	127	70	129	70	70	64	129	72	80	66	131	72	80	66	131
575-3-60	STD	NONE	-	-	19	30	17	91	91	22	30	22	95	20	30	19	93	24	30	24	97		
		118A	17.0	20.4	28	30	25	91	33	95	30	35	30	95	30	35	32	97	35	35	32	97	
		119A	34.0	40.9	54	60	49	91	58	95	56	60	53	95	60	70	55	97	60	70	55	97	
		NONE	-	-	19	30	18	95	23	99	21	30	20	99	24	30	24	101	24	30	24	101	
		118A	17.0	20.4	28	30	26	95	33	99	31	35	28	99	35	35	32	97	35	35	32	97	
		119A	34.0	40.9	54	60	49	95	59	99	56	60	51	97	61	70	56	97	61	70	56	97	
575-3-60	HIGH	NONE	-	-	20	30	19	106	106	24	30	21	108	25	30	25	108	25	30	25	108		
		118A	17.0	20.4	29	30	27	106	34	110	32	35	29	108	36	40	33	112	36	40	33	112	
		119A	34.0	40.9	55	60	50	106	60	110	57	60	52	108	62	70	57	108	62	70	57	108	

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	IFM-TYPE	ELEC. HTR				NO C.O. or UNPWR C.O.						w/ PWDR C.O.											
		CRHEATER***A00	Nom (kW)	FLA	NO PE.			w/ PE. (pwrd fr/unit)			NO PE.			w/ PE. (pwrd fr/unit)									
					MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE			
208/230-3-60	STD	NONE	-	-	40	50	42	208	44	44	50	46	212	45	50	47	213	49	60	60	52	217	
		117A	7.8/10.4	21.7/25.0	40/40	50/50	42/42	208/208	44/44	44/44	50/50	46/46	212/212	45/45	50/50	47/47	213/213	49/49	60/60	60/60	52/52	217/217	
		110A	12.0/16.0	33.4/38.5	49/55	60/60	44/50	208/208	53/60	53/60	60/60	49/55	212/212	55/61	60/70	50/56	213/213	59/66	60/70	60/70	54/60	217/217	
		111A	18.6/24.8	51.7/59.7	72/82	80/90	65/75	208/208	76/86	76/86	80/90	70/79	212/212	78/88	80/90	71/80	213/213	82/92	80/90	90/100	75/85	217/217	
		112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	208/208	95/108	95/108	100/110	87/99	212/212	96/109	100/110	88/100	213/213	101/114	110/125	110/125	93/104	217/217	
		112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	208/208	122/139	122/139	125/150	112/128	212/212	123/140	125/150	113/129	213/213	128/145	150/150	150/150	118/133	217/217	
	MED	NONE	-	-	42/42	50/50	44/44	246	46/46	46/46	60/50	48/48	250	47/47	60/60	49/49	251	51/51	51/51	60/60	60/60	54/53	255
		117A	7.8/10.4	21.7/25.0	42/42	50/50	44/44	246/246	46/46	46/46	60/50	48/48	250/250	47/47	60/60	49/49	251/251	51/51	51/51	60/60	60/60	54/53	255/255
		110A	12.0/16.0	33.4/38.5	51/57	60/60	46/52	246/246	56/62	56/62	60/70	51/56	250/250	57/63	60/70	52/58	251/251	62/68	60/70	70/70	56/62	255/255	
		111A	18.6/24.8	51.7/59.7	74/83	80/90	67/76	246/246	78/88	78/88	80/90	72/81	250/250	80/89	80/90	73/82	251/251	84/94	84/94	90/100	77/86	255/255	
		112A	24.0/32.0	66.7/77.0	92/105	100/110	85/96	246/246	97/110	97/110	100/110	89/101	250/250	98/111	100/125	90/102	251/251	103/116	103/116	110/125	95/106	255/255	
		112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	246/246	124/141	124/141	125/150	114/129	250/250	126/142	150/150	115/131	251/251	130/147	130/147	150/150	119/135	255/255	
460-3-60	STD	NONE	-	-	19	20	109	21	21	25	21	111	21	25	22	111	23	25	25	24	27	113	
		116A	13.9	16.7	25	30	22	109	27	27	30	24	111	27	30	25	111	30	30	27	27	113	
		113A	16.5	19.8	28	30	26	109	31	31	35	28	111	31	35	28	111	33	35	30	30	113	
		114A	27.8	33.4	45	50	41	109	48	48	50	43	111	48	50	44	111	50	60	60	46	53	113
		115A	33.0	39.7	53	60	49	109	56	56	60	51	111	56	60	51	111	58	60	60	53	60	113
		114A+116A	41.7	50.2	66	70	61	109	69	69	70	63	111	69	70	63	111	71	80	80	65	65	113
	MED	NONE	-	-	20	25	20	128	21	21	25	22	130	22	25	23	130	24	25	25	25	25	132
		116A	13.9	16.7	26	30	23	128	28	28	30	25	130	28	30	26	130	31	35	35	28	28	132
		113A	16.5	19.8	29	30	27	128	32	32	35	29	130	32	35	29	130	34	35	31	31	132	
		114A	27.8	33.4	46	50	42	128	49	49	50	44	130	49	50	45	130	51	60	60	47	47	132
		115A	33.0	39.7	54	60	50	128	57	57	60	52	130	57	60	52	130	59	60	60	54	54	132
		114A+116A	41.7	50.2	67	70	62	128	70	70	70	64	130	70	70	64	130	72	80	80	66	66	132
HIGH	NONE	-	-	21	25	22	143	23	23	25	24	145	24	25	25	145	25	25	25	27	27	147	
	116A	13.9	16.7	28	30	25	143	30	30	30	27	145	31	35	28	145	33	35	30	30	30	147	
	113A	16.5	19.8	32	35	29	143	34	34	35	31	145	35	35	31	145	37	40	40	33	33	147	
	114A	27.8	33.4	49	50	45	143	51	51	60	47	145	52	60	47	145	54	60	60	49	49	147	
	115A	33.0	39.7	57	60	52	143	59	59	60	54	145	60	60	54	145	62	70	70	56	56	147	
	114A+116A	41.7	50.2	70	70	64	143	72	72	80	66	145	73	80	66	145	75	80	80	68	68	147	
575-3-60	STD	NONE	-	-	16	20	85	19	19	25	20	89	17	20	18	87	21	25	25	22	22	91	
	118A	17.0	20.4	28	30	25	85	33	33	35	30	89	30	30	27	87	35	35	32	32	91		
	119A	34.0	40.9	54	60	49	85	58	58	60	53	89	56	60	51	87	60	70	55	55	91		
MED	NONE	-	-	16	20	89	20	20	25	20	93	18	20	20	18	91	21	25	25	22	22	95	
	118A	17.0	20.4	28	30	26	89	33	33	35	30	93	31	35	28	91	35	35	32	32	95		
	119A	34.0	40.9	54	60	49	89	59	59	60	54	93	58	60	51	91	61	70	56	56	95		
HIGH	NONE	-	-	17	20	100	21	21	25	20	104	18	20	20	19	102	22	25	25	23	23	106	
	118A	17.0	20.4	29	30	27	100	34	34	35	31	104	32	35	29	102	36	40	33	33	106		
	119A	34.0	40.9	55	60	50	100	60	60	60	55	104	57	60	52	102	62	70	57	57	106		

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	IM- TYPE	ELEC. HTR				NO C.O. or UNPWR C.O.						NO PWRD C.O.							
		CRHEATER**A00	Nom (kW)	FLA	NO PE.			w/ P.E. (pwrdr fr/unit)			NO PE.			w/ P.E. (pwrdr fr/unit)					
					MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA			
208/230-3-60	STD	NONE	-	-	44	263	50	60	48	267	51	60	50	268	55	80	54	272	
		117A	7.8/10.4	21.7/25.0	46/46	263/263	50/50	60/60	48/48	267/267	51/51	60/60	50/50	268/268	55/55	80/80	54/54	272/272	
		110A	12.0/16.0	33.4/38.5	49/55	263/263	53/60	60/60	49/55	267/267	55/61	60/60	50/56	268/268	59/66	80/80	54/60	272/272	
		112A	24.0/32.0	66.7/77.0	90/103	263/263	95/108	100/110	87/99	267/267	96/109	100/110	100/110	88/100	268/268	101/114	110/125	93/104	272/272
		112A+117A	31.8/42.4	88.4/102.0	117/134	263/263	122/139	125/150	112/128	267/267	123/140	125/150	110/125	111/129	268/268	128/145	150/175	118/133	272/272
		112A+110A	37.6/50.0	104.2/120.3	137/127	263/263	142/132	150/150	130/149	267/267	143/133	150/150	131/150	268/268	148/138	150/150	136/154	136/154	272/272
	MED	NONE	-	-	50	319	55	80	55	323	56	80	56	324	60	80	60	328	
		117A	7.8/10.4	21.7/25.0	52/52	319/319	55/55	80/80	55/55	323/323	56/56	80/80	56/56	324/324	60/60	80/80	60/60	328/328	
		110A	12.0/16.0	33.4/38.5	55/62	319/319	60/67	80/80	55/61	323/323	61/68	80/80	56/62	324/324	66/73	80/80	60/66	328/328	
		112A	24.0/32.0	66.7/77.0	97/110	319/319	102/115	110/125	93/105	323/323	103/116	110/125	110/125	94/106	324/324	108/121	110/125	99/111	328/328
		112A+117A	31.8/42.4	88.4/102.0	124/141	319/319	129/146	150/150	118/134	323/323	130/147	150/150	110/125	119/135	324/324	135/152	150/175	124/139	328/328
		112A+110A	37.6/50.0	104.2/120.3	144/134	319/319	149/139	150/150	136/155	323/323	150/140	150/150	138/156	324/324	155/145	175/175	142/160	142/160	328/328
460-3-60	HIGH	NONE	-	-	54/53	321	80/80	58/57	325	59/59	80/80	59/58	326	63/62	80/80	64/63	330		
		117A	7.8/10.4	21.7/25.0	55/54	321/321	58/58	80/80	58/57	325/325	59/59	80/80	59/58	326/326	63/62	80/80	64/63	330/330	
		110A	12.0/16.0	33.4/38.5	59/64	321/321	64/69	80/80	58/63	325/325	65/70	80/80	60/64	326/326	70/75	80/80	64/69	330/330	
		112A	24.0/32.0	66.7/77.0	101/113	321/321	106/117	110/125	97/108	325/325	107/119	110/125	98/109	326/326	112/123	125/125	102/113	330/330	
		112A+117A	31.8/42.4	88.4/102.0	128/144	321/321	133/149	150/150	122/136	325/325	134/150	150/150	123/137	326/326	139/155	150/175	127/142	330/330	
		112A+110A	37.6/50.0	104.2/120.3	148/137	321/321	152/141	150/150	140/157	325/325	154/143	175/175	141/158	326/326	158/147	175/175	145/163	330/330	
	STD	NONE	-	-	24	133	27	40	26	135	28	40	27	135	30	45	29	137	
		116A	13.9	16.7	26	133	27	40	26	135	28	40	27	135	30	45	29	137	
		113A	16.5	19.8	28	133	31	40	28	135	31	40	28	135	33	45	30	137	
		115A	33.0	39.7	53	133	56	60	51	135	56	60	51	135	58	60	53	137	
		114A+116A	41.7	50.2	66	133	69	70	63	135	69	70	63	135	69	70	65	137	
		115A+113A	50.0	60.1	64	133	66	70	74	135	67	70	75	135	69	70	77	137	
575-3-60	HIGH	NONE	-	-	27	161	45	29	163	30	45	30	163	32	45	32	165		
		116A	13.9	16.7	28	161	30	45	29	163	31	45	30	163	33	45	32	165	
		113A	16.5	19.8	32	161	34	45	31	163	35	45	31	163	37	45	33	165	
		115A	33.0	39.7	57	161	59	60	54	163	59	60	54	163	62	70	56	165	
		114A+116A	41.7	50.2	70	161	72	80	66	163	73	80	66	163	75	80	68	165	
		115A+113A	50.0	60.1	67	161	69	80	77	163	70	80	78	163	72	80	80	165	
	STD	NONE	-	-	19	95	23	30	22	99	21	30	20	97	24	30	24	101	
		118A	17.0	20.4	28	95	33	35	30	99	31	35	28	97	35	35	32	101	
		119A	34.0	40.9	54	95	59	60	54	99	56	60	51	97	61	70	56	101	
		118A+119A	51.0	61.3	64	95	69	80	77	99	66	70	75	97	71	80	79	101	
		NONE	-	-	20	106	24	30	23	110	21	30	21	108	25	30	25	112	
		118A	17.0	20.4	29	106	34	35	31	110	32	35	29	108	36	40	33	112	
HIGH	NONE	-	-	23	120	26	30	26	124	24	30	24	122	28	35	28	126		
	118A	17.0	20.4	33	120	38	40	34	124	35	40	34	122	40	40	36	126		
	119A	34.0	40.9	59	120	63	70	58	124	61	70	55	122	65	70	60	126		
	118A+119A	51.0	61.3	69	120	74	80	81	124	71	80	79	122	76	80	83	126		
	NONE	-	-	23	120	26	30	26	124	24	30	24	122	28	35	28	126		
	118A	17.0	20.4	33	120	38	40	34	124	35	40	34	122	40	40	36	126		

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor — (Units Produced On or Before 02/15/2015)

UNIT	NO M, V-Ph-HZ	ELEC. HTR				NO PE.				NO C.O. or UNPWR C.O.				w/ PWRD C.O.										
		IFRM TYPE	CRHEATER**A00	Nom (kW)	FLA	MCA	MAX FUSE or BRKR	DISC. SIZE		MCA	MAX FUSE or BRKR	DISC. SIZE		MCA	MAX FUSE or BRKR	DISC. SIZE								
								FLA	LRA			FLA	LRA			FLA	LRA	FLA	LRA					
50TC+D14	460-3-60	STD	NONE	—	62/62	80/80	64/64	376	66/66	80/80	69/69	380	67/67	80/80	67/67	80/80	70/70	381	71/71	80/80	74/74	385		
			117A	7.8/10.4	21-7/25.0	21-7/25.0	64/64	80/80	67/67	390/390	66/66	80/80	69/69	380/380	67/67	80/80	67/67	80/80	70/70	381/381	71/71	80/80	74/74	385/385
			110A	12.0/16.0	33-4/38.5	33-4/38.5	64/64	80/80	69/69	376/376	66/66	80/80	69/69	380/380	67/67	80/80	67/67	80/80	70/70	381/381	71/71	80/80	74/74	385/385
			112A	24.0/32.0	66-7/77.0	66-7/77.0	86/86	100/110	86/86	376/376	99/112	100/125	91/102	390/380	100/113	100/125	100/113	100/125	92/104	381/381	105/118	110/125	96/108	385/385
			112A+117A	31.8/42.4	88-4/102.0	88-4/102.0	111/127	125/150	111/127	376/376	126/143	150/150	116/131	390/380	127/144	150/150	127/144	150/150	117/132	381/381	132/149	150/150	121/137	385/385
			112A+110A	37.6/50.0	104-2/120.3	104-2/120.3	141/131	150/150	129/148	376/376	146/136	150/150	134/152	390/390	147/137	150/150	147/137	150/150	135/153	381/381	152/142	175/150	139/158	385/385
			NONE	—	64	390	68	80	67	390	68	80	71	394	69	80	72	395	73	395	80	77	399	
			117A	7.8/10.4	21-7/25.0	21-7/25.0	64/64	80/80	67/67	390/390	66/66	80/80	71/71	394/394	69/69	80/80	72/72	395/395	73/73	395/395	80/80	77/77	399/399	
			110A	12.0/16.0	33-4/38.5	33-4/38.5	64/64	80/80	67/67	390/390	68/68	80/80	71/71	394/394	69/69	80/80	72/72	395/395	73/73	395/395	80/80	77/77	399/399	
			112A	24.0/32.0	66-7/77.0	66-7/77.0	97/110	100/110	89/101	390/390	102/115	110/125	93/105	394/394	103/116	110/125	103/116	110/125	94/106	395/395	108/121	110/125	99/111	399/399
50TC+D14	460-3-60	HIGH	NONE	—	67/66	80/80	70/69	392	71/70	80/80	75/74	386	72/71	80/80	72/71	80/80	76/75	387	76/75	80/90	80/79	401		
			117A	7.8/10.4	21-7/25.0	21-7/25.0	67/66	80/80	70/69	392/392	71/70	80/80	75/74	386/386	72/71	80/80	76/75	387/387	76/75	90/90	80/79	401/401		
			110A	12.0/16.0	33-4/38.5	33-4/38.5	67/66	80/80	70/69	392/392	71/70	80/80	75/74	386/386	72/71	80/80	76/75	387/387	76/75	90/90	80/79	401/401		
			112A	24.0/32.0	66-7/77.0	66-7/77.0	101/113	110/125	92/103	392/392	106/117	110/125	97/108	396/386	107/119	110/125	107/119	110/125	98/109	397/397	112/123	125/125	102/113	401/401
			112A+117A	31.8/42.4	88-4/102.0	88-4/102.0	128/144	150/150	117/132	392/392	133/149	150/150	122/136	396/396	134/150	150/150	134/150	123/137	397/397	139/155	150/175	127/142	401/401	
			112A+110A	37.6/50.0	104-2/120.3	104-2/120.3	148/137	150/150	135/153	392/392	152/141	175/175	140/157	396/396	154/143	175/175	154/143	141/158	397/397	158/147	175/175	145/163	401/401	
			NONE	—	31	189	33	40	32	189	33	40	34	191	33	40	34	191	35	40	40	36	193	
			116A	13.9	16.7	16.7	31	40	32	189	33	40	34	191	33	40	34	191	35	40	40	36	193	
			113A	16.5	19.8	19.8	31	40	32	189	33	40	34	191	33	40	34	191	35	40	40	36	193	
			115A	33.0	39.7	39.7	55	60	50	189	58	60	53	191	58	60	53	191	60	60	60	55	193	
575-3-60	460-3-60	MED	NONE	—	68	80	63	189	71	80	65	191	71	80	65	191	73	80	80	67	79	193		
			114A+116A	41.7	50.2	50.2	68	70	63	189	71	80	65	191	71	80	65	191	73	80	67	79		
			115A+113A	50.0	60.1	60.1	68	70	74	189	68	80	76	191	69	80	76	191	71	80	67	79		
			NONE	—	32	196	34	40	33	196	34	40	35	198	34	40	36	198	36	45	38	200		
			116A	13.9	16.7	16.7	32	40	33	196	34	40	35	198	34	40	36	198	36	45	38	200		
			113A	16.5	19.8	19.8	32	40	33	196	34	40	35	198	35	40	36	198	37	45	38	200		
			115A	33.0	39.7	39.7	57	60	52	196	59	60	54	198	59	60	54	198	62	70	56	200		
			114A+116A	41.7	50.2	50.2	70	70	64	196	72	80	66	198	73	80	66	198	75	80	68	200		
			115A+113A	50.0	60.1	60.1	67	80	75	196	69	80	77	198	70	80	78	198	72	80	80	200		
			NONE	—	33	197	35	40	34	197	35	40	36	199	35	40	37	199	37	45	39	201		
575-3-60	460-3-60	STD	NONE	—	23	30	23	142	27	30	28	146	24	30	25	144	28	30	30	30	148			
			118A	17.0	20.4	20.4	29	30	27	142	34	35	31	146	32	35	29	144	36	40	33			
			119A	34.0	40.9	40.9	55	60	50	142	60	60	55	146	57	60	52	144	62	70	57			
			118A+119A	51.0	61.3	61.3	65	70	74	142	70	80	78	146	67	70	76	144	72	80	80			
			NONE	—	23	30	23	142	27	30	28	30	28	146	24	30	25	144	28	30	30			
			118A	17.0	20.4	20.4	29	30	27	142	34	35	31	146	32	35	29	144	36	40	33			
			119A	34.0	40.9	40.9	55	60	50	142	60	60	55	146	57	60	52	144	62	70	57			
			118A+119A	51.0	61.3	61.3	65	70	74	142	70	80	78	146	67	70	76	144	72	80	80			
			NONE	—	26	30	27	156	29	156	29	35	31	160	27	30	29	158	31	35	33			
			118A	17.0	20.4	20.4	33	35	30	156	38	40	34	160	35	35	32	158	40	40	36			
119A	34.0	40.9	40.9	59	60	53	156	63	70	58	160	61	70	55	158	65	70	60						
118A+119A	51.0	61.3	61.3	69	80	77	156	74	80	81	160	71	80	79	158	76	80	83						

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	NO M, V - Ph -HZ	ELEC. HTR				NO C.O. or UNPWR C.O.						w/ PWRD C.O.										
		IFM-TYPE	CRHEATER***A00	Nom (kW)	FLA	NO PE.			w/ P.E. (pwrd fr/unit)			NO PE.			w/ P.E. (pwrd fr/unit)							
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE FLA LRA					
50TC'D16	STD	NONE		-	-	70/70	80/80	72/72	412	73/73	80/80	77/77	416	74/74	90/90	78/78	417	78/78	100/100	82/82	421	
		291A	34.4/39.7	12.4/16.5	34.4/39.7	70/70	80/80	72/72	412/412	73/73	80/80	77/77	416/416	74/74	90/90	78/78	417/417	78/78	100/100	82/82	421/421	
		294A	69.9/80.6	25.2/33.5	69.9/80.6	98/112	100/125	90/102	412/412	103/116	110/125	110/125	94/107	416/416	104/118	110/125	96/108	417/417	109/122	110/125	100/112	421/421
		288A+294A	90.7/104.7	32.7/43.5	90.7/104.7	124/142	125/150	114/130	412/412	129/146	150/150	150/150	118/134	416/416	130/148	150/150	119/135	417/417	135/152	150/175	124/140	421/421
		291A+294A	104.3/120.3	37.6/50.0	104.3/120.3	141/131	150/150	130/148	412/412	146/136	150/150	150/150	134/152	416/416	147/137	150/150	135/153	417/417	152/142	175/150	139/158	421/421
		294A+294A	139.7/161.2	50.3/67.0	139.7/161.2	151/172	175/200	170/195	412/412	155/177	175/200	175/200	175/199	416/416	157/178	175/200	176/200	417/417	161/183	175/200	180/205	421/421
		NONE		-	-	72	80	75	426	76	100	100	79	430	77	100	80	431	80	100	85	435
		291A	34.4/39.7	12.4/16.5	34.4/39.7	72/72	80/80	75/75	426/426	76/76	100/100	100/100	79/79	430/430	77/77	100/100	80/80	431/431	80/80	100/100	85/85	435/435
		294A	69.9/80.6	25.2/33.5	69.9/80.6	101/114	110/125	93/105	426/426	106/119	110/125	110/125	97/109	430/430	107/120	110/125	98/110	431/431	112/125	125/125	102/115	435/435
		288A+294A	90.7/104.7	32.7/43.5	90.7/104.7	127/145	150/150	116/133	426/426	132/149	150/150	150/150	121/137	430/430	133/151	150/175	122/138	431/431	138/155	150/175	126/142	435/435
291A+294A	104.3/120.3	37.6/50.0	104.3/120.3	144/134	150/150	132/151	426/426	149/139	150/150	150/150	137/155	430/430	150/140	150/150	138/156	431/431	155/145	175/175	142/160	435/435		
294A+294A	139.7/161.2	50.3/67.0	139.7/161.2	159/175	175/200	173/198	426/426	158/180	175/200	175/200	177/202	430/430	159/181	175/200	178/203	431/431	164/186	175/200	183/207	435/435		
460-3-60	STD	NONE		-	-	35	45	36	242	37	45	38	244	37	45	39	244	40	50	41	246	
		292A	16.5	16.5	16.5	35	45	36	242	37	45	38	244	37	45	39	244	40	50	41	246	
		295A	33.5	33.5	33.5	56	60	51	242	58	60	53	244	59	60	54	244	61	70	56	246	
		289A+295A	43.5	43.5	43.5	71	80	65	242	73	80	67	244	74	80	68	244	76	80	70	246	
		292A+295A	60.2	50.0	60.2	66	74	74	242	68	80	76	244	69	80	77	244	71	80	79	246	
		295A+295A	80.6	67.0	80.6	86	100	98	242	89	100	100	100	244	89	100	100	100	100	102	246	
		NONE		-	-	36	45	38	249	38	50	40	251	251	39	50	40	251	40	50	42	253
		292A	16.5	16.5	16.5	36	45	38	249	38	50	40	251	251	39	50	40	251	40	50	42	253
		295A	33.5	33.5	33.5	57	60	52	249	60	60	55	251	251	60	60	55	251	62	70	57	253
		289A+295A	43.5	43.5	43.5	72	80	66	249	75	80	68	251	251	75	80	69	251	77	80	71	253
292A+295A	60.2	50.0	60.2	67	80	75	249	70	80	77	251	251	70	80	78	251	72	80	80	253		
295A+295A	80.6	67.0	80.6	88	100	99	249	90	100	100	101	251	90	100	101	251	93	100	103	253		
HIGH	STD	NONE		-	-	41	50	43	252	43	50	45	254	43	50	46	254	45	50	48	256	
		292A	16.5	16.5	16.5	41	50	43	252	43	50	45	254	43	50	46	254	45	50	48	256	
		295A	33.5	33.5	33.5	64	70	58	252	66	70	60	254	66	70	61	254	69	70	63	256	
		289A+295A	43.5	43.5	43.5	79	80	72	252	81	90	74	254	81	90	74	254	84	90	76	256	
		292A+295A	60.2	50.0	60.2	73	80	81	252	76	80	83	254	76	80	83	254	78	80	86	256	
		295A+295A	80.6	67.0	80.6	94	100	104	252	96	100	100	106	254	97	100	107	254	99	100	109	256

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 109 - Unit Wire/Fuse or HACR Breaker Sizing Data with Single Speed Indoor Fan Motor (cont.)

UNIT	NO M, V, Pn-HZ	ELEC. HTR			NO C.O. or UNPWR C.O.						w/ PWRD C.O.													
		IFM-TYPE	CRHEATER**A00	Nom (kW)	FLA	NO PE.			w/ P.E. (pwrdr fr/unit)			NO PE.			w/ P.E. (pwrdr fr/unit)									
						MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	LRA	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	LRA	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	LRA				
STD		NONE	—	—	—	27	30	28	184	184	31	40	32	188	188	29	35	30	186	186	32	40	34	190
		293A	16.5	15.9	—	27	30	28	184	184	31	40	32	188	188	29	35	30	186	186	32	40	34	190
		296A	33.5	32.2	—	44	45	40	184	184	49	50	45	188	188	46	50	42	186	186	51	60	47	190
		290A+296A	43.5	41.8	—	56	60	51	184	184	61	70	56	188	188	58	60	53	186	186	63	70	58	190
		293A+296A	50.0	48.1	—	52	60	59	184	184	57	60	63	188	188	54	60	60	186	186	59	60	65	190
		296A+296A	67.0	64.4	—	68	80	77	184	184	73	80	82	188	188	70	80	79	186	186	75	80	84	190
MED	575-3-60	NONE	—	—	—	27	30	28	184	184	31	40	32	188	188	29	35	30	186	186	32	40	34	190
		293A	16.5	15.9	—	27	30	28	184	184	31	40	32	188	188	29	35	30	186	186	32	40	34	190
		296A	33.5	32.2	—	44	45	40	184	184	49	50	45	188	188	46	50	42	186	186	51	60	47	190
		290A+296A	43.5	41.8	—	56	60	51	184	184	61	70	56	188	188	58	60	53	186	186	63	70	58	190
		293A+296A	50.0	48.1	—	52	60	59	184	184	57	60	63	188	188	54	60	60	186	186	59	60	65	190
		296A+296A	67.0	64.4	—	68	80	77	184	184	73	80	82	188	188	70	80	79	186	186	75	80	84	190
HIGH		NONE	—	—	—	33	40	35	196	196	37	45	39	200	200	35	40	37	198	198	39	45	41	202
		293A	16.5	15.9	—	33	40	35	196	196	37	45	39	200	200	35	40	37	198	198	39	45	41	202
		296A	33.5	32.2	—	52	60	47	196	196	57	60	52	200	200	54	60	49	198	198	59	60	54	202
		290A+296A	43.5	41.8	—	64	70	58	196	196	69	70	63	200	200	66	70	60	198	198	71	80	65	202
		293A+296A	50.0	48.1	—	60	70	66	196	196	65	70	70	200	200	62	70	68	198	198	67	70	72	202
		296A+296A	67.0	64.4	—	76	80	84	196	196	81	90	89	200	200	78	80	86	198	198	83	90	91	202

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 110 - Unit Wire/Fuse or HACR Breaker Sizing Data with 2 Speed Indoor Fan Motor (cont.)

UNIT	IMM-TYPE	ELEC. HTR				NO C.O. or UNPWR C.O.				NO P.E.				w/ PWRD C.O.						
		CRHEATER**A00	Nom (kW)	FLA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	MCA	DISC. SIZE		MAX FUSE or HACR BRKR	MCA	DISC. SIZE				
							FLA	LRA				FLA	LRA			FLA	LRA	FLA	LRA	
50TC*D12	STD	NONE	-	-	46/46	60/60	48/47	255	50/50	60/60	52/52	259	51/51	60/60	53/53	260	60/60	58/57	264	
		117A	7.8/10.4	21.7/25.0	46/46	60/60	48/47	255/255	50/50	60/60	52/52	259/259	51/51	60/60	53/53	260/260	60/60	58/57	264/264	
		110A	12.0/16.0	33.4/38.5	51/57	60/60	48/52	255/255	56/62	60/70	52/56	259/259	57/63	60/70	53/58	260/260	70/80	58/62	264/264	
		112A	24.0/32.0	66.7/77.0	93/105	100/110	89/101	259/259	97/110	100/110	89/101	259/259	99/111	100/125	100/125	90/102	260/260	110/125	95/106	264/264
		112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	255/255	125/141	125/150	114/129	259/259	126/142	150/150	150/150	115/131	260/260	131/147	120/135	264/264
		112A+110A	37.6/50.0	104.2/120.3	140/129	150/150	128/146	255/255	144/134	150/150	150/150	132/151	259/259	146/135	150/150	134/152	260/260	150/140	138/156	264/264
	MED	NONE	-	-	50/49	60/60	52/51	305	54/53	60/60	56/55	309	55/54	60/60	58/56	310	58/57	70/70	62/61	314
		117A	7.8/10.4	21.7/25.0	50/49	60/60	52/51	305/305	54/53	60/60	56/55	309/309	55/54	60/60	58/56	310/310	58/57	70/70	62/61	314/314
		110A	12.0/16.0	33.4/38.5	56/61	60/70	52/56	305/305	60/66	60/70	56/60	309/309	62/67	70/70	58/61	310/310	66/72	70/80	62/65	314/314
		112A	24.0/32.0	66.7/77.0	97/109	100/110	89/100	305/305	102/114	110/125	93/104	309/309	103/115	110/125	103/115	95/105	310/310	108/120	99/110	314/314
		112A+117A	31.8/42.4	88.4/102.0	124/140	125/150	114/129	305/305	129/145	130/146	118/133	309/309	130/146	150/150	150/150	120/134	310/310	135/151	124/138	314/314
		112A+110A	37.6/50.0	104.2/120.3	144/133	150/150	132/150	305/305	149/138	150/150	137/154	309/309	150/139	150/150	150/150	138/155	310/310	155/144	142/160	314/314
460-3-60	STD	NONE	-	-	53/52	60/60	55/54	316	56/55	60/60	60/59	320	57/56	70/60	61/60	321	65/64	325		
		116A	13.9	16.7	23	30	23	122	25	30	26	124	25	30	26	124	27	30	28	
		113A	16.5	19.8	27	30	27	122	32	35	29	124	24	32	35	29	124	31	35	
		115A	33.0	39.7	54	60	50	122	57	60	52	124	52	60	52	124	59	60	54	
		114A+116A	41.7	50.2	67	70	62	122	70	70	64	124	72	70	70	72	80	66	78	
		115A+113A	50.0	60.1	73	80	73	122	67	70	75	124	75	70	70	76	80	78	80	
	MED	NONE	-	-	24	30	25	147	26	30	27	149	26	30	28	149	28	30	30	
		116A	13.9	16.7	27	30	25	147	30	30	27	149	30	30	28	149	32	35	30	
		113A	16.5	19.8	31	35	28	147	34	35	30	149	34	35	31	149	36	40	33	
		115A	33.0	39.7	56	60	51	147	58	60	53	149	59	60	54	149	61	70	56	
		114A+116A	41.7	50.2	69	70	63	147	72	80	65	149	72	80	66	149	74	80	68	
		115A+113A	50.0	60.1	67	80	75	147	69	80	77	149	69	80	77	149	72	80	79	
575-3-60	STD	NONE	-	-	26	30	27	152	28	30	29	154	28	30	29	154	30	32		
		116A	13.9	16.7	29	30	27	152	32	35	29	154	32	35	29	154	34	35		
		113A	16.5	19.8	33	35	30	152	35	35	32	154	36	40	33	154	38	40		
		115A	33.0	39.7	58	60	53	152	60	60	55	154	61	70	56	154	63	70		
		114A+116A	41.7	50.2	71	80	65	152	73	80	67	154	74	80	68	154	76	80		
		115A+113A	50.0	60.1	69	80	76	152	71	80	79	154	71	80	79	154	74	80		
	MED	NONE	-	-	18	20	19	95	22	25	23	99	21	25	21	97	24	25		
		118A	17.0	20.4	30	30	27	95	35	35	32	99	32	35	29	97	34	35		
		119A	34.0	40.9	56	60	51	95	61	70	55	99	58	60	53	97	63	70		
		118A+119A	51.0	61.3	66	70	75	95	71	80	79	99	68	80	76	97	73	80		
		NONE	-	-	19	25	20	104	23	25	24	108	21	25	22	106	25	30		
		118A	17.0	20.4	32	35	29	104	36	40	33	108	34	35	31	106	38	40		
HIGH	NONE	-	-	21	25	22	118	25	30	26	122	23	25	24	120	26	30			
	118A	17.0	20.4	34	35	31	118	38	40	35	122	36	40	34	120	41	45			
	119A	34.0	40.9	59	60	54	118	64	70	59	122	61	70	56	120	66	70			
	118A+119A	51.0	61.3	67	80	76	104	72	80	80	108	70	80	78	106	74	80			
	NONE	-	-	21	25	22	118	25	30	26	122	23	25	24	120	26	30			
	118A	17.0	20.4	34	35	31	118	38	40	35	122	36	40	34	120	41	45			

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 110 - Unit Wire/Fuse or HACR Breaker Sizing Data with 2 Speed Indoor Fan Motor (cont.) — (Units Produced On or Prior to 02/15/2015)

UNIT	NO M. V-PH-HZ	ELEC. HTR				NO P.E.				NO P.E.				w/ PWRD C.O.										
		CRHEATER**A00	Nom (kW)	FLA	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	w/ P.E. (pwrd fr/unit)	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	w/ P.E. (pwrd fr/unit)	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	MCA	w/ P.E. (pwrd fr/unit)				
50TC*D14	460-3-60	STD	NONE	-	-	30	35/153	392/392	152/141	175/175	40	33	182	33	34	34	40	36	184	34	36	184		
			116A	13.9	16.7	30	31	180	32	140	40	33	182	33	34	34	40	36	184	34	36	184		
			113A	16.5	19.8	30	31	180	32	140	40	33	182	33	34	34	40	36	184	34	36	184		
			115A	33.0	39.7	55	58	180	52	182	57	60	52	182	58	58	60	60	53	182	60	55	184	
			114A+116A	41.7	50.2	68	70	180	62	180	70	70	64	182	71	71	70	80	65	182	73	80	67	184
			115A+119A	50.0	60.1	65	67	180	73	180	68	80	76	182	68	69	70	80	77	182	70	78	184	
			NONE	-	-	31	31	192	33	392/392	152/141	175/175	40	35	194	34	34	40	35	194	35	37	196	
			116A	13.9	16.7	31	31	192	33	392/392	152/141	175/175	40	35	194	34	34	40	35	194	35	37	196	
			113A	16.5	19.8	31	31	192	33	392/392	152/141	175/175	40	35	194	34	34	40	35	194	35	37	196	
			115A	33.0	39.7	56	58	192	51	192	58	60	53	194	59	59	60	60	54	194	61	56	196	
			114A+116A	41.7	50.2	71	69	197	65	197	73	80	67	199	74	74	80	80	68	199	76	80	70	201
			115A+119A	50.0	60.1	69	67	197	76	197	71	80	79	199	71	71	80	80	77	199	74	80	81	201
575-3-60	208/230-3-60	STD	NONE	-	-	24	142	142	28	30	30	146	26	26	30	27	144	30	32	148	32	148		
			118A	17.0	20.4	24	28	142	36	144	30	30	146	34	34	35	35	31	144	38	40	35	148	
			119A	34.0	40.9	57	57	142	62	142	62	70	57	146	59	59	60	54	144	64	70	59	148	
			118A+119A	51.0	61.3	67	67	142	72	142	72	80	80	146	70	70	80	78	144	74	80	82	148	
			NONE	-	-	24	28	142	36	144	30	30	146	26	26	30	27	144	30	32	148	32	148	
			118A	17.0	20.4	24	28	142	36	144	30	30	146	34	34	35	35	31	144	38	40	35	148	
			119A	34.0	40.9	57	57	142	62	142	62	70	57	146	59	59	60	54	144	64	70	59	148	
			118A+119A	51.0	61.3	67	67	142	72	142	72	80	80	146	70	70	80	78	144	74	80	82	148	
			NONE	-	-	26	26	156	32	160	28	35	32	160	28	28	30	29	158	32	35	34	35	162
			118A	17.0	20.4	26	26	156	32	160	28	35	32	160	28	28	30	29	158	32	35	34	35	162
			119A	34.0	40.9	59	59	156	64	160	64	70	59	160	61	61	70	56	158	66	70	60	60	162
			118A+119A	51.0	61.3	70	70	156	74	160	74	80	82	160	72	72	80	80	158	76	80	84	84	162

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 110 - Unit Wire/Fuse or HACR Breaker Sizing Data with 2 Speed Indoor Fan Motor (cont.)

UNIT	ELEC. HTR				NO C.O. or UNPWR C.O.																	
	IFM-TYPE	CRHEATER***A00	Nom (kW)	FLA	I NO RE.				w/ PE. (pwrd fr/unit)				NO RE.				w/ PWRD C.O.					
					MAX FUSE or BRKR	MCA	FLA	DISC. SIZE	LRA	MCA	MAX FUSE or BRKR	FLA	DISC. SIZE	LRA	MCA	MAX FUSE or BRKR	FLA	DISC. SIZE	LRA	MCA	MAX FUSE or BRKR	FLA
50TC*16	STD	NONE	-	-	70/69	80/80	73/72	393	74/73	80/80	77/76	397	75/74	90/80	78/77	398	78/78	100/100	82/82	402/402	402	
		291A	12.4/16.5	34.4/39.7	70/69	80/80	73/72	393/393	74/73	80/80	77/76	397/397	75/74	90/80	78/77	398/398	78/78	100/100	82/82	402/402	402	
		294A	25.2/33.5	69.9/80.6	99/111	100/125	90/102	393/393	103/116	110/125	95/106	397/397	105/117	110/125	110/125	96/107	398/398	109/122	110/125	100/112	402/402	402
		288A+294A	32.7/43.5	90.7/104.7	125/141	125/150	114/129	393/393	129/146	150/150	119/134	397/397	131/147	150/150	150/150	120/135	398/398	135/152	150/175	124/139	402/402	402
		291A+294A	37.6/50.0	104.3/120.3	142/131	150/150	130/147	393/393	146/135	150/150	134/152	397/397	149/137	150/150	150/150	135/153	398/398	152/141	175/150	140/157	402/402	402
		294A+294A	50.3/67.0	139.7/161.2	151/171	175/200	171/194	393/393	156/176	175/200	175/199	397/397	157/177	175/200	175/200	176/200	398/398	162/182	175/200	180/204	402/402	402
	MED	NONE	-	-	72/71	80/80	75/74	417	76/75	100/90	79/78	421	77/76	100/100	81/79	422	81/80	100/100	85/84	426	426	
		291A	12.4/16.5	34.4/39.7	72/71	80/80	75/74	417/417	76/75	100/90	79/78	421/421	77/76	100/100	81/79	422/422	81/80	100/100	85/84	426/426	426	
		294A	25.2/33.5	69.9/80.6	101/113	110/125	93/104	417/417	106/118	110/125	97/108	421/421	107/119	110/125	110/125	98/109	112/124	125/125	103/114	426/426	426	
		288A+294A	32.7/43.5	90.7/104.7	127/144	150/150	117/132	417/417	132/148	150/150	121/136	421/421	133/154	150/150	150/150	122/137	422/422	138/154	150/175	127/142	426/426	426
		291A+294A	37.6/50.0	104.3/120.3	144/133	150/150	132/150	417/417	149/138	150/150	137/154	421/421	150/139	150/150	150/150	138/155	422/422	155/144	175/175	142/160	426/426	426
		294A+294A	50.3/67.0	139.7/161.2	154/174	175/200	173/197	417/417	158/179	175/200	177/201	421/421	160/180	160/180	175/200	179/202	422/422	164/185	175/200	183/207	426/426	426
460-3-60	STD	NONE	-	-	82	100	86	436	85	100	91	436	86	100	92	437	90	100	96	441		
		292A	16.5	19.9	35	45	36	233	37	45	38	235	37	45	38	235	39	50	40	237		
		295A	33.5	40.3	56	60	51	233	58	60	53	235	58	60	53	235	61	70	55	237		
		288A+295A	43.5	52.3	71	80	65	233	73	80	67	235	73	80	67	235	76	80	69	237		
		292A+295A	50.0	60.2	65	70	74	233	68	80	76	235	68	80	76	235	70	80	78	237		
		295A+295A	67.0	80.6	86	90	97	233	88	100	99	235	89	100	100	235	91	100	102	237		
	MED	NONE	-	-	36	45	37	245	38	50	39	247	38	50	40	247	40	50	42	249		
		292A	16.5	19.9	36	45	37	245	38	50	39	247	38	50	40	247	40	50	42	249		
		295A	33.5	40.3	57	60	52	245	59	60	54	247	60	60	55	247	62	70	57	249		
		288A+295A	43.5	52.3	72	80	66	245	74	80	68	247	75	80	68	247	77	80	70	249		
		292A+295A	50.0	60.2	67	80	75	245	69	80	77	247	70	80	77	247	72	80	79	249		
		295A+295A	67.0	80.6	87	100	98	245	89	100	100	247	90	100	100	247	92	100	103	249		
HIGH	NONE	-	-	41	50	43	252	43	50	45	254	43	50	46	254	45	50	48	256			
	292A	16.5	19.9	41	50	43	252	43	50	45	254	43	50	46	254	45	50	48	256			
	295A	33.5	40.3	64	70	58	252	66	70	60	254	66	70	61	254	69	70	63	256			
	288A+295A	43.5	52.3	79	80	72	252	81	90	74	254	81	90	74	254	84	90	76	256			
	292A+295A	50.0	60.2	73	80	81	252	76	80	83	254	76	80	83	254	78	80	86	256			
	295A+295A	67.0	80.6	94	100	104	252	96	100	106	254	97	100	107	254	99	100	109	256			

See "Legend and Notes for Tables 109 & 110" on page 140.

ELECTRICAL INFORMATION

Table 110 - Unit Wire/Fuse or HACR Breaker Sizing Data with 2 Speed Indoor Fan Motor (cont.)

UNIT	NO M, V, Ph, HZ	ELEC. HTR			NO C.O. or UNPWR C.O.						w/ PWRD C.O.							
		CRHEATER**A00	Nom (kW)	FLA	I NO PE.			w/ P.E. (pwrdr fr/unit)			NO PE.			w/ P.E. (pwrdr fr/unit)				
					MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	LRA	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE	LRA	MCA	MAX FUSE or HACR BRKR	FLA	DISC. SIZE
STD		NONE	-	-	30	184	32	40	34	188	30	35	32	186	34	40	36	190
		293A	16.5	15.9	30	184	32	40	34	188	30	35	32	186	34	40	36	190
		296A	33.5	32.2	42	184	51	60	47	188	48	50	44	186	53	60	49	190
		290A+296A	43.5	41.8	53	184	63	70	58	188	60	60	55	186	65	70	60	190
		293A+296A	50.0	48.1	60	184	59	60	65	188	56	60	62	186	61	70	67	190
		296A+296A	67.0	64.4	79	184	75	80	84	188	73	80	81	186	77	80	86	190
MED	575-3-60	NONE	-	-	30	184	32	40	34	188	30	35	32	186	34	40	36	190
		293A	16.5	15.9	30	184	32	40	34	188	30	35	32	186	34	40	36	190
		296A	33.5	32.2	42	184	51	60	47	188	48	50	44	186	53	60	49	190
		290A+296A	43.5	41.8	53	184	63	70	58	188	60	60	55	186	65	70	60	190
		293A+296A	50.0	48.1	60	184	59	60	65	188	56	60	62	186	61	70	67	190
		296A+296A	67.0	64.4	79	184	75	80	84	188	73	80	81	186	77	80	86	190
HIGH		NONE	-	-	35	196	37	45	39	200	35	40	37	198	39	45	41	202
		293A	16.5	15.9	35	196	37	45	39	200	35	40	37	198	39	45	41	202
		296A	33.5	32.2	47	196	57	60	52	200	54	60	49	198	59	60	54	202
		290A+296A	43.5	41.8	58	196	69	70	63	200	66	70	60	198	71	80	65	202
		293A+296A	50.0	48.1	66	196	65	70	70	200	62	70	68	198	67	70	72	202
		296A+296A	67.0	64.4	84	196	81	90	89	200	78	80	86	198	83	90	91	202

See "Legend and Notes for Tables 109 & 110" on page 140.

Legend and Notes for Tables 109 & 110

- LEGEND:**
- BRKR Circuit breaker
 - CO Convenience outlet
 - DISC Disconnect
 - FLA Full load amps
 - IFM Indoor Fan Motor
 - LRA Locked rotor amps
 - MCA Minimum circuit amps
 - MOCP MAX FUSE or HACR Breaker
 - PE Power exhaust
 - PWRD CO Powered convenient outlet
 - UNPWR CO Unpowered convenient outlet

NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.
2. **Unbalanced 3-Phase Supply Voltage**
Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



- AB = 224 V
- BC = 231 V
- AC = 226 V

$$\text{Average Voltage} = \frac{(224 + 231 + 226)}{3} = \frac{681}{3}$$

$$= 227$$

Determine maximum deviation from average voltage.

$$\text{(AB) } 227 - 224 = 3 \text{ v}$$

$$\text{(BC) } 231 - 227 = 4 \text{ v}$$

$$\text{(AC) } 227 - 226 = 1 \text{ v}$$

Maximum deviation is 4 v.

Determine percent of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{4}{227}$$

$$= 1.76\%$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

SEQUENCE OF OPERATION

General

The sequence below describes the sequence of operation for an electromechanical unit with and without a factory installed EconoMi\$er™ IV and X (called “economizer” in this sequence). For information regarding a direct digital controller, see the start-up, operations, and troubleshooting manual for the applicable controller.

Electromechanical units with no economizer

Cooling (Single speed indoor fan motor) —

When the thermostat calls for cooling, terminals G and Y1 are energized. As a result, the indoor fan contactor (IFC) and the compressor contactor (C1) are energized, causing the indoor fan motor (IFM), compressor #1, and outdoor fan to start. If the unit has 2 stages of cooling, the thermostat will additionally energize Y2. The Y2 signal will energize compressor contactor #2 (C2), causing compressor #2 to start. Regardless of the number of stages, the outdoor fan motor runs continuously while unit is cooling.

Cooling (2-speed indoor fan motor) —

Per ASHRAE 90.1 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%).

Heating

NOTE: The 50TC is sold as cooling only. If electric heaters are required, use only factory-approved electric heaters. They will operate as described below.

Units have either 1 or 2 stages of electric heat. When the thermostat calls for heating, power is applied to the W1 terminal at the unit. The unit control will energize the indoor fan contactor and the first stage of electric heat. On units with 2-stage heating, when additional heating is required, the second stage of electric heat (if equipped) will be energized when power is applied at the W2 terminal on the unit.

Electromechanical units with an economizer

Cooling —

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor air damper is modulated by the EconoMi\$er IV and X control to provide a 50°F (10°C) to 55°F (13°C) mixed air temperature into the zone. As the mixed air temperature fluctuates above 55°F (13°C) or below 50°F (10°C) dampers will be modulated (open or close) to bring the mixed air temperature back within control. If mechanical cooling is utilized with free cooling, the outdoor air damper will maintain its current position at the time the compressor is started. If the

increase in cooling capacity causes the mixed air temperature to drop below 45°F (9°C), then the outdoor air damper position will be decreased to the minimum position. If the mixed air temperature continues to fall, the outdoor air damper will close. Control returns to normal once the mixed air temperature rises above 48°F (9°C). The power exhaust fans will be energized and de-energized, if installed, as the outdoor air damper opens and closes.

If field-installed accessory CO₂ sensors are connected to the EconoMi\$er IV and X control, a demand controlled ventilation strategy will begin to operate. As the CO₂ level in the zone increases above the CO₂ setpoint, the minimum position of the damper will be increased proportionally. As the CO₂ level decreases because of the increase in fresh air, the outdoor air damper will be proportionally closed. For EconoMi\$er IV and X operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the EconoMi\$er IV and X control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the EconoMi\$er IV and X damper to the minimum position.

On the initial power to the EconoMi\$er IV and X control, it will take the damper up to 2 1/2 minutes before it begins to position itself. After the initial power-up, further changes in damper position can take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1 1/2 and 2 1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed air temperature setpoint at 50°F (10°C) to 55°F (13°C). If there is a further demand for cooling (cooling second stage - Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed air temperature setpoint. The EconoMi\$er IV and X damper will be open at maximum position. EconoMi\$er IV and X operation is limited to a single compressor.

2-Speed Note: When operating in ventilation mode only, the indoor fan motor will automatically adjust to 2/3rd of the total cfm established.

Heating

The sequence of operation for the heating is the same as an electromechanical unit with no economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor air damper is closed when the indoor fan is not operating.

SEQUENCE OF OPERATION (cont.)

Optional Humidi-MiZer® Dehumidification System

NOTE: Last order date for 50TC 04-06 units with Humidi-MiZer is October, 12, 2015. Use KC, HC or LC models after the last order date.

Units with the factory equipped Humidi-MiZer option are capable of providing multiple modes of improved dehumidification as a variation of the normal cooling cycle. The Humidi-MiZer option includes additional valves in the liquid line and discharge line of each refrigerant circuit, a small reheat condenser coil downstream of the evaporator, and Motormaster variable-speed control of some or all outdoor fans. Operation of the revised refrigerant circuit for each mode is described below.

The Humidi-MiZer system provides three sub-modes of operation: Cool, Reheat1, and Reheat2.

Cool mode - provides a normal ratio of Sensible and Latent Cooling effect from the evaporator coil.


Reheat1 - provides increased Latent Cooling while slightly reducing the Sensible Cooling effect.

Reheat2 - provides normal Latent Cooling but with null or minimum Sensible Cooling effect delivered to the space.

The Reheat1 and Reheat2 modes are available when the unit is not in a Heating mode and when the Low Ambient Lockout switch is closed.


The following diagrams depict piping for Single Stage cooling units.

SEQUENCE OF OPERATION (cont.)

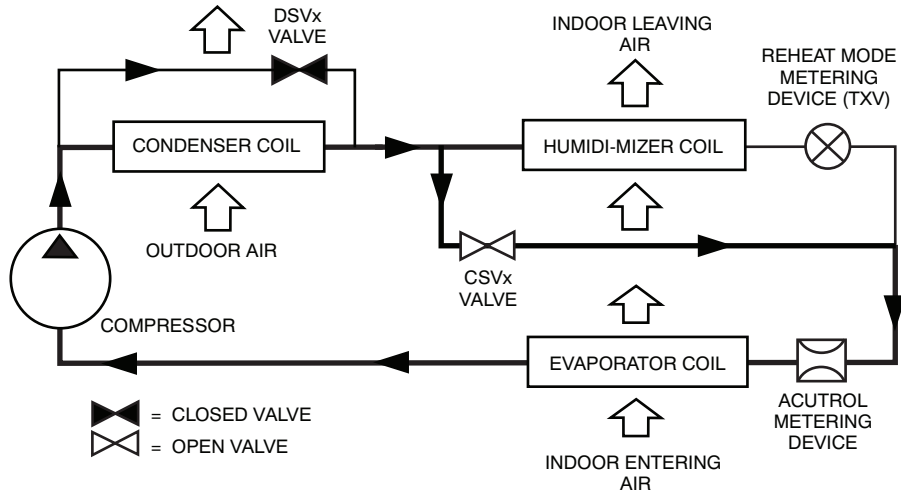


C12647

Normal Cooling Mode - Humidi-MiZer System with Single Stage Cooling

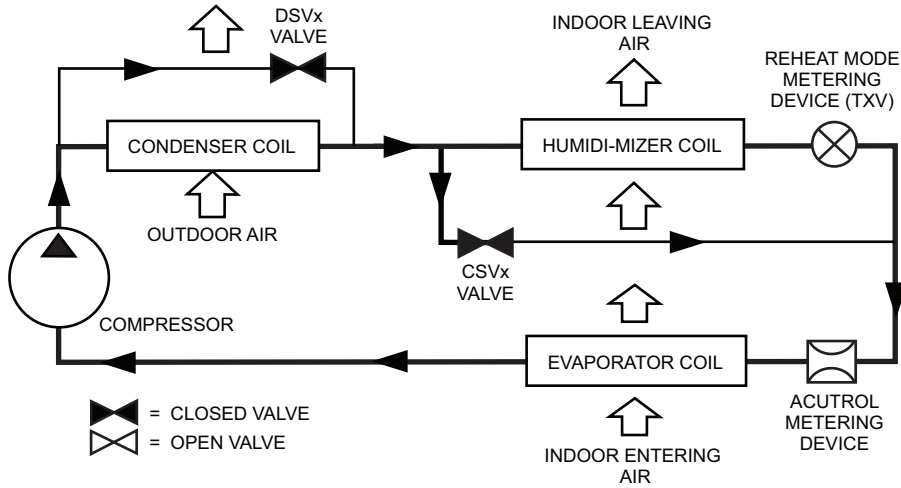

C12648

Subcooling Mode (Reheat 1) - Humidi-MiZer System with Single Stage Cooling

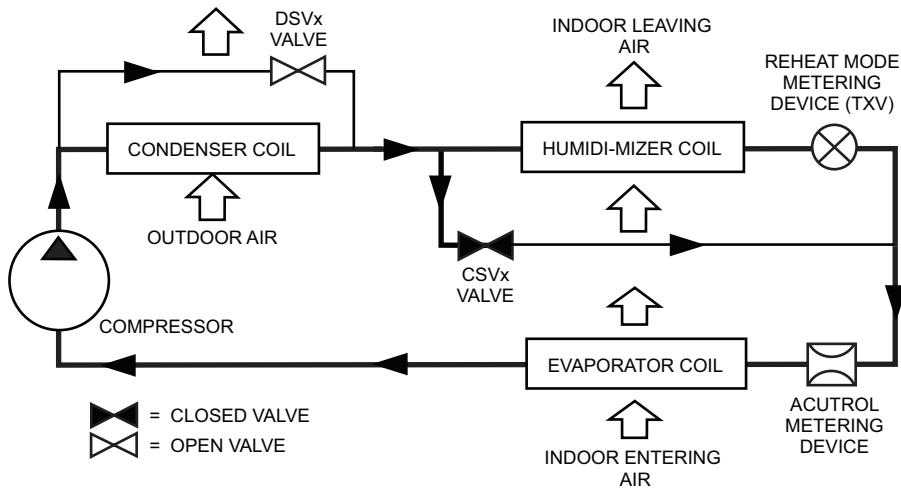

C12649

Hot Gas Reheat Mode (Reheat 2) - Humidi-MiZer System with Single Stage Cooling

**Cooling Only/Electric Heat Packaged Rooftop
HVAC Guide Specifications**

Size Range: 3 to 15 Nominal Tons



Section Description

23 06 80 Schedules for Decentralized HVAC Equipment

- 23 06 80.13 Decentralized Unitary HVAC Equipment Schedule
- 23 06 80.13.A. Rooftop unit schedule
 - 1. Schedule is per the project specification requirements.

23 07 16 HVAC Equipment Insulation

- 23 07 16.13 Decentralized, Rooftop Units:
 - 23 07 16.13.A. Evaporator fan compartment:
 - 1. Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
 - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
 - 23 07 16.13.B. Electric heat compartment:
 - 1. Aluminum foil-faced fiberglass insulation shall be used.
 - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 13 Instrumentation and Control Devices for HVAC

- 23 09 13.23 Sensors and Transmitters
 - 23 09 13.23.A. Thermostats
 - 1. Thermostat must
 - a. energize both “W” and “G” when calling for heat.
 - b. have capability to energize 2 different stages of cooling, and 2 different stages of heating.
 - c. include capability for occupancy scheduling.

23 09 23 Direct-digital Control system for HVAC

- 23 09 23.13 Decentralized, Rooftop Units:
 - 23 09 23.13.A. PremierLink controller
 - 1. Shall be ASHRAE 62 compliant.
 - 2. Shall accept 18-32VAC input power.
 - 3. Shall have an operating temperature range from -40°F (-40°C) to 158°F (70°C), 10% - 95% RH (non-condensing).
 - 4. Shall include an integrated economizer controller to support an economizer with 4 to 20 mA actuator input and no microprocessor controller.
 - 5. Controller shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, indoor relative humidity, compressor lock-out, fire shutdown, enthalpy, fan status, remote time clock/door switch.
 - 6. Shall accept a CO₂ sensor in the conditioned space, and be Demand Control Ventilation (DCV) ready.
 - 7. Shall provide the following outputs: Economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, heat stage 3/ exhaust/ reversing valve/ dehumidify/ occupied.
 - 8. Unit shall provide surge protection for the controller through a circuit breaker.
 - 9. Shall be Internet capable, and communicate at a Baud rate of 38.4K or faster
 - 10. Shall have an LED display independently showing the status of activity on the communication bus, and processor operation.
 - 11. Shall include an RS-485 protocol communication port, an access port for connection of either a computer or a Carrier technician tool, an RS-485 port for network communication to intelligent space sensors and displays, and a port to connect an optional LonWorks plug-in communications card.
 - 12. Shall have built-in Carrier Comfort Network (CCN) protocol, and be compatible with other CCN devices, including ComfortLink and ComfortVIEW controllers.
 - 13. Shall have built-in support for Carrier technician tool.

14. Software upgrades will be accomplished by local download. Software upgrades through chip replacements are not allowed.
 15. Shall be shock resistant in all planes to 5G peak, 11ms during operation, and 100G peak, 11ms during storage.
 16. Shall be vibration resistant in all planes to 1.5G @ 20-300 Hz.
 17. Shall support a bus length of 4000 ft max, 60 devices per 1000 ft section, and 1 RS-485 repeater per 1000 ft sections.
- 23 09 23.13.B. RTU Open - Open protocol, direct digital controller:
1. Shall be ASHRAE 62 compliant.
 2. Shall accept 18-30VAC, 50-60Hz, and consumer 15VA or less power.
 3. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10% - 90% RH (non-condensing).
 4. Shall include built-in protocol for BACNET (MS/TP and PTP modes), Modbus (RTU and ASCII), Johnson N2 and LonWorks. LonWorks Echelon processor required for all Lon applications shall be contained in separate communication board.
 5. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers
 6. Baud rate Controller shall be selectable using a dipswitch.
 7. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.
 8. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/humidity/ remote occupancy.
 9. Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, heat stage 3/ exhaust/ reversing valve.
 10. Shall have built-in surge protection circuitry through solid state polyswitches. Polyswitches shall be used on incoming power and network connections. Polyswitches will return to normal when the "trip" condition clears.
 11. Shall have a battery backup capable of a minimum of 10,000 hours of data and time clock retention during power outages.
 12. Shall have built-in support for Carrier technician tool.
 13. Shall include an RS-485 protocol communication port, an access port for connection of either a computer or a Carrier technician tool, an RS-485 port for network communication to intelligent space sensors and displays, and a port to connect an optional LonWorks communications card.
 14. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color-coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, DDC control options, and low and high pressure switches.
4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

23 09 33.23.B. Safeties:

1. Compressor over-temperature, over current.
2. Low pressure switch.
 - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
3. High pressure switch.
 - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
4. Automatic reset, motor thermal overload protector.

23 09 93 Sequence of Operations for HVAC Controls

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filters shall be accessible through an access panel with “no-tool” removal as described in the unit cabinet section of this specification (23 81 19.13.G).

23 81 19 Self-Contained Air Conditioners

23 81 19.13 Small-Capacity Self-Contained Air Conditioners (50TC**04-16)

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use Puron refrigerant.
4. Unit shall be installed in accordance with the manufacturer’s instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
2. Unit shall be rated in accordance with AHRI Standards 210/240 and 340/360.
3. Unit shall be designed to conform to ASHRAE 15.
4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
6. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
7. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
8. Roof curb shall be designed to conform to NRCA Standards.
9. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
10. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
12. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.
13. High Efficient Motors listed shall meet section 313 of the Energy Independence and Security Act of 2007 (EISA 2007).

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer’s recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.D. Project Conditions

1. As specified in the contract.

23 81 19.13.E. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation down to 40°F (4°C), ambient outdoor temperatures. Accessory winter start kit is necessary if mechanically cooling at ambient temperatures down to 25°F (-4°C).
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.

5. Unit shall be field convertible from vertical to horizontal airflow on all models. No special kit required on 04-14 models. Supply duct kit required for 16 size model only.
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

23 81 19.13.F. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.G. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210/240 or 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
4. Base of unit shall have a minimum of four locations for thru-the-base gas and electrical connections (factory installed or field installed), standard.
5. Base Rail
 - a. Unit shall have base rails on a minimum of 2 sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - d. Base rail shall be a minimum of 16 gauge thickness.
6. Condensate pan and connections:
 - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 3/4" -14 NPT drain connection, possible either through the bottom or end of the drain pan. Connection shall be made per manufacturer's recommendations.
7. Top panel:
 - a. Shall be a single piece top panel on 04 thru 12 sizes, two piece on 14 and 16 size.
8. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
 - b. Thru-the-base capability
 - (1.) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - (2.) Optional, factory-approved, water-tight connection method must be used for thru-the-base electrical connections.
 - (3.) No basepan penetration, other than those authorized by the manufacturer, is permitted.
9. Component access panels (standard)
 - a. Cabinet panels shall be easily removable for servicing.
 - b. Unit shall have one factory installed, tool-less, removable, filter access panel.
 - c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have molded composite handles.
 - d. Handles shall be UV modified, composite. permanently attached, and recessed into the panel.
 - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
 - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

23 81 19.13.H. Coils

1. Standard Aluminum fin - Copper Tube Coils:
 - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
 - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
2. Optional Pre-coated aluminum-fin condenser coils (3 Phase Models Only):

- a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
- b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
- c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
3. Optional Copper-fin evaporator and condenser coils (3 Phase Models Only):
 - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
 - b. Galvanized steel tube sheets shall not be acceptable.
 - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
4. Optional E-coated aluminum-fin evaporator and condenser coils (3 Phase Models Only):
 - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
 - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
 - c. Color shall be high gloss black with gloss per ASTM D523-89.
 - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
 - e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
 - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
 - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
 - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.
5. Standard All Aluminum Novation Coils:
 - a. Standard condenser coils shall have all aluminum Novation Heat Exchanger Technology design consisting of aluminum multi port flat tube design and aluminum fin. Coils shall be a furnace brazed design and contain epoxy lined shrink wrap on all aluminum to copper connections.
 - b. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
6. Optional E-coated aluminum-fin, aluminum tube condenser coils:
 - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil external surface areas without material bridging between fins or louvers.
 - b. Coating process shall ensure complete coil encapsulation, including all exposed fin edges.
 - c. E-coat thickness of 0.8 to 1.2 mil with top coat having a uniform dry film thickness from 1.0 to 2.0 mil on all external coil surface areas, including fin edges, shall be provided.
 - d. Shall have superior hardness characteristics of 2H per ASTM D3363-00 and cross-hatch adhesion of 4B-5B per ASTM D3359-02.
 - e. Shall have superior impact resistance with no cracking, chipping or peeling per NSF/ANSI 51-2002 Method 10.2.

23 81 19.13.I. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Fixed orifice metering system shall prevent mal-distribution of two-phase refrigerant by including multiple fixed orifice devices in each refrigeration circuit. Each orifice is to be optimized to the coil circuit it serves.
 - b. Refrigerant filter drier.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through a specially designed access port in the top panel of the unit.
2. There shall be gauge line access port in the skin of the rooftop, covered by a black, removable plug.
 - a. The plug shall be easy to remove and replace.
 - b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.
 - c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
 - d. The plug shall be made of a leak proof, UV-resistant, composite material.
3. Compressors
 - a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
 - b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.

- c. Compressors shall be internally protected from high discharge temperature conditions.
- d. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
- e. Compressor shall be factory mounted on rubber grommets.
- f. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
- g. Crankcase heaters shall not be required for normal operating range, unless provided by compressor manufacturer due to refrigerant charge limits.

23 81 19.13.J. Filter Section

- 1. Filters access is specified in the unit cabinet section of this specification.
- 2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
- 3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
- 4. Filters shall be standard, commercially available sizes.
- 5. Only one size filter per unit is allowed.

23 81 19.13.K. Evaporator Fan and Motor

- 1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings.
 - b. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
 - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
- 2. Electric Drive (Direct Drive) X13 – 5 Speed/Torque Evaporator Fan:
 - a. Multi-speed motor with easy quick adjustment settings.
 - b. Blower fan shall be double-inlet type with forward-curved blades.
 - c. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
 - d. Standard on all 04-06 3-phase models without Humidi-MiZer[®], with optional belt drive.
- 3. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball-bearing type.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.L. Condenser Fans and Motors

- 1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design on 04 to 12 and 16 size models and shaft-up design on 14 size with rain shield.
- 2. Condenser Fans:
 - a. Shall be a direct-driven propeller type fan.
 - b. Shall have galvalum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.M. Special Features, Options and Accessories

- 1. 2 Staged Air Volume System (SAV) for 2-stage cooling models only.
 - a. Evaporator fan motor:
 - (1.) Shall have permanently lubricated bearings.
 - (2.) Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating.
 - (3.) Shall be Variable Frequency duty and 2-speed control.
 - (4.) Shall contain motor shaft grounding ring to prevent electrical bearing fluting damage by safely diverting harmful shaft voltages and bearing currents to ground.
- 2. Variable Frequency Drive (VFD). Only available on 2-speed indoor fan motor option (SAV):
 - a. Shall be installed inside the unit cabinet, mounted, wired and tested.
 - b. Shall contain Electromagnetic Interference (EMI) frequency protection.
 - c. Insulated Gate Bi-Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform, allowing for quiet motor operation.

- d. Self diagnostics with fault and power code LED indicator. Field accessory Display Kit available for further diagnostics and special setup applications.
 - e. RS485 capability standard.
 - f. Electronic thermal overload protection.
 - g. 5% swinging chokes for harmonic reduction and improved power factor.
 - h. All printed circuit boards shall be conformal coated.
3. Integrated EconoMi\$er IV, EconoMi\$er2, and EconoMi\$er X standard leak rate models. (Factory installed on 3 phase models only. Field installed on all 3 and 1 phase models)
- a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - f. Standard leak rate shall be equipped with dampers not to exceed 2% leakage at 1 in. wg pressure differential.
 - g. Economizer controller on EconoMi\$er IV models shall be Honeywell W7212 that provides:
 - (1.) Combined minimum and DCV maximum damper position potentiometers with compressor staging relay.
 - (2.) Functions with solid state analog enthalpy or dry bulb changeover control sensing.
 - (3.) Contain LED indicates for:
 - when free cooling is available, when module is in DCV mode, when exhaust fan contact is closed.
 - h. Economizer controller on EconoMi\$er X models shall be the Honeywell W7220 that provides:
 - (1.) 2-line LCD interface screen for setup, configuration and troubleshooting.
 - (2.) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24.
 - (3.) Sensor failure loss of communication identification
 - (4.) Automatic sensor detection
 - (5.) Capabilities for use with multiple-speed indoor fan systems
 - i. Economizer controller on EconoMi\$er 2 models with PremierLink shall be 4-20mA design and controlled by the PremierLink controller. PremierLink does not comply with California Title 24 Fault Detection & Diagnostic (FDD) requirements.
 - (6.) Utilize digital sensors: Dry bulb and Enthalpy
 - j. Economizer controller on EconoMi\$er 2 models with RTU Open models shall be a 4-20mA design controlled directly by the RTU Open controller. RTU Open meets California Title 24 Fault Detection & Diagnostic (FDD) requirements.
 - k. Shall be capable of introducing up to 100% outdoor air.
 - l. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
 - m. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - n. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to 100F /4 to 38C. Additional sensor options shall be available as accessories.
 - o. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
 - p. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
 - q. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - r. Economizer controller shall accept a 2-10 Vdc CO2 sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
 - s. Compressor lockout temperature on W7220 is adjustable from -45°F to 80°F, set at a factory default of 32°F. Others shall open at 35°F (2°C) and closes at 50°F (10°C).
 - t. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.

- u. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
4. Integrated EconoMi\$er2, and EconoMi\$er X Ultra Low Leak rate models. (Factory installed on 3 phase models only. Field installed on all 3 and 1 phase models)
 - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control
 - f. Ultra Low Leak design meets California Title 24 section 140.4 and ASHRAE 90.1 requirements for 4 cfm per sq.ft. on the outside air dampers and 10 cfm per sq. ft. on the return dampers.
 - g. Economizer controller on EconoMi\$er X models shall be the Honeywell W7220 that provides:
 - (1.) 2-line LCD interface screen for setup, configuration and troubleshooting
 - (2.) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24.
 - (3.) Sensor failure loss of communication identification
 - (4.) Automatic sensor detection
 - (5.) Capabilities for use with multiple-speed indoor fan systems
 - (6.) Utilize digital sensors: Dry bulb and Enthalpy
 - h. Economizer controller on EconoMi\$er 2 models with RTU Open models shall be a 4-20mA design controlled directly by the RTU Open controller. RTU Open meets California Title 24 Fault Detection & Diagnostic (FDD) requirements.
 - i. Shall be capable of introducing up to 100% outdoor air.
 - j. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
 - k. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - l. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
 - m. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
 - n. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
 - o. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - p. Economizer controller shall accept a 2-10 Vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
 - q. Compressor lockout temperature on W7220 is adjustable from -45°F to 80°F, set at a factory default of 32°F. Others shall open at 35°F (2°C) and closes at 50°F (10°C).
 - r. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - s. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
 5. Two-Position Damper (Factory installed on 3 Phase Models Only. Field installed on all 3 and 1 Phase Models)
 - a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
 - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
 - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
 - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
 - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
 - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
 - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
 - h. Outside air hood shall include aluminum water entrainment filter

- i. Not available with Staged Air Volume (SAV) models.
- 6. Manual damper
 - a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.
 - b. Not available with Staged Air Volume (SAV) models.
- 7. Humidi-MiZer[®] Adaptive Dehumidification System (3 Phase Models Only):
 - a. The Humidi-MiZer Adaptive Dehumidification System shall be factory installed in single stage 50TC 04-07 (last order date for 50TC 04-06 units with Humidi-MiZer is October, 12, 2015) and 2-stage 50TC08-16 models with RTPF (round tube plate fin) condenser coils, and shall provide greater dehumidification of the occupied space by two modes of dehumidification operations in addition to its normal design cooling mode:
 - (1.) Subcooling mode further subcools the hot liquid refrigerant leaving the condenser coil when both temperature and humidity in the space are not satisfied.
 - (2.) Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a two-phase heat transfer in the system, resulting in a neutral leaving- air temperature when only humidity in the space is not satisfied.
 - (3.) Includes Head Pressure Controller.
- 8. Head Pressure Control Package
 - a. Controller shall control coil head pressure by condenser-fan speed modulation or condenser-fan cycling and wind baffles.
 - b. Shall consist of solid-state control and condenser-coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C).
- 9. Condenser Coil Hail Guard Assembly (Factory installed on 3 Phase Models Only. Field installed on all 3 and 1 Phase Models)
 - a. Shall protect against damage from hail.
 - b. Shall be louvered design.
- 10. Unit-Mounted, Non-Fused Disconnect Switch (Available on units with MOCP's of 80 amps or less):
 - a. Switch shall be factory-installed, internally mounted.
 - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
 - c. Shall be accessible from outside the unit
 - d. Shall provide local shutdown and lockout capability.
- 11. Convenience Outlet
 - a. Powered convenience outlet (3 Phase Models Only)
 - (1.) Outlet shall be powered from main line power to the rooftop unit.
 - (2.) Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
 - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - (5.) Voltage required to operate convenience outlet shall be provided by a factory-installed step-down transformer.
 - (6.) Outlet shall be accessible from outside the unit.
 - (7.) Outlet shall include a field-installed "Wet in Use" cover.
 - b. Non-Powered convenience outlet.
 - (1.) Outlet shall be powered from a separate 115/120v power source.
 - (2.) A transformer shall not be included.
 - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - (5.) Outlet shall be accessible from outside the unit.
 - (6.) Outlet shall include a field-installed "Wet in Use" cover.
- 12. Thru-the-Base Connectors:
 - a. Kits shall provide connectors to permit electrical connections to be brought to the unit through the unit basepan.
 - b. Minimum of four connection locations per unit.
- 13. Supply Duct Cover (16 size only):

- a. Required when field converting the factory standard vertical duct supply to horizontal duct supply configuration. One required per unit.
14. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust is shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
 15. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
 16. Thru-the-Bottom Utility Connectors:
 - a. Kit shall provide connectors to permit gas and electrical connections to be brought to the unit through the basepan.
 17. Outdoor Air Enthalpy Sensor:
 - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
 18. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
 19. Indoor Air Quality (CO₂) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
 20. Smoke detectors (factory-installed only):
 - a. Shall be a Four-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
 - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - (4.) Capable of direct connection to two individual detector modules.
 - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
 21. Winter start kit
 - a. Shall contain a bypass device around the low pressure switch.
 - b. Shall be required when mechanical cooling is required down to 25°F (-4°C).
 - c. Shall not be required to operate on an economizer when below an outdoor ambient of 40°F (4°C).
 22. Time Guard
 - a. Shall prevent compressor short-cycling by providing a 5-minute delay (±2 minutes) before restarting a compressor after shutdown for any reason.
 - b. One device shall be required per compressor.
 23. Electric Heat:
 - a. Heating Section
 - (1.) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.

- (2.) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.
- 24. Disconnect Switch Bracket (16 size only)
 - a. Provides a pre-engineered and sized mounting bracket for applications requiring a unit mounted fused and non-fused disconnect of greater than 100 amps. Bracket assures that no damage will occur to coils when mounting with screws and other fasteners.
- 25. California OSHPD Seismic Certification Label
 - a. Units meet the seismic capacity requirements of the International Code Council Evaluation Service (ICC-ES) document AC156 (Acceptance Criteria for Seismic Qualification by Shake-Table Testing of Nonstructural Components and Systems) and per International Building Code (IBC 2009) at an SDS (g) value of 2.00 z/h=1.0, Ip=1.5 and certified by independent structural engineers.
 - b. Units shall include a certification label that meets the CA OSHPD Special Seismic Certification pre-approval labeling requirements on the external chassis of the unit.
- 26. Hinged Access Panels
 - a. Shall provide easy access through integrated quarter turn latches.
 - b. Shall be on major panels of: filters, control box, fan motor and compressor.
- 27. Display Kit for Variable Frequency Drive
 - a. Kit allows the ability to access the VFD controller programs to provide special setup capabilities and diagnostics.
 - b. Kit contains display module and communication cable.
 - c. Display Kit can be permanently installed in the unit or used on any SAV system VFD controller as needed.